

ITEM #7.A

Brown Act Training Conducted by District General Counsel

OVERVIEW OF THE RALPH M. BROWN ACT (GOVERNMENT CODE SECTION 54950 ET SEQ.)



Mona G. Ebrahimi

General Counsel to the Del Paso Manor Water District



Brown Act In a Nutshell

“All meetings of the legislative body of a local agency shall be open and public, and all persons shall be permitted to attend any meeting of the legislative body of a local agency.”

(Gov. Code, § 54953(a).)



What is a Legislative Body?



- County, City, Special Districts.
 - The Del Paso Manor Water District Board of Directors is a legislative body.
- Other bodies created by “formal action” of another legislative body, including:
 - Standing committees with continuing jurisdiction.
 - A body created by the Board that includes members of the Board and members of the public.

What is *NOT* a Legislative Body?



- Advisory “ad hoc” committees made up solely of less than a quorum of the legislative body with no continuing jurisdiction or fixed meeting schedule.
 - E.g., a committee of two Directors who are tasked with interviewing potential general counsel.
 - Not formed by formal action of a legislative body, rather appointed by the President without action or approval by the Board.

What is a Meeting?

“Any congregation of a majority of the members of a legislative body at the same time and location, including teleconference location as permitted by Section 54953, to *hear, discuss, deliberate, or take action* on any item that is within the subject matter jurisdiction of the legislative body.

(Gov. Code, § 54952.2.)

- *Serial Meetings* – Consensus building through intermediaries or multiple conversations.
- *1-on-1 Discussion* – Individual contacts are fine, as long as there is no serial meeting.
- *Social Media* – AB 992 is more strict on social media use than the Brown Act allows in person.



What is *NOT* a Meeting?

- Individual contacts between legislative bodies and any other person, as long as no “majority”. (Gov. Code, § 54952.2(c)(1).)
- Attendance by a quorum of a legislative body at:
 - Public meetings of other legislative bodies discussing some topic of local concern (e.g., RQWCD, Sacramento County.)
 - Social and ceremonial events (e.g., ground breaking ceremony, retirement party, etc.)
 - Committee meetings with non-committee members present as *observers* (Non-committee members may observe as long as they do not participate in committee business in any fashion (i.e., verbal, written, other input.)



What is *NOT* a Meeting?

- Attendance by a quorum of a legislative body at conferences.
 - Note: small break out sessions or impromptu discussions where specific business of the District is at issue should not be attended by a quorum.
- Conversations at conferences, social and ceremonial events, and public meetings of other legislative bodies may not include discussion of the District's business.
 - Members of the legislative body should diligently self-police conversations they have with their colleagues in these settings.
 - *Perceptions* about groupings of a quorum in these settings should also be considered.



Types of Meetings



- Regular Meeting (72 hours notice)
- Special Meeting (24 hours notice)
- Adjourned or Continued Meetings
- Emergency Meetings (1 hour notice)

Serial Meetings

A majority of the members of a legislative body shall not, outside an authorized meeting, *use a series of communications of any kind, directly or through intermediaries, to discuss, deliberate, or take action on any item of business that is within the subject matter jurisdiction of the legislative body.*

(Gov. Code, § 54952.2.)

- These are not meetings in the traditional sense, but consensus building through intermediaries or multiple conversations among people who are familiar with the thoughts and opinions of others.



Serial Meetings Are Prohibited

- Prohibited Intermediaries (e.g., staff, third parties, members of the public.)
- Types of Serial Meetings
 - Chain Meeting – e.g., $A \rightarrow B \rightarrow C$.
 - Hub and Spoke – e.g., $B \leftarrow A \rightarrow C$.
- Technology
 - Be careful of emails that “CC,” or “Reply-all”; use “BCC.”
 - Avoid texting during meetings, effectively a private meeting.



Closed Sessions

Only those matters identified by statute may be discussed in closed session and only if certain procedures are followed. (Gov. Code, § 54957.7.)



- Common grounds – personnel matters, labor or real estate negotiations, pending/anticipated litigation.
 - The item must be described in the agenda.
 - May be “added on” at a regular meeting.
- Attendance is limited.
 - Depends on the reason for closed session (e.g., legal counsel, labor negotiator.)
 - Staff participation is always limited to essential personnel.
- Prior to going into closed session.
 - Announce the matter to be discussed in closed session.
 - Allow public comment.
- After the closed session.
 - Publically “report out” any action taken.
 - Publically report the vote of each member.

Agenda Requirements



- Content.
 - Time and location of the meeting, including web link/number.
 - Brief description of each item to be discussed.
 - How to obtain assistance (e.g., visually impaired.)
 - Opportunity for public comment on each agenda item.
 - General public comment – only at regular meetings.

- Posting – depends on meeting type.
 - Regular meeting – 72 hours.
 - Special meeting – 24 hours, provide to members and the press.
 - Always post in a place accessible to the public.
 - Always post on the District website.

- Agenda Additions – only at regular meetings due to:
 - Emergency – a majority determines that an “emergency” exists; or
 - Need – 2/3 of the legislative body present, or unanimous if less than 2/3 are present, determine: (1) immediate action is needed, and (2) the need came to the District’s attention after the agenda was posted.

Meeting Conduct

- *Items on the agenda.*
 - May place reasonable time limits on commenters; all speakers must be treated the same.
 - May ask, but cannot require, commenters to give identifying information.
- *Items not on the agenda:*
 - The body cannot discuss items not on the agenda, except to ask for information or give staff direction.



Brown Act Violations



- “Cure and Correct.”
 - A potential plaintiff is first required to ask the District to cure and correct the violation, usually meaning void the action taken, conduct the matter in compliance with the Brown Act, and make a commitment not to violate it again.
 - Appropriate cure and correct action should foreclose the possibility of future violations.
- Civil penalties.
- Criminal penalties.

Questions?



Thank You!



For more information, please visit us at
www.kmtg.com.




ITEM #7.B

Training of Public Notification Requirements Following a Notice of Violation, Conducted by District General Manager.



Del Paso Manor Water District

Emergency Water Plan

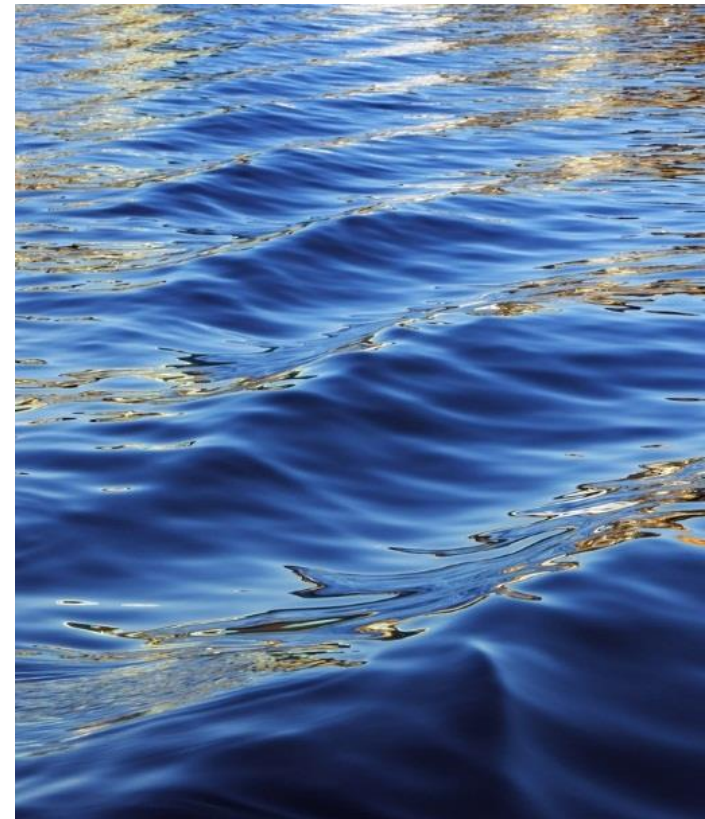

November 5, 2021 Grand Jury Report

- **Recommendation 4** “The DPMWD should notify ratepayers in the required timeframe for any Notice of Violation, including when a water sampling test result exceeds the water Maximum Contaminant Level, along with its corrective actions. The DPMWD Board of Directors and staff should be trained on the public notification requirements and procedures. A new section in the DPMWD Policy Manual should be added to address these public notification requirements. The Grand Jury recommends that the DPMWD complete this training by January 31, 2022, and the Policy Manual should be updated accordingly by March 31, 2022.”
 - Public must be notified within 30 days upon receipt of a Notice of Violation
 - Updates to Policy Manual

California Division of Drinking Water (DDW)

- The State Water Resources Control Board (SWRCB) Division of Drinking Water (DDW) regulates public water systems; oversees water recycling projects; permits water treatment devices; supports and promotes water system security; and performs a number of other functions.
- Drinking water-related statutes are from the Corporations Code, Education Code, Food and Agricultural Code, Government Code, Health and Safety Code, Public Resources Code, and Water Code. Regulations are from Title 17 and Title 22 of the CCR.
- The District serves approximately 1,800 customers, and falls within the “Small Water System” category.

Consumer Confidence Reports (CCRs)

- The preparation of CCRs is required by [Health & Safety Code §116470](#) and [California Code of Regulations, Title 22, Article 20. Health & Safety Code §116470\(b\)](#) also requires public water systems that detect contaminants above their Public Health Goals (PHGs) to provide PHG exceedance reports every three years and to hold public hearings regarding their reports.
- CCRs should cover water quality data from January 1 through December 31 of that year. For example, the 2022 CCR must include data from that time frame, and then be completed and distributed to consumers by **July 1, 2023**. Certification of a completed CCR and consumer notice must be submitted to the DDW by **October 1, 2023**.
 - Historically, the District has retained outside consultants to prepare its CCRs.
 - The District's current consultant is Gemini Group.

Public Notification

- The State of California's drinking water regulations require public notification under certain circumstances. Water systems must contact the Division of Drinking Water's (DDW's) district office if public notification is required. Any notification must be approved by DDW prior to distribution or posting, unless otherwise directed by DDW.
- The form and substance of the notification is dependent on the issue
 - E.g., Boil Water, Do not Drink, DO NOT USE
- THE FOLLOWING THREE SLIDES ARE EXAMPLES OF WHEN NOTICE IS REQUIRED

NOTE -- The District would adhere to the notice templates found on the DDW website (https://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Notices.html)

Types of Unsafe Water Notices and Regulatory Criteria

The three unsafe water notices that can be issued are: "Boil Water", "Do Not Drink" and "Do Not Use". These are termed 'Tier 1' public notices under the California and Federal Public Notification Rules.

- The basis for the use of each of these notices are:
 - **Boil Water Notice:** The water supply has a microbiological contaminant that can be rendered safe by boiling the water or by using bottled water. The notice may provide detailed instructions for manual disinfection by the consumer, where appropriate. This is the most commonly used notice. Note that Boil Water Notices should not be issued where nitrate concentrations are elevated.
 - **Do Not Drink Notice:** The water supply has an acute contaminant that cannot be rendered safe by boiling the water or by disinfection or is an unapproved source with no water quality data.
 - **Do Not Use Notice:** The water supply has an unknown contaminant, or exposure to the water may adversely impact public health. Section 64463.1(b), Title 22, CCR, requires that the water system provide notification to persons served as soon as possible but within 24 hours after learning of a violation specified in 64463.1 (a) or after being notified by the State Board that it has determined there is a potential for adverse effects on human health. Section 64463.1(c), Title 22, CCR, describes the method(s) that must be used by public water systems to deliver the notice to consumers.
- The water supplier should follow its Water Quality Emergency Notification Plan (WQENP) to provide the best methods for immediate notification.
- Among other things, the notice must address whether alternative sources of drinking water should be used, health risks, what actions consumers should take, what corrective action is being taken, and when the notice is expected to be cancelled. The notice should include a brief description of what happened or what was suspected to have happened. If the cause of the problem is unknown, the notice should indicate that the water system is investigating and will report to the public when the information is available or set a specific time for an update on the situation.
- Each public notice must contain the following in Spanish and in any language for each non-English speaking group that exceeds 1,000 residents or 10 percent of the residents in the community served, whichever is less: (1) Information regarding the importance of the notice and (2) A telephone number or address where non-English speaking groups may contact the water system to obtain a translated copy of the notice in the appropriate language. Note that Spanish translations of the templates for all three types of unsafe water notices are provided on the DDW website at the web link provided in Section 1. The water supplier may consider, when practicable, posting notices at locations in public facilities where there are drinking fountains and restrooms as applicable. Modifications to the notice must be approved by the State Board prior to distribution. Section 64469(d), Title 22, CCR, requires that a copy of the notice, along with a certification that the public notice requirements have been met, be sent to the State Board within ten days after issuance of the notice.

Tier 1 **Boil Water** Notification Is Required By Regulation For The Following Circumstances

Tier 1 **Boil Water** notification is required by regulation for the following circumstances and are further detailed in subsection (a) and (b), which also defines failure to conduct repeat sampling as a trigger for Tier 1 notification: · Fecal Coliform or E. coli · Turbidity Exceedance under the Surface Water Treatment Rule · Waterborne Microbial Disease Outbreak · Ground Water Rule – Fecal Indicator – Positive Source Sample

(a) Specific Tier 1 Public Notice triggers that would result in the issuance of a **Boil Water notification, are:**

- (1) Violation of the total coliform MCL when: · Fecal coliform or E. coli are present in the distribution system; or · When any repeat sample tests positive for coliform and the water system fails to test for fecal coliforms or E. coli in the repeat sample;
- (2) Violation of a Chapter 17 treatment technique requirement resulting from a single exceedance of a maximum allowable turbidity level and/or a disinfection treatment failure if: Unsafe the State Board determines after consultation with the water system and a review of the data that a Tier 1 public notice is required; or · The consultation between the State Board and the water system does not take place within 24 hours after the water system learns of the violation;
- (3) Occurrence of a waterborne microbial disease outbreak, as defined in section 64651.91, or other waterborne emergency, a failure or significant interruption in water treatment processes, a natural disaster that disrupts the water supply or distribution system, or a chemical spill or unexpected loading of possible pathogens.

(b) Other incidents that DDW may require issuance of Tier 1 **Do Not Drink public notice includes:**

- 1) Use of an unapproved water source which is located in an area with known nitrate, nitrite, or perchlorate groundwater contamination.
- 2) Identification of a potential cross-connection within the distribution system.

A Tier 1 Do Not Drink (DND) notifications required by regulation.

- Failure to conduct repeat sampling is also defined as a trigger for Tier 1 notification. While some Tier 1 DND notifications specify certain demographics that should not drink the water, it is still mandatory to distribute the notice to all customers receiving the contaminated water.
- Unsafe Water Notice Guidance-November 2021 Do Not Drink notifications required by regulation, and are further detailed in subsection (a) and (b):
 - Nitrate or Nitrite MCL Exceedance
 - Perchlorate MCL Exceedance
 - Chlorite MCL Exceedance
 - Chlorine Dioxide Maximum Residual Disinfectant Level Exceedance(a) Specific Tier 1 Public Notice triggers that would result in a Do Not Drink notification, pursuant to Section 64463.1(a), Title 22, CCR, are:
 - (1) Violation of the MCL for nitrate, nitrite, or total nitrate and nitrite, or when the water system fails to take a confirmation sample within 24 hours of the system's receipt of the first sample showing an exceedance of the nitrate or nitrite MCL;
 - (2) Violation of the MCL for perchlorate or when a system is unable to resample within 48 hours of the system's receipt of the first sample showing an exceedance of the perchlorate MCL as specified in section 64432.3(d)(3)(3) For chlorite:
 - Violation of the MCL for chlorite;
 - When a system fails to take the required sample(s) within the distribution system, on the day following an exceedance of the MCL at the entrance to the distribution system; or
 - When a system fails to take a confirmation sample pursuant to section 64534.2(b)(4); or(4) Violation of the MRDL for chlorine dioxide; or when a system fails to take the required sample(s) within the distribution system, on the day following an exceedance of the MRDL at the entrance to the distribution system.
- (5) Other violation or occurrence that has the potential for adverse effects on human health as a result of short-term exposure, as determined by the State Board based on a review of all available toxicological and analytical data.

Tier 1 Public Notices: DO NOT USE

- Tier 1 Public Notices: **DO NOT USE** Scenarios that may result in the issuance of a **Do Not Use** notification:
 - (1) Reliability of treatment processes is questionable due to operator incompetence, negligence, absence, or lack of attention;
 - (2) A cross-connection incident involving any contaminant;
 - (3) Overfeeding of disinfectant; Unsafe Water Notice Guidance-November 2021 Page 7
 - (4) Deliberate contamination of an unknown chemical, radiological, or microbiological constituent;
 - (5) Overfeed of any treatment chemical that may cause a risk to human health.
 - (6) Other violation or occurrence that has the potential for adverse effects on human health as a result of short-term exposure, as determined by the State Board based on a review of all available toxicological and analytical data.

Emergency Response Plan

- The District is also required to prepare an Emergency Response Plan, which also includes a Notification Plan
 - A copy of this should be provided to the local DDW Drinking Water Field Operations Branch District Office
 - The local office will review the Plan and keep in on file in the event of an emergency
 - Del Paso Manor is within District 9 – Sacramento. The District’s point of contact is Ali Rezvani
 - DWPDIST09@waterboards.ca.gov; Ali.Rezvani@waterboards.ca.gov
 - Phone: (916) 449-5681
- District must also provide a copy of this Plan to the SWRCB for approval
- This Plan must provide for immediate notice to customers in the event of any significant rise in the bacterial count of the water or other failure to comply with the any primary drinking water standard that represents an imminent danger to the health of the water users. (See Health & Safety Code section 116460)

DPMWD Emergency Response Plan

- Staff is directed to immediately consult the District's Emergency Response Plan and Appendix A in the event of a Notice of Violation and follow protocols
- The General Manager is responsible for all oversight, communicating with State and local agencies, and issuing all public notices

DPMWD Emergency Response Plan—Limitations

- The District does not have email addresses of all customers
- The District does not have sufficient staff to call each of the 1,800 customers following a Notice of Violation
- The District currently:
 - Posts mailers/door hangers
 - Mails notices
 - Makes public announcements by bullhorn

DPMWD Emergency Response Plan—Opportunities

- The District is exploring additional alternative notification methods including:
 - Updating NextDoor account to provide important governmental notices
 - Consulting with Sacramento County and Sacramento Suburban Water District for coordinated notification methods
 - Obtaining more customer email addresses through outreach and sending mass email notices during emergencies


DPMWD Emergency Response Plan—Updates

- The District will update its Plan and submit it to all appropriate State agencies in the next few months
 - Target date: On or before March 31, 2022



THANK YOU!

Questions?

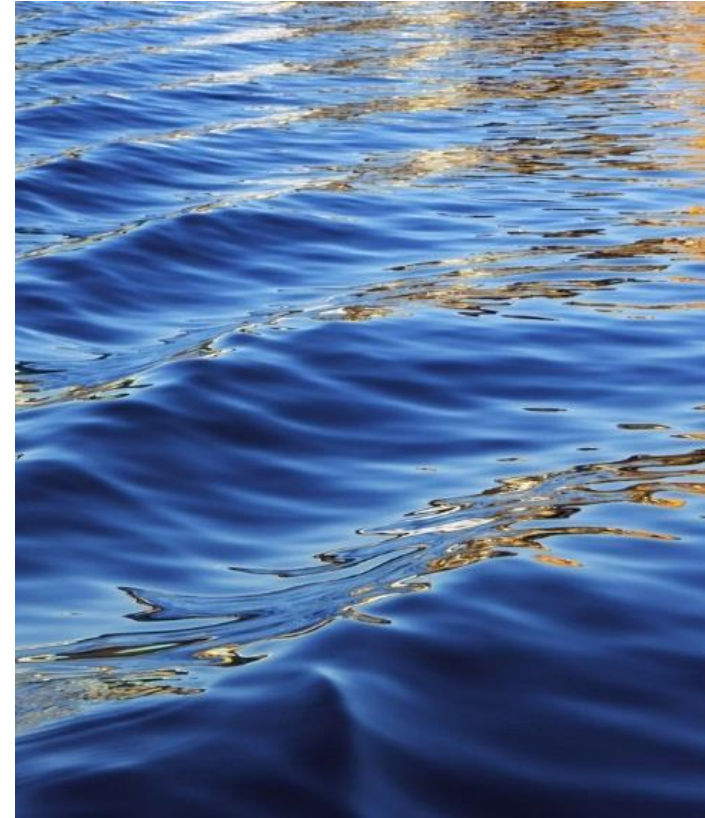

ITEM #7.C

*Discuss, Review and Provide Direction to Staff on Draft Responses
to November 5, 2021 Grand Jury Report.*



DEL PASO MANOR WATER DISTRICT BOARD SPECIAL MEETING STAFF REPORT

MEETING DATE: January 27, 2022

AGENDA ITEM 7C Discuss, Review and Provide Direction to Staff on Draft Responses to November 5, 2021 Grand Jury Report.

EXECUTIVE SUMMARY

Staff requests the Board of Directors consider the draft responses to the Grand Jury Report and provide direction and/or changes. The Board will be asked to approve the final responses at its February 1, 2022 Regular Meeting and subsequently submit the response to the Grand Jury.

BACKGROUND

On November 4, 2021, the Grand Jury issued a report regarding the District's operations and leadership. The District was supposed to respond within 60 days, but the Court allowed the District to provide its response not later than February 4, 2022. On December 20, 2021, the Board was presented with a proposal by staff on preparing responses. Specifically, staff proposed the following outline:

1. An introduction that presents a summary intended for residents and others without a lot of technical information.
2. A traditional Executive Summary of the presentation.
3. The body of the report will provide the District's response to each of the Grand Jury's Findings and Recommendations. By way of example, the response to Finding 1 will include:
 - a. A brief summary of the history from founding of the District to 2006.
 - b. A detailed discussion of the District from 2006 to May 2019.
 - c. A detailed discussion of the District from January 2019 to August 2021.
4. The response to the remaining Findings will likely be more succinct, having already provided the bulk of background information in the response to Finding 1.
5. The response to each Recommendation will likely identify how the District has begun its implementation of the recommendation or the potential timeline for such implementation if appropriate.

Since that meeting, staff has continued to review documents and prepare the response. Rather than prepare an introduction and executive summary, staff proposes a cover letter to Judge Hom

that includes an introductory paragraph, setting the context for the responses. Consistent with prior direction, staff also prepared responses to the Findings and Recommendations, each which were reviewed with input by an ad hoc committee consisting of President Saunders and Director Matteoli.

The responses were drafted to provide a direct answer to the Finding or Recommendation, but also provide background information, to the extent helpful.

The Board of Directors will be asked to approve the final response at its February 1, 2022 meeting, and before it is submitted to the Grand Jury.

This report will be finalized and a hard copy and electronic copy submitted to the Grand Jury no later than February 4, 2022.

Even after submission of the responses to the Grand Jury, the District has a number of items it must accomplish within the next few months including, but not limited to: 1.) Updating its Emergency Notification Plan, 2.) Coordinating with the Sacramento Local Agency Formation Commission to prepare a new Municipal Services Review, and 3.) Prepare an Engineer's Report and finalize the HydroScience Technical Memorandum to initiate a Proposition 218 rate hearing.

ENVIRONMENTAL CONSIDERATIONS

The consideration and creation of the District's response to the November 4, 2021 Grand Jury Report is not a project for purposes of CEQA.

STAFF RESPONSIBLE FOR REPORT: Alan Gardner, General Manager

February 4, 2022

Hon. Russell L. Hom, Presiding Judge
Sacramento County Superior Court
720 9th Street
Sacramento, CA 95814

Dear Judge Hom:

On November 4, 2021, the Del Paso Manor Water District (hereinafter "the District" or "DPMWD") received the Grand Jury Report entitled "Del Paso Manor Water District Flooded with Public Safety Dangers." Pursuant to California Penal Code sections 933 and 933.05, the Grand Jury requested that the District and President Ryan Saunders each respond to the Grand Jury's findings and recommendations.

On December 2, 2021, DPMWD requested an extension of time to respond, which your Honor graciously allowed. DPMWD was required to provide a response by February 4, 2022, and President Saunders was to separately respond.

The District thanks the Court and the Grand Jury for its work. This serves as the District's response, which consists of an Introduction, and replies to each Finding and Recommendation, including supporting exhibits.

INTRODUCTION

The general theme of the Grand Jury's report is that a majority of the immediately prior Board of Directors was "reckless and irresponsible" and failed its customers. The District does not disagree. However, that black mark in its past should not overshadow the many more years of responsible and transparent stewardship the District enjoyed. Importantly, the current leadership is confident that the District can and will comply with all laws and regulations, and once again be accountable to its residents.

Since its formation in 1956, DPMWD has served its customers well, providing reliable potable water at efficient rates, and operated transparently with a well-run governing body. A part of that rich history are systems of wells and distribution infrastructure that also date back 70 years. Not surprisingly, these systems are in need of repairs and improvements. To fund these improvements, the District is required to carry out the constitutional procedures prescribed by Proposition 218. While ratepayers have historically been supportive of necessary rate adjustments, in 2017, a successful grassroots campaign backed the Howard Jarvis Taxpayer Association resulted in a majority protest of a Proposition 218 rate-setting hearing, effectively eliminating revenue generation. That revenue was intended to fund District-wide capital improvements, as well as operation and maintenance costs. The leaders of that campaign went on to serve on the DPMWD Board of Directors in 2019, 2020 and up to and including August 2021, refocusing the District's priorities from safe and functional water service to maintaining low water rates. All the while, much of the District's infrastructure continued to age without redress and the most expensive improvements, unfunded.

With new leadership, DPMWD will once again ensure that customers are provided safe drinking water and are advised of the costs of maintaining and improving the systems that distribute it. The District will again initiate a Proposition 218 hearing and inform the ratepayers of the costs of capital improvements; assuming the rates are approved and adopted, it will implement the balance of the recommendations set forth in its Waster Master Plan and related documents.

The District agrees with the Grand Jury that ratepayers deserve elected representatives who are accountable for their decisions and prioritize the health and safety of the public. Between January 2019 and August 2021, a majority of the Board of Directors admittedly lost sight of these essential priorities, and the District's customers, understandably, lost trust in the District. In the final months of 2021 through the time of the submission of this response, the District has made dramatic changes to personnel and internal procedures in order to re-establish standards of governance and operations that the public can once again rely on to serve its best interests.

Response to Findings

**DEL PASO MANOR WATER DISTRICT'S ("DPMWD" or "District")
RESPONSE TO GRAND JURY FINDINGS**

- F1. The DPMWD has abdicated its mission to “provide safe drinking water in accordance with California and federal regulations and to maintain a reliable water supply for water consumption and fire protection.”**

Response to F1.

The District disagrees with this finding.

Since its establishment in 1956, DPMWD has, for almost all of its history, successfully provided safe drinking water for its customers at cost-efficient rates. District operations have benefitted from a long line of qualified General Managers and District Engineers, all of whom were competent in the laws and regulations governing both the administration of the District, and the provision of water under the control of the District. This is also true of many of the individuals elected to serve on the DPMWD Board of Directors over the years.

Nevertheless, the District acknowledges and agrees that a majority of the Board of Directors in 2019, 2020, and up to and including August 2021 undermined the longstanding precedent of effective management and transparent governance that DPMWD's customers had come to expect. Regretfully, this misguided decision-making diminished the quality of service provided to ratepayers and eroded public trust.

However, since August 2021, the District has made significant changes in an effort to restore the public trust that was lost, to complete outstanding infrastructure improvements, and maintain compliance with the rules and regulations that govern District operations. For example, the District has a new Board of Directors, a new General Manager, and new General Counsel. In the short time that the new leadership has been in place, the District commenced a substantial amount of work to carry out structural changes to the District's governance and, importantly, to execute improvements to the District's aging infrastructure. Among the projects completed or in progress are the following:

- The District repaired or resolved almost all of the items on the list of maintenance and safety concerns prepared by the Sacramento Suburban Water District ("SSWD") in late summer 2021;
- The District entered into an agreement with SSWD on December 10, 2021 to automate all three tie-ins, effectively increasing fire flows on the west, north and east sides of the District;
- The District is currently trying to rehabilitate and extend the life and production of Well Nos. 2, 4 and 7 at a reasonable cost;
- The District is investigating strategies to bring Well No. 3 from "standby" status to full use by employing activated carbon filters and exploring alternatives to recover part or all of the costs;
- The District is preparing the required materials to support a Proposition 218 rate setting hearing in order to raise the necessary funds to cover the costs of completing several more of the improvements recommended by the 2009 Water Master Plan, and the more recently reviewed Draft Technical Memorandum presented by HydroScience Strategic Water Solutions ("HydroScience"); and
- The District has issued a Request for Proposals, seeking a qualified individual or professional company to serve as its Engineer. The Board recommended entering into contract negotiations with Forsgren Associates, Inc. at its January 4, 2022 regular meeting.

These and many more forthcoming improvements demonstrate DPMWD's recommitment to its mission to "provide safe drinking water in accordance with California and federal regulations and to maintain a reliable water supply for water consumption and fire protection." Ratepayer health and safety is the top priority of the District. Moving forward, customers can and should expect that all District actions will be guided by this priority.

F2. The DPMWD has deferred action on the District's 2009 Water Master Plan, the 2011 LAFCO Municipal Service Review, the 2021 HydroScience Strategic Water Solutions Technical Memorandum, and the July 2021 General Manager Final Recommendations Report, all of which outline the urgent need to address the District's critical infrastructure needs for repair or replacement.

Response to F2.

The District agrees in part, and disagrees in part, with this finding.

As the Grand Jury acknowledges in its report on page 3, "Examination of documents shows that recommended expenditures cannot be funded with current revenue from District ratepayers and would result in budget shortfalls in the millions of dollars."

The District's ability to fully implement the action items identified by the named reports and plans has been severely limited by a lack of funding and, in some cases, the ill-advised decisions of the majority of the previous Board of Directors. Proposition 218 restricts local governments' ability to impose assessments and property-related fees, and requires elections to approve other revenue raising methods, such as bonds or taxes. Because of this, the District's capacity to generate revenue to fund important infrastructure improvements largely depends on the consensus of its ratepayers. In 2017, faced with a formidable grassroots campaign that opposed any rate increases, a Proposition 218 rate setting hearing failed to pass, meaning that the District could not move forward with the proposed rate increase which would have funded both capital improvements, and operations and maintenance. As a result, the District was unable to complete a number of recommended infrastructure improvements, including replacing all WWII steel surplus pipes. Fortunately, a 2018 Proposition 218 rate setting hearing to exclusively fund operations and maintenance was passed, albeit much more limited in amount and scope than the District needed.

2009 Water Master Plan. The District agrees that it has not completed several improvements recommended by the 2009 Water Master Plan, because the District has been unable to successfully increase rates to fund those improvements. Even so, the District disagrees that it has entirely deferred action. To the contrary, and per the recommendations and findings of the 2009 Water Master Plan, the District completed the following projects:

- Decommissioning of Well No. 1, and drilling of Well No. 9 , to replace Well No. 1, construction of security facility, current action to install a backup generator;
- Installation of new electrical panels for Well Nos. 2-5;
- Decommissioning of Well No. 6 and drilling of Well No. 6B, including construction of security facility and the installation of new generator;
- Installation and operation of SCADA Central Control System;

- Installation of SCADA equipment at Well Nos. 2-5 and 8; and
- Installation of electrical disconnect switches for Well Nos. 2-5.

2011 LAFCO Municipal Service Review ("MSR"). The District disagrees that it overall deferred actions relating to the 2011 MSR recommended actions. The written determinations adopted by the Sacramento Local Agency Formation Commission ("LAFCO") generally concluded that the District was providing adequate water service to its customers. The then-General Manager provided thorough responses in cooperation with LAFCO's evaluation of the District's Sphere of Influence, relying in large part on the recommendations and findings included within the 2009 Water Master Plan. In fact, the final MSR report concluded that the District had complied with all laws and found that "the Del Paso Manor Water District currently provides adequate services and facilities throughout its service area. However, the District recognizes that continued water line replacement, water meters, and infrastructure replacement are required and necessary to sustain current levels of service and meet future demands. The District has established a rate structure and capital improvement program to facilitate a sustainable water system." As indicated above, the District's rate setting is limited by the Constitutional restrictions set forth in Proposition 218 and is subject to ratepayer approval. The District's abilities to raise funds to construct necessary improvements and carry out the recommendations in the LAFCO MSR and other reports is entirely contingent on these rates. With every successful rate setting passage since 2011, the District has taken steps to comply with the MSR recommendations. By way of example, commercial properties and multi-family connections are metered. In addition, even though the District is considered a "Small Water District" and is not required to meter all connections, since the District is a signatory to the Water Forum Agreement, it has agreed to convert all water connections to meters by 2030. Furthermore, despite the failed Proposition 218 hearing in 2017, the District successfully implemented a rate increase in 2018 to fund operations and maintenance costs. The District also intends to conduct a renewed effort in 2022 to raise much-needed funds to finance capital improvement costs. In so doing, the District will publish a report that outlines the immediate and longer-term water quality, delivery, and fire flow infrastructure improvement needs and the resulting cost impact to District ratepayers. Finally, the District disagrees with the Grand Jury's statement that "the DPMWD has not approved [LAFCO's attempts to conduct a new MSR.]" (Grand Jury Report at p. 8.) MSRs are part of LAFCO's mandates. While LAFCO works cooperatively with public agencies to complete MSRs, and the District has every intent to cooperate, it ultimately does not approve or prevent LAFCO's ability to prepare one.

Further, after the Grand Jury Report was published, the District's new General Manager has had discussions with LAFCO and requested time to demonstrate the current Board's and staffs' positive approach before a new MSR. The District and LAFCO staff held a status meeting on January 27, 2022 to report on the progress.

As such, the District has not deferred action, but has merely been limited in its abilities due to financial constraints.

May 2021 HydroScience Draft Technical Memorandum. The Grand Jury report repeatedly describes the Draft Technical Memorandum as an update to the 2009 Master Plan that was completed in May 2021, but not approved. (See, Report at p. 8.) Actually, the Draft Technical Memorandum has not yet been finalized, and does not update the Master Plan and replace it. As such, the District disagrees with Finding Number 2 that it has deferred action on this document, which reviews the Master Plan and changes to District operations, and provides recommendations on improvements. The Board of Directors addressed several specific findings and recommendations identified in the Draft Technical Memorandum at its

December 10, 2021 Special Meeting. The discussion, including suggested amendments, are more fully discussed in the response to Recommendation Number 2.

July 2021 General Manager Final Recommendations Report. The District disagrees that it has deferred action on the Recommendations Report. This document was only presented to the District in the last few months, and the District has not had sufficient time to respond. Accordingly, it is premature to say that the District has deferred action on the Recommendations Report. As indicated in the District's earlier responses, the District is comprised of a largely new Board of Directors, hired a new General Manager, and appointed new legal counsel. In light of these significant changes, the District will need more time to review and evaluate the previous General Manager's Recommendations Report. The recommendations in the report, like those in the documents identified above, will all be evaluated and prioritized for implementation.

F3. The DPMWD Board of Directors awarded a \$56,830.00 contract to HydroScience Strategic Water Solutions, to complete a Water District Master Plan Update, without officially taking a public re-vote at its December 2020 board meeting to authorize the contract as required by the Sacramento County District Attorney.

Response to F3.

The District disagrees with this finding.

The District cured and corrected its previous defects and substantially complied with the Brown Act during its December 1, 2020 board meeting. As part of its response to Finding Number 3, the District adopts and incorporates herein by reference, the Sacramento District Attorney's response to Finding Number 3 as set forth in **Exhibit 1**. As stated in said Exhibit 1, it was alleged that the Board of Directors did not sufficiently disclose bidding information as required by the Brown Act. After the District cured and corrected the Brown Act violation by disclosing the bid information at its December 1, 2020 board meeting, the District Attorney concluded its investigation. The Board of Directors voted to approve the Capital Improvement Project Budget, which included the \$56,830.00 contract payment to HydroScience, by unanimous vote. The District Attorney's conclusion was informed, in part, by the response provided by the District's prior General Counsel. That response, incorporated herein as **Exhibit 2** confirms that the District's award of contract to HydroScience was re-agendized at the December 1, 2020 Regular Meeting of the Board of Directors and that the public was provided both the relevant bidders' materials, and an opportunity to comment on the item.

F4. During its October 20, 2020 general meeting, the DPMWD Board of Directors failed to provide all of the meeting documents in its board packets to the public. Upon request from the public for the materials, the Board president denied their release to the public as required by both the Brown Act and the Public Records Act.

Response to F4.

The District agrees with this finding, but explains that it subsequently cured and corrected this issue.

The District provided some, but not all, relevant information to the public relating to its October 20, 2020 board meeting. Unfortunately, the then-board President denied release of this information to the public,

claiming that the records were privileged and not subject to disclosure. However, as described in the District's response to Finding Number 3, the actions taken by the Board of Directors at the October 20, 2020 board meeting were subsequently corrected at the December 1, 2020 meeting when the relevant documents were made public. DPMWD is confident that the current Board of Directors, its new General Manager, and the recently appointed General Counsel will act diligently to ensure that the general administration of the District is consistent with applicable laws, including the Brown Act and the Public Records Act. Moving forward, the current Board of Directors intends to participate in the California Special District Association's Certificate of Excellence Program for District Transparency and periodic legal trainings, as described more fully in the response to Recommendation Number 7. These efforts, among others, underscore the District's renewed commitment to transparency and public engagement.

F5. The DPMWD failed to follow the California State Water Resources Control Board, Division of Drinking Water guidance in publicly reporting notable Maximum Contamination Level violations in the required timeframe. Additionally, the DPMWD did not follow the prescribed reporting requirements in the Consumer Confidence Reports (2018, 2019).

Response to F5.

The District agrees with this finding in part.

As this Finding relates to several aspects of compliance with the Consumer Confidence Report requirements, this response addresses each separately.

MCL Public Reporting Notification. As described in the Grand Jury Report, the Division of Drinking Water ("DDW") detected the presence of PCE levels that exceeded required levels in a DPMWD water sample from Well No. 8 that was taken in 2016. The District was not made aware of this violation for three years. It was not until September 5, 2019 that the District finally received DDW's Notice of Violation, dated August 23, 2019 related to the 2016 exceedance. The District notified the public of the PCE exceedance in its 2019 Consumer Confidence Report ("CCR"), but agrees with Finding Number 5 that the notification was not timely. The District decommissioned Well No. 8 for "Distribution Use" in October 2019, and it has not been used since. The State Water Resources Control Board continues its potential use by placing it on standby. However, the District does not intend to use it unless and until it can ensure that the water can meet MCL requirements.

Furthermore, the District complied with DDW's mandate to immediately initiate monitoring of Well No. 8. Once the DDW 2019 letter was received, the District used the sample results it received on August 27, 2019 as the first quarter sampling. The second quarter sampling was conducted on December 30, 2019, and the third quarter sampling was conducted on February 11, 2020. District staff was unable to locate sample data or a chain of custody of a sample conducted for the fourth quarter, and therefore can neither confirm nor deny whether that quarter's sampling was undertaken. The then-General Manager directed that quarterly sampling be terminated at the end of December 2020. The District's Board of Directors did not hire an interim General Manager until April; there is no record of follow through for sampling by him.

Consumer Confidence Reports.

The District historically retained outside consultants to prepare its CCRs. In 2017, Crocker & Crocker (aka Lucy & Co.) completed the report on behalf of the District. Against the General Manager's

recommendation, the Board terminated the Lucy & Co. contract in February 2019 (before the end of the contract that included developing the 2018 CCR.) The Board directed the General Manager to contact SSWD and Carmichael Water District ("CWD") to assist the District with the development of the CCR. (See **Exhibit 3**, Page 16 – Item #7 of the February 4, 2019 Meeting Minutes.)

The General Manager received letters from both SSWD and CWD stating they could not assist the District. Minutes of April 2, 2019 board meeting reflect that the General Manager informed the Board of this news. The meeting minutes also reflect that the Board retained the Gemini Group to complete the 2018 CCR, as that firm attested that they would prepare a report that was compliant with regulations. (See **Exhibit 4**, page 31 – Item #6 of the April 2, 2019 Meeting Minutes and the Gemini Group letter showing Compliance Guarantee.) The District used this same group to develop the 2019 CCR as well.

The District believed it was in compliance. Corrections will be made in future to ensure compliance, including having DDW review the CCR before it issues.

District staff and the Board of Directors were trained on applicable statutory requirements for drinking water notification levels on January 27, 2022 and will prepare the annual CCR as more fully described in response to Recommendation Number 5.

- F6. The agendas for the public meetings of the DPMWD Board of Directors have provided inadequate and vague descriptions of the items to be discussed or acted upon at its General and Special meetings.**

Response to F6.

The District partially disagrees with this finding.

Until 2019, the District provided well-articulated and clear agendas and reports for all of its meetings. Between 2019, 2020 and until late fall 2021, the District agrees that while it substantially complied with agenda requirements, some past agenda items could have been more accurately described, as illustrated by the examples in the Grand Jury's Report. With a new Board of Directors, new General Manager, and new legal counsel, the District is well positioned to ensure compliance with the relevant public meeting laws and encourage public participation. The District remains committed to providing sufficiently detailed agenda descriptions to ensure the public is fully informed.

- F7. The ambiguous agenda item descriptions of the DPMWD Board of Directors meetings violate the intent of the Ralph M. Brown Act, which is designed to properly inform the public of the business to be undertaken at public meetings by public officials and to encourage their participation.**

Response to F7.

The District partially agrees with this finding.

The District agrees that the October 20, 2020 meeting was the subject of an alleged Brown Act violation, as addressed in the response to Finding Number 3. Furthermore, the District agrees that ambiguity in public meeting agendas and the supporting materials can frustrate effective engagement between the public and their local governing bodies. The District has already taken steps to improve the preparation of its meeting materials by using new agenda and staff report templates that are clear and organized,

participating in a recent Brown Act training, and re-enrolling in the California Special District Association's Certificate of Excellence Program for District Transparency.

EXHIBIT 1



Sacramento County District Attorney's Office

ANNE MARIE SCHUBERT
District Attorney

Rod Norgaard
Chief Deputy

Michael M. Blazina
Assistant District Attorney

January 7, 2022

Honorable Michael G. Bowman, Presiding Judge
Sacramento County Superior Court
720 9th Street, Dept. 47
Sacramento, CA 95814

Re: Sacramento County Grand Jury Report: Del Paso Manor Water District Flooded with
Public Safety Dangers

Dear Judge Bowman:

This letter will serve as my response pursuant to Penal Code sections 933 and 933.05, as invited by the Grand Jury, concerning the portion of the Sacramento County Grand Jury's November 5, 2021, Report entitled, "Del Paso Manor Water District Flooded with Public Safety Dangers." Only Finding F3 mentions the District Attorney's Office:

F3. The DPMWD Board of Directors awarded a \$56,830.00 contract to HydroScience Strategic Water Solutions, to complete a Water District Master Plan Update, without officially taking a public re-vote at its December 2020 board meeting to authorize the contract as required by the Sacramento County District Attorney.

This finding relates to the DPMWD Board's decision to award a \$56,830.00 contract to HydroScience Strategic Water Solutions to complete a Water District Master Plan Update. According to this finding, the Board did not re-vote on this decision at its December 2020 board meeting. I wish to clarify this finding.

In October of 2020, our office received a citizen's complaint alleging that the DPMWD Board failed to comply with the Brown Act at its October 20, 2020, Special Meeting. This complaint concerned the decision to award the Master Plan Update contract to HydroScience and the failure to provide the public with copies of the various bids regarding that project. By letter dated November 3, 2020, my office wrote to the Board indicating we had received a complaint regarding the sufficiency under the Brown Act of the notice provided in advance of the October 20, 2020, Special Meeting. We asked for a written response and the District's intended corrective action if warranted.

After initial correspondence with the District's General Manager, we were thereafter contacted in January 2021 by counsel for the District. Counsel represented that the decision to award a contract related to the Master Plan had been "re-agendized" for the December 1, 2020, General

Meeting, and notice, as well as copies of all reports, bids, and the ranking sheet, had been provided to the public prior to that meeting. Counsel noted that the matter had been discussed at that meeting, and public comment was permitted, with at least three members of the public doing so.


The posted agenda packet for the December 1, 2020, General Meeting has bids from three separate firms for updating the Master Plan, including HydroScience's bid in the amount of \$56,830.00, as well as the ranking sheet evaluating the three different bids. The agenda also included an item for discussion and possible action on the "CIP [Capital Improvement Program] Budget." The agenda packet for this item included a proposed budget, which contained the \$56,830.00 for the Master Plan Update (broken into two payments divided between budget categories). A review of the recording from that meeting shows public comment on both the CIP Budget and the Master Plan Update. The CIP Budget, which included the payment to HydroScience, was approved by unanimous vote. There was extensive Board discussion of the Master Plan Update. Following the December 1, 2020, General Meeting, the District Attorney's Office did not receive any additional complaints regarding the District's actions at that meeting.

The District could have spelled out agenda items in more detail for the December 1, 2020, Special Meeting regarding the Master Plan Update. However, as the agenda included the various bids, the ranking sheet, and the proposed budget that included the potential awarded contract, which was voted on after Board discussion and public comment, there was not sufficient evidence to sustain the required burden of proof in an action on the grounds of an alleged Brown Act violation. Thus, pursuing action was not warranted. Having no other complaints regarding the District, that concluded our investigation.

As District Attorney, I am dedicated to protecting the rights of all citizens in our community, including the rights to open and public hearings by the commissions, boards, councils, and other agencies within Sacramento County subject to the Brown Act. My office will continue to be responsive to community complaints regarding local agencies and will provide available resources to investigate and evaluate those matters.

I appreciate the efforts of the Grand Jury to ensure that the Del Paso Manor Water District provides proper notice of its meetings, holds those meetings in an appropriate manner, and provides the public with copies of documents to which they are entitled. We are fortunate to have the resource of a grand jury, which can serve the function of lengthy and detailed investigations and reviews of the performance of governmental entities, and comment on their practices and provide suggestions even when legal action might not otherwise be available.

Sincerely,



Anne Marie Schubert
District Attorney

Cc: Erendira Tapia-Bouthillier, Grand Jury Coordinator
Sacramento County Board of Supervisors

EXHIBIT 2

January 26, 2021

VIA U.S. MAIL & EMAIL (SchieleD@sacda.org)

Investigator Dan Schiele
Sacramento County District Attorney's Office
901 G Street
Sacramento, Ca 95814

Re: Brown Act Complaint – Del Paso Manor Water District

Dear Mr. Schiele:

This firm represents the Del Paso Manor Water District. This letter is in response to your November 3, 2020 notification regarding a possible Brown Act violation by the Del Paso Manor Water District Board of Directors ("Board") during their October 20, 2020 Special Meeting, as well as your December 22, 2020 follow-up email to District General Manager Adam Coyan.

Del Paso Manor Water District is aware of this alleged violation for failing to publicly disclose details related to the bidding process prior to awarding the contract related to its Master Plan. In my review of the matter, it seems that the item was improperly agendized for the District's October 20, 2020 Special Meeting, because the District and the Board failed to make the bid proposals and ranking sheets public prior to the meeting. The Board voted to take action during the October meeting on the District's Master Plan project. The bid was properly awarded to the lowest bidder. Once the oversight was recognized, the matter was re-agendized for the December 1, 2020 General Meeting. The District provided all reports and bids to the public with the appropriate notice prior to the December meeting. The matter was discussed and the public was permitted to comment, which at least three members of the public did. In addition, at the December meeting, the Board members discussed how the error came to occur and spoke of suggestions to prevent such an oversight from happening again.

Should you have any further questions, please do not hesitate to contact me.

Best regards,

Churchwell White LLP

/s/ Erin M. Dervin

Erin M. Dervin
EMD/hb

EXHIBIT 3

**MINUTES OF REGULAR BOARD MEETING
OF THE BOARD OF DIRECTORS OF
DEL PASO MANOR WATER DISTRICT**

February 4, 2019

The Board of Directors of the Del Paso Manor Water District held its regular meeting at the District office located at 1817 Maryal Drive, Suite 300, Sacramento, California on February 4, 2019 at 7:30PM.

President Lenahan called the meeting to order. Vice President Harrington, Director Burt, and Director Matteoli were also present. Director Allen was absent due to a scheduled vacation. Also present were Attorney Adam Brown, Field Manager Rich Bolton, Field Technician Ken Ingle, and Office Administrator Lori Hensley. Manager Debra Sedwick called into the Board meeting as she was attending the National Rural Water Association Rally. There were several residents and members of the public also present.

PLEDGE OF ALLEGIANCE:

Field Manager Bolton led the Pledge of Allegiance.

PUBLIC COMMENT:

Resident Greg Schneider thanked field staff for the well site tour earlier today. Director Burt thanked President Lenahan for increasing public comment time to five minutes.

CONSENT CALENDAR:

Vice President Harrington requested to have both the regular minutes for December and January and invoices for January pulled. She asked what changes were made as she could not remember what she requested. Manager Sedwick stated she requested to include information on the discussion of who would pay for the project on the DPM school discussion. Vice President Harrington made a motion to approve the December 2018 regular meeting minutes as presented. Director Burt seconded the motion. With no other public or Board comment, the motion carried by the following roll call vote:

Ayes: Burt, Harrington, Lenahan, and Matteoli
Noes: None
Absent/Abstain: Allen

Director Burt questioned why the approved travel policy was not included in the December minutes. Manager Sedwick explained the policies are generally only attached to the original minutes once adopted. Director Burt made corrections to the January minutes. She also asked if the District has been reimbursed for the stolen items from the District truck. Manager Sedwick replied yes.

Vice President Harrington requested a letter from Sacramento Metro Fire with the fire flow requirements for the school. Manager Sedwick stated she has requested the letter many times but has

not received it yet. She inquired if C900 pipe was looked into rather than ductile iron pipe for the Burrell Court project. Field Manager Bolton stated pipe costs were comparable for this project but the labor would have been more intensive with C900. Director Harrington requested the date of minutes to be included in the heading. Director Burt made a motion to approve the January 7th Regular Meeting minutes as corrected. Director Matteoli seconded the motion. With no other public or Board comments, the motion carried by the following roll call vote:

Ayes: Burt, Harrington, Lenahan, and Matteoli
 Noes: None
 Abstain/Absent: Allen

Manager Sedwick answered a couple of invoice questions from the Directors. Director Burt would like to return the check she received for payment for December classes taken which were paid at the old rate of \$200 per training day. She only intended to be paid \$100. It was decided to not pay Director Burt for the next two meetings rather than voiding her check.

Director Burt made a motion for the approval for payment of January invoices which was seconded by Director Matteoli. With no other public or Board comments, the motion carried to pay the January invoices by the following roll call vote:

Ayes: Burt, Harrington, Lenahan, and Matteoli
 Noes: None
 Absent/Abstain: Allen

<u>CHECKS DRAWN</u>	<u>CHECK NO.</u>	<u>AMOUNT</u>
AT&T 1/2	8985	65.75
Primetax Service Charge 1/5	EFT	263.93
ACWA/JPIA Workers' Comp. 1/7	8986	1740.74
One Print Source & Graphics 1/7	8987	7.63
AT&T 1/7	8988	177.16
Primetax - Payroll 1/15	EFT	8970.05
Primetax - Payroll Taxes 1/15	EFT	4921.79
State Water Resources Control Board (Certification) 1/22	8989	90.00
AT&T 1/22	8990	55.00
Primetax - Payroll 1/31	EFT	10703.39
Primetax - Payroll taxes 1/31	EFT	5353.39
PERS/Health 1/31	EFT	6966.83
PERS/Retirement 1/31	EFT	4788.78
ACWA/JPIA 1/31	8991	620.60
Voya Financial	8992	1800.00
One Print Source & Graphics	8993	449.75
AT&T	8994	68.24
Hill Rivkins Brown & Associates	8995	2850.00
BSK Associates	8996	96.00
Chevron	8997	349.75
AT&T Mobility	8998	278.97
Void	8999	0.00
Emigh Hardware	9000	93.84
GM Construction & Developers, Inc.	9001	8000.00
Inland Business Systems	9002	249.25
Void	9003	0.00
P.G. & E.	9004	8.60
Petty Cash	9005	103.50
U.S. Postal Service	9006	772.50
Sacramento County Utilities	9007	175.22
SMUD	9008	5744.22
Sacramento Area Water Works Association (Dues)	9009	900.00
Sam's Club	9010	412.55
Sierra Chemical Company	9011	313.20

Streamline	9012	200.00
USA BlueBook	9013	490.34
Uinta Holdings, LLC	9014	1985.00
Stericycle Communication Solutions	9015	195.93
YP	9016	15.50
		<u>70277.40</u>

Vice President Harrington made a motion to approve the January 7th Special Board meeting minutes which was seconded by Director Burt. With no public or Board comments, the motion carried to approve the January 7th Special Board meeting minutes as presented.

Ayes: Burt, Harrington, Lenahan, and Matteoli
 Noes: None
 Absent/Abstain: Allen

REPORT FROM FIELD MANAGER CONCERNING:

January field matters:

1. The District field staff responded to two leak service calls during the month. One leak call was the responsibility of the homeowner and the other was on Burrell Court.
2. Field staff performed 21 Underground Service Alerts and two customer service line location requests in the month of January.
3. The District experienced several power outages on January 6th; however, Well #6 was not affected. No damages were incurred at the District facilities.
4. All of the equipment has been replaced in the District truck from the theft. All big equipment is secured by cables and pad locks and labeled as "Property of Del Paso Manor Water District."
5. The upgrade and replacement of the water main on Burrell Way is proceeding. The project is expected to be completed this week.
6. Well #8 was planned and budgeted to have maintenance and pump work performed this year. Field Manager discussed the status of Well #8 and the pump issues. Due to the Well #8 lack of efficiency and loss of production, the maintenance has been scheduled and will begin soon.
7. Field Manager Bolton stressed the importance of wearing proper safety equipment when visiting construction and job sites and requested all Board members to connect with District staff first.

REPORT FROM MANAGER CONCERNING:

January operational matters:

1. Manager Sedwick stated she provided in the Board packet the six month budget (to December 31, 2018) outlook along with the actual amount charged for both the Operations & Maintenance and Planned System Maintenance.
2. Also implemented this month at the request of Director Burt was an accounting of compensation that each Board member received. This will be done monthly.

3. Manager Sedwick attended the Sacramento Suburban Water District/San Juan Water District Water Management/Re-Organization meeting, now being referred to as the Collaboration-Integration Meetings. One project that is already being collaborated on is meter purchases. The Board members of SSWD/SJWD requested a report from their managers. They also would like to see inter agency agreements soon if there is an interest to collaborate. The managers are still meeting to determine if there are areas for collaboration.

4. The Water Reliability plan is moving into Phase 2 which is the beginning of the development of a regional groundwater bank. The biggest cost will be the modeling. The next step will be participation agreements along with the fees associated with participating.

5. The Regional Water Authority Advocacy Program monthly meeting was very active. The major issues will be the water tax and the low income assistance program. ACWA will be introducing a bill which would require a longer compliance period for newly adopted MCL standards for water quality. We expect to see a few more conservation and water use efficiency bills this year too.

6. At the RWA Executive Committee meeting, the development of the budget and the water reliability plan was discussed. John Woodling, the Executive Director, announced his retirement stating March 1st would be his last day. Robert's Consulting was approved for the recruitment of a new Executive Director.

7. The Water Forum Successor Effort held a Coordinating Committee meeting. The big discussion was the voluntary settlement agreements for the American River. Tom Gohring reported that the Caucus's will need to vote on this issue per the Water Forum Agreement. There was also an update on the Habitat Management program.

8. The District decreased our water production for January by 6.5% compared to 2018. Compared to 2013, January water production decreased by 16.2%.

9. All bacteriological quality samples tested absent for January.

10. There were no water quality complaints for the month of January.

REPORT FROM ATTORNEY CONCERNING:

Attorney Brown commented on the Reimbursement Agreement with Del Paso Manor School which was prepared shortly after last month's Board meeting.

REPORTS ON VARIOUS MEETINGS:

Manager Sedwick attended the Regional Water Authority meeting. The Board approved several personnel policies and an employee compensation policy. The 2017/2018 audit was also accepted. The Board authorized the Executive Director to sign a Memorandum of Agreement with Non-Federal

partners to develop a Water Marketing Strategy plan. The RWA Board elected the Executive Committee and then elected Paul Schubert as Chair and Kerry Schmitz as Vice Chair.

President Lenahan and Director Burt met once together and then once again with Manager Sedwick for the Finance Ad-Hoc Committee meeting. They reported they are making progress.

President Lenahan and Vice President Harrington met for the Succession Planning Ad-Hoc Committee meeting. They will meet with Manager Sedwick upon her return.

OLD BUSINESS:

1. Reviewed and discussed the status of the Del Paso Manor Elementary School Project. Manager Sedwick reported the signed Reimbursement Agreement was received late Friday, January 25th and on Monday, January 28th, an amended task order with Forsgren Associates was signed. Field staff is working with Forsgren to determine testing points for the field verifications. Director Burt wanted assurances that the Board will review everything before a decision is made as to the best option. President Lenahan stated they want to be involved in the process. Director Matteoli reminded the Board that the last State Water Resource Control Board, Division of Drinking Water inspection report encouraged the District to move forward with the Master Plan replacing aging pipes. Vice President Harrington would still like to see a letter from Sacramento Metro Fire stating the fire flow requirements for the school project. She also requested a copy of the State Board inspection report.

2. Field Manager Bolton updated the Board on the Burrell Court line replacement project. The third estimate was received and was slightly higher than GM Construction. Due to the extensive rain, the project has been slightly delayed. The Board and public made a few general comments.

Field Manager Bolton gave a presentation about the main replacement project on Burrell Ct. Director Burt had copies of two invoices relating to prior projects done at the site; one in May 2017 for \$13,440 and one from November 2018 for \$8,000. At the Jan 7th Board Meeting a discussion about whether to approve additional work on Burrell Ct. Manager Bolton stated the two repairs were \$18,000 each. He also discussed new quotes, but the Director's were not given any for review. Although the new project for \$9,917 was approved, Director Burt stated she would no longer approve spending requests without seeing all the back-up documentation ahead of time. 2/21/19

NEW BUSINESS:

1. Upcoming Meeting(s):

a. California Special Districts Association's "Governance Foundations" – March 26, 2019

in Sacramento, California.

2. President Lenahan appointed Director Burt and himself to the Auditor Selection Ad-Hoc Committee.

3. President Lenahan appointed Vice President Harrington and Director Burt to the Policy Manual Review Ad-hoc Committee.

4. The Board reviewed and discussed the process to amend Ordinance No. 2, An Ordinance Establishing Rules and Regulations for the Business and Proceedings of the Board of Directors of the Del Paso Manor Water District and changing the time and place for the regular meetings. They discussed changing the time to 6:30pm. Director Matteoli stated he has obligations on Monday at that

time and suggested changing the meeting day to the first Tuesday of the month. The Board agreed that Tuesday would be good. Resident Carol Rose inquired as to the costs involved with the change. Attorney Brown responded to the question. Resident Carl Dolk was in favor of the change. Vice President Harrington made a motion to direct Manager Sedwick to begin the process to amend Ordinance No. 2 for the regular Board meetings to be held on the first Tuesday of the month at 6:30PM. Director Matteoli seconded the motion. There being no other comments, the motion carried by the following roll call vote:

Ayes: Burt, Harrington, Lenahan, and Matteoli
Noes: None
Absent/Abstain: Allen

5. The Board reviewed and discussed options for the Directors to preview invoices in order to authorize payment. Invoices will be scanned and emailed to the Board members.

6. The Board reviewed and discussed contracting with a company to host District emails using the delpasomanorwd.org extension. Manager Sedwick reported the costs for AT&T and Go-Daddy to host. The AT&T was \$420 per year vs. \$1,100 for Go-Daddy but Go-Daddy provided a discount if you signed up for two years and provided more email storage and backups. Vice President Harrington inquired about Streamline. Manager Sedwick stated she did not think they provided email hosting but will confirm and report back next month.

7. Terminating the contract with Lucy & Company was discussed. Manager Sedwick reported the current contract ends with the March/April newsletter which work has begun. The contract also provides pricing to assist with the Consumer Confidence Report which is required to be out by July 1, 2019. It is normally inserted in the May/June billing. Manager Sedwick stated the District does not have the software that the CCR has been developed on and changes to the CCR will be required. Manager Sedwick recommended finishing out this fiscal year with Lucy & Co., and then determining what to do for next fiscal year. Director Matteoli commented that he was concerned with tying up the staff with more work. President Lenahan feels that any software should take care of these issues and should not cost more than \$1,800. Director Matteoli again stated not to nickel and dime staff and reminded the Board that start up time to get things up and running is needed too. Director Burt stated the District can call Sacramento Suburban Water District for assistance on the CCR or another water district may be willing to help. Director Burt made a motion to terminate the Lucy & Company contract and Vice President Harrington seconded the motion. Resident Diane Graves commented that the Board should let the contract end with the fiscal year and questioned why cancel Lucy & Company now. Resident Greg Schneider agrees with the motion. Resident Roy Wilson commented that it is good that the new Board questions where the money is being spent. Resident Carl Dolk would like to see two newsletters a year

with just information. Attorney Brown stated he should review the contract to assure there are no cancellation fees or notice provisions. Director Burt revised her motion to terminate the Lucy & Company contract once it has been reviewed by the Attorney and there are no termination provisions. Vice President Harrington accepted the amended motion. With no further comments, the motion carried by the following roll call vote:

Ayes: Burt, Harrington, and Lenahan
Noes: Matteoli
Absent/Abstain: Allen


8. President Lenahan requested the Vehicle Use Policy for on-call personnel be reviewed by the Policy Review Ad-hoc committee. No discussion took place.

9. The Board reviewed and discussed changing to an "Action Only" format for meeting minutes. After discussion, no action was taken.

BOARD GENERAL DISCUSSION:


Director Burt requested to have a Privacy Policy discussion next month due to a post of Next Door. Manager Sedwick briefly explained the situation. Director Burt would also like to have more comfortable chairs for the residences and guests that attend the Board meetings and requested Manager Sedwick to bring back prices next month. Vice President Harrington suggested looking at State surplus. She also requested that the Investment Policy be reviewed and possibly amended. She also likes Carl's idea, in order to save time, that the General Manager and Field Manager Reports be written. Director Burt would also like the web site updated to reference the President is now John Lenahan and add pictures. Director Burt inquired about quotes verses estimates on jobs and would like to discuss signing limits for the Manager. She would also like to see the "Draft" kept on the minutes until they are approved. Director Matteoli commented you are making whole lot demands of the staff on top of their normal very busy schedules. Director Burt and Vice President Harrington would like to review health insurance and retirement contributions. Vice President Harrington inquired about a policy on Director's attendance. Manager Sedwick stated the District does not have one; Director Allen was sick in January and was on a scheduled vacation in February. Attorney Brown will look into rules of excused verses unexcused and policy on absent Director.

There being no further business to come before the Board, President Lenahan adjourned the meeting at 10:27PM.



John Lenahan, President

ATTEST:



Debra Sedwick, Secretary

EXHIBIT 4

**MINUTES OF REGULAR BOARD MEETING
OF THE BOARD OF DIRECTORS OF
DEL PASO MANOR WATER DISTRICT**

April 2, 2019

The Board of Directors of the Del Paso Manor Water District held its regular meeting at the District office located at 1817 Maryal Drive, Suite 300, Sacramento, California on April 2, 2019 at 6:30PM.

President Lenahan called the meeting to order. Director Burt and Director Matteoli were also present. Vice President Harrington was absent due to a prior commitment. There is one vacant seat on the Board. Also present were Attorney Adam Brown, Manager Debra Sedwick, Field Manager Rich Bolton, and Office Administrator Lori Hensley. Richard Noll and Alan Driscoll with Forsgren Associates were present. There were several residents and members of the public also present.

PLEDGE OF ALLEGIANCE:

President Lenahan led the Pledge of Allegiance.

PUBLIC COMMENT:

Resident Gwynne Pratt commented on the need for water knowledge on the Board and water articles should be included in newsletters as she feels residents are interested.

OLD BUSINESS:

1. Forsgren Associates gave a presentation on the modeling efforts for the school project. Their final recommendation included the approval of the project as the school district requested and for the Board to discuss and establish a policy as to the District's desired and acceptable pressure for daily operations and during a fire flow event. They also recommended the Board consider adding Variable Frequency Drives to the well motors, if financially feasible and to replace the main lines in the Northeast section of the District. The Board asked many questions. After discussion, Director Matteoli made a motion to approve the school district's request for two 8" connections and one 4" connection as they submitted. Director Burt seconded the motion. Three residents made comments. With no further comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

2. Manager Sedwick presented to the Board her findings on the cost to have Gmail host the District email service with the delpasomanorwd.org extension. The cost would be \$10 per month per email address. After discussion, the Board decided to wait until a later date to implement.

3. The Board reviewed and discussed the Actuarial Study for GASB 74/75 as well as the funding strategies and funding & contribution method recommended by the Manager. Director Burt asked if the District could have the actuary give a presentation. Manager Sedwick explained that the cost would be approximately \$1600. She suggested that the District will need to contract for the next full valuation for a measurement date of June 30, 2019 and suggested that she ask for a presentation for that report in the next fiscal year since payment has already been sent for the current fiscal year. She also suggested that we request that contribution amounts be calculated based on different amortization schedules since the new reporting does not give the Annual Required Contribution amount like the old valuations. The Board directed the Manager to budget a presentation and calculations in the next fiscal year budget. After discussion, Director Matteoli made a motion to approve the study, funding Strategy 1 and funding & contribution methods as recommended by the Manager. Director Burt seconded the motion. With no further Board or public comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

4. The amended Investment Policy as discussed last month was presented to the Board for adoption. Director Burt requested the item be tabled as she would like the Policy Review Ad-Hoc Committee to review and make additional changes.

5. President Lenahan stated that the Succession Planning Ad-Hoc Committee has not completed the package for review and tabled the succession planning item to next month.

6. Manager Sedwick presented to the Board her findings as to adding PayPal payment option to the website. When she spoke with PayPal, they informed her that their fee of 2.9% + the flat rate currency fee is taken off the top of every payment and there is no way for it to be set up by them for the fee to be paid by the customer. Manager Sedwick also reported she spoke with Sloane at Streamline and she also understood that was how PayPal worked. Sloane provided 3rd party vendors as an alternative. Resident Carol Rose questioned is there a demand for PayPal in the District with the older population of residents. After discussion, the Board decided this item would go back to the Finance Ad-Hoc Committee for further investigation.

NEW BUSINESS:

1. Upcoming Meeting(s):
 - a. California Special Districts Association's "Financial Management", April 25, 2019 in Simi Valley, CA or August 8, 2019 in Sacramento, CA.
 - b. California Special Districts Association's "Legislative Days", May 21-22, 2019 in Sacramento, CA.

c. California Special Districts Association's "Governance Leadership Academy", July 7-10, 2019 in Napa, CA.

2. President Lenahan appointed Director Matteoli as the additional signer for the Voya Deferred Compensation Plan since Richard Allen is no longer a Director

3. The Auditor Selection Ad-hoc Committee stated they interviewed two firms of the four firms that presented proposals and were recommending Richardson & Company to perform the 2018/19 fiscal year audit as they felt they were the most qualified. Director Burt disclosed that she had contacted Richardson & Company last year to ask questions about the prior year's audit. Although Richardson & Company did not accept payment for their time with her, she sent them a \$25 gift card. Resident Carl Dolk suggested that for appearance, Director Burt should exclude herself from the vote. Attorney Brown stated there was no financial conflict and Director Burt did not legally need to. Director Matteoli made a motion to approve the committee's recommendation of Richardson & Company to perform the 2018/19 audit. The motion was seconded by Director Burt. Resident Greg Schneider inquired about the amount of the contract. With no further comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

4. The Board reviewed and discussed the request to execute a letter of support for Paradise Irrigations District's request for a one-time funding from the State's General Fund to provide assistance from the Camp Fire disaster. Director Burt made a motion to approve the request and Director Matteoli seconded the motion. With no further comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

5. The Board reviewed the District's Drought Preparedness and Water Shortage Plan. They also discussed the current laws in place on making conservation "A Way of Life". Manager Sedwick recommended that the District be in Phase 1 of the plan for the 2019 season which asks for voluntary reductions and for the District not to hire a conservation patrol this year due to the amount of rain the region has received. Director Burt discussed comments made by a resident last month and suggested ways for the District staff to respond to complaints. She requested that the Drought Preparedness and Water Shortage Plan be revised to indicate that it has been reviewed April 2, 2019 and put onto the District's website. Manger Sedwick stated upon approval, a notice will be put on the website with the adopted rules for the season with a link to the Plan. Director Burt made a motion to approve the District be in Phase 1 (voluntary reductions) and not to hire a patrol for this season. Director Matteoli seconded the motion. With no further comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

6. Manager Sedwick reported that she contact both Sacramento Suburban Water District and Carmichael Water District, per the Board's request, for assistance with the Consumer Confidence Report. Both agencies replied that they could not assist due to not having the additional staffing and also with the liability since it is a compliance report. Manager Sedwick further reported that she contacted Gemini Group who could assist at a cost of approximately \$2600. This company guarantees compliance with the State's requirements. Director Burt stated she also investigated and found compliance was important and she liked that this company offered a guarantee. After discussion, Director Burt made a motion to authorize the Manager to contract with Gemini Group to assist with the development of the District's Consumer Confidence Report this year. Director Matteoli seconded the motion. With no further comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

7. The Board reviewed and discussed Phase 1 of the Sacramento Regional Water Bank Project. Director Matteoli expressed his support for the participation as he sees this as beneficial to the region and also a potential revenue source to the District. Director Burt stated that although she has concerns, all the other agencies in the region are participating and Del Paso Manor Water District should to. President Lenahan stated that the District's cost is relatively small and it is not committing the District to Phase 2. After further discussion, Director Matteoli made a motion to authorize the Manage to sign the participation agreement. Director Burt seconded the motion. Resident Greg Schneider asked for clarification on the minor changes to the agreement that Manager Sedwick described. With no further comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

8. President Lenahan requested the Board consider changing the regular meeting date for the May meeting due to the possibility of a lack of quorum since he and Director Matteoli will be at the Association of California Water Agencies conference. After looking at schedules, Director Burt made a motion to change the date to May 2, 2019. Director Matteoli seconded the motion. With no further comments, the motion carried by the following vote:

Ayes: Burt, Lenahan, Matteoli
Noes: None
Abstain/Absent: Harrington

9. The Board discussed the possibility of having a Board newsletter instead of a District newsletter per the request of President Lenahan. Director Burt spoke on behalf of the Communication Ad-Hoc Committee that she felt it should be a District Newsletter but developed with both staff and Board members input. They also briefly discussed if it should be bi-monthly, quarterly or semi-annual. Two residents commented on the newsletter timing and content.

10. The District discussed the possibility of outsourcing the District's accounting functions. After discussion, no action was taken. It was referred to the Finance Ad-Hoc Committee to look into and bring back a recommendation.

CONSENT CALENDAR:

President Lenahan requested the Regular Board Meeting minutes of March 4, 2019 be pulled. The items left on the consent calendar were the minutes of the Special Meeting on March 4, 2019 and the approval of March invoices. Director Matteoli made a motion to approve the remaining consent calendar. Director Burt seconded the motion. With no Board or public comments, the motion was carried by the following roll call vote:

Ayes: Burt, Lenahan, and Matteoli
 Noes: None
 Absent/Abstain: Harrington

<u>CHECKS DRAWN</u>	<u>CHECK NO.</u>	<u>AMOUNT</u>
AT & T Mobility 3/4	9043	249.01
Primetax Service Charge 3/5	EFT	274.03
One Print Source & Graphics (Replace Cks.#8960 & #8987) 3/7	9044	300.56
AT&T 3/7	9045	177.70
CSDA (Sample Policy Handbook) 3/12	9046	225.00
Primetax - Payroll 3/15	EFT	8999.62
Primetax - Payroll Taxes 3/15	EFT	4949.23
AT&T 3/19	9047	55.00
Schiff Hardin, LLP(Public Records Req-Refund Est. chgs.) 3/26	9048	25.55
Debra Sedwick (Reim.Copy Charges PRR-Schiff Hardin) 3/26	9049	169.20
Primetax - Payroll 3/29	EFT	9330.40
Primetax - Payroll taxes 3/29	EFT	4982.59
PERS/Health 3/29	EFT	6966.83
PERS/Retirement 3/29	EFT	4652.11
GM Construction & Developers Inc. (Burrell Ct.) 3/29	9050	70650.00
ACWA/JPIA 3/29	9051	620.60
Voya Financial	9052	1800.00
One Print Source & Graphics	9053	370.67
Aqua Sierra Controls, Inc. (Scada reports DPM Elem.Project)	9054	520.00
Hill Rivkins Brown & Associates	9055	2850.00
BSK Associates	9056	2562.50
California Rural Water Association (Dues)	9057	777.00
Chevron	9058	382.82
AT&T Mobility	9059	249.01
Emigh Hardware	9060	252.04
Forsgren Associates Inc. (DPM Elem. School Project)	9061	12175.00
GM Construction & Developers Inc. (Butano)	9062	398.00
Ken Ingle (Reimbursement)	9063	195.00
Inland Business Systems	9064	177.12
P.G. & E.	9065	8.88
Petty Cash	9066	45.42
U.S. Postal Service	9067	770.00
The Sacramento Bee (Director Vacancy)	9068	277.24
Sacramento County Utilities	9069	175.22
Sac. Metropolitan Air Quality Management District	9070	2134.00

SMUD	9071	5606.14
Sam's Club	9072	303.33
Sierra Chemical Company	9073	417.60
Streamline	9074	200.00
Amber Beasley (Customer Refund)	9075	218.25
Uinta Holdings, LLC	9076	2045.00
Stericycle Communication Solutions	9077	219.53
YP	9078	15.50
		<u>147772.70</u>

President Lenahan stated he received a few requested changes from Vice President Harrington and had a few as well. He gave his corrections. Director Matteoli made a motion to approve the March 4, 2019 minutes as amended. Director Burt seconded the motion. With no further public or Board comments, the motion carried by the following roll call vote:

Ayes: Burt, Lenahan, and Matteoli
 Noes: None
 Abstain/Absent: Harrington

REPORT ON MEETINGS:

Director Burt reported that the Communication Committee developed the March-April Newsletter. They are pleased with the report and look forward to developing the next one.

President Lenahan reported that he met with Manager Sedwick for the Finance Ad-Hoc Committee and open items were discussed. Additional work is being done but progress is being made.

President Lenahan reported that the Human Resource Ad-Hoc Committee has received materials from Manager Sedwick and will begin working on reviewing the current job descriptions and the current personnel manual.

Director Burt reported that the Policy Manual Review Ad-Hoc Committee has purchased the California Special Districts Associations Sample Policy Handbook and will begin work on developing a new policy manual.

Manager Sedwick gave a report of the Regional Water Authority Meeting.

REPORT FROM ATTORNEY CONCERNING:

No report.

REPORT FROM MANAGER CONCERNING:

March operational matters:

A written report was provided. There were no questions or comments.

REPORT FROM FIELD MANAGER CONCERNING:

March field matters:


A written report was provided. There were no questions or comments.

BOARD GENERAL DISCUSSION:

Director Burt requested that next month there be a report and discussion on associations the District belongs to and the dues associated with each. She also request that the consent calendar be removed from future agendas.


Director Matteoli commented that it appears items are starting to be implemented that were on a letter of recommendations to the Board provided by Marissa Burt and Greg Schneider in March 2018. In that recommendation letter, there were statements that consultants were used. He asked Director Burt to provide names of those consultants. Director Burt responded that that was given by a private citizen and herself as a private citizen and felt it was not appropriate to disclose.

There being no further business to come before the Board, President Lenahan adjourned the meeting at 10:31PM.



John Lenahan, President

ATTEST:



Debra Sedwick, Secretary



Regional Locations

Northeast
209 W Central Street
Suite 102
Natick, MA 01760

Southeast
2423 SW 147th Avenue
Miami, FL 33185

Central
6539 Harrison Avenue
Cincinnati, OH 45247

Southwest
12680 W Lake Houston Pkwy
Suite 510
Houston, TX 77044

West
3705 W. Pico Blvd
Los Angeles, CA 90019

Debra Sedwick
Del Paso Manor County WD
1817 Maryal Drive
Suite 300
Sacramento, CA 95864

Dear Debra,

Thank you for requesting information about our Consumer Confidence Report Management Services. As promised, please find attached a proposal detailing your cost for complete CCR management services. I have also included a brochure and samples of our work for your review.


Since 1998, we've delivered more than 80 million compliant consumer confidence reports to communities across the country. Year after year, our clients have trusted us to produce the highest quality reports that meet all their state's unique requirements. Whether you need to print and mail hardcopies or just need an electronic version to put on your web page, we have the perfect solution for you.

Our process is fast and easy – just answer some questions and you're done! We manage everything else and with our 100% No-Worries Compliance Guarantee you can be confident that your CCR will be perfectly compliant every time. Let Gemini Group provide you with what we've been providing to our clients for over 20 years:


- We help you write a compliant CCR
- We know all of your state's additional reporting requirements
- 100% No-Worries Guarantee – your CCRs will always be compliant
- Knowledgeable and friendly staff always here when you need us
- Compliance consultants to answer all your questions
- Printing, mailing and much, much more

I hope you find this information helpful and to your satisfaction. To obtain a more detailed cost quote, please visit us at www.GemGrp.com and click 'My Project Center'. If you have any questions, please call me at (800) 254-9761 ext. 213. Again, thank you for your interest in Gemini Group, and we look forward to the opportunity to serve you.

Sincerely,

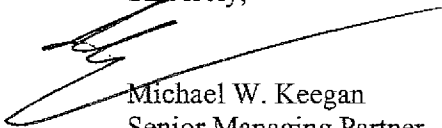

Michael W. Keegan
Senior Managing Partner

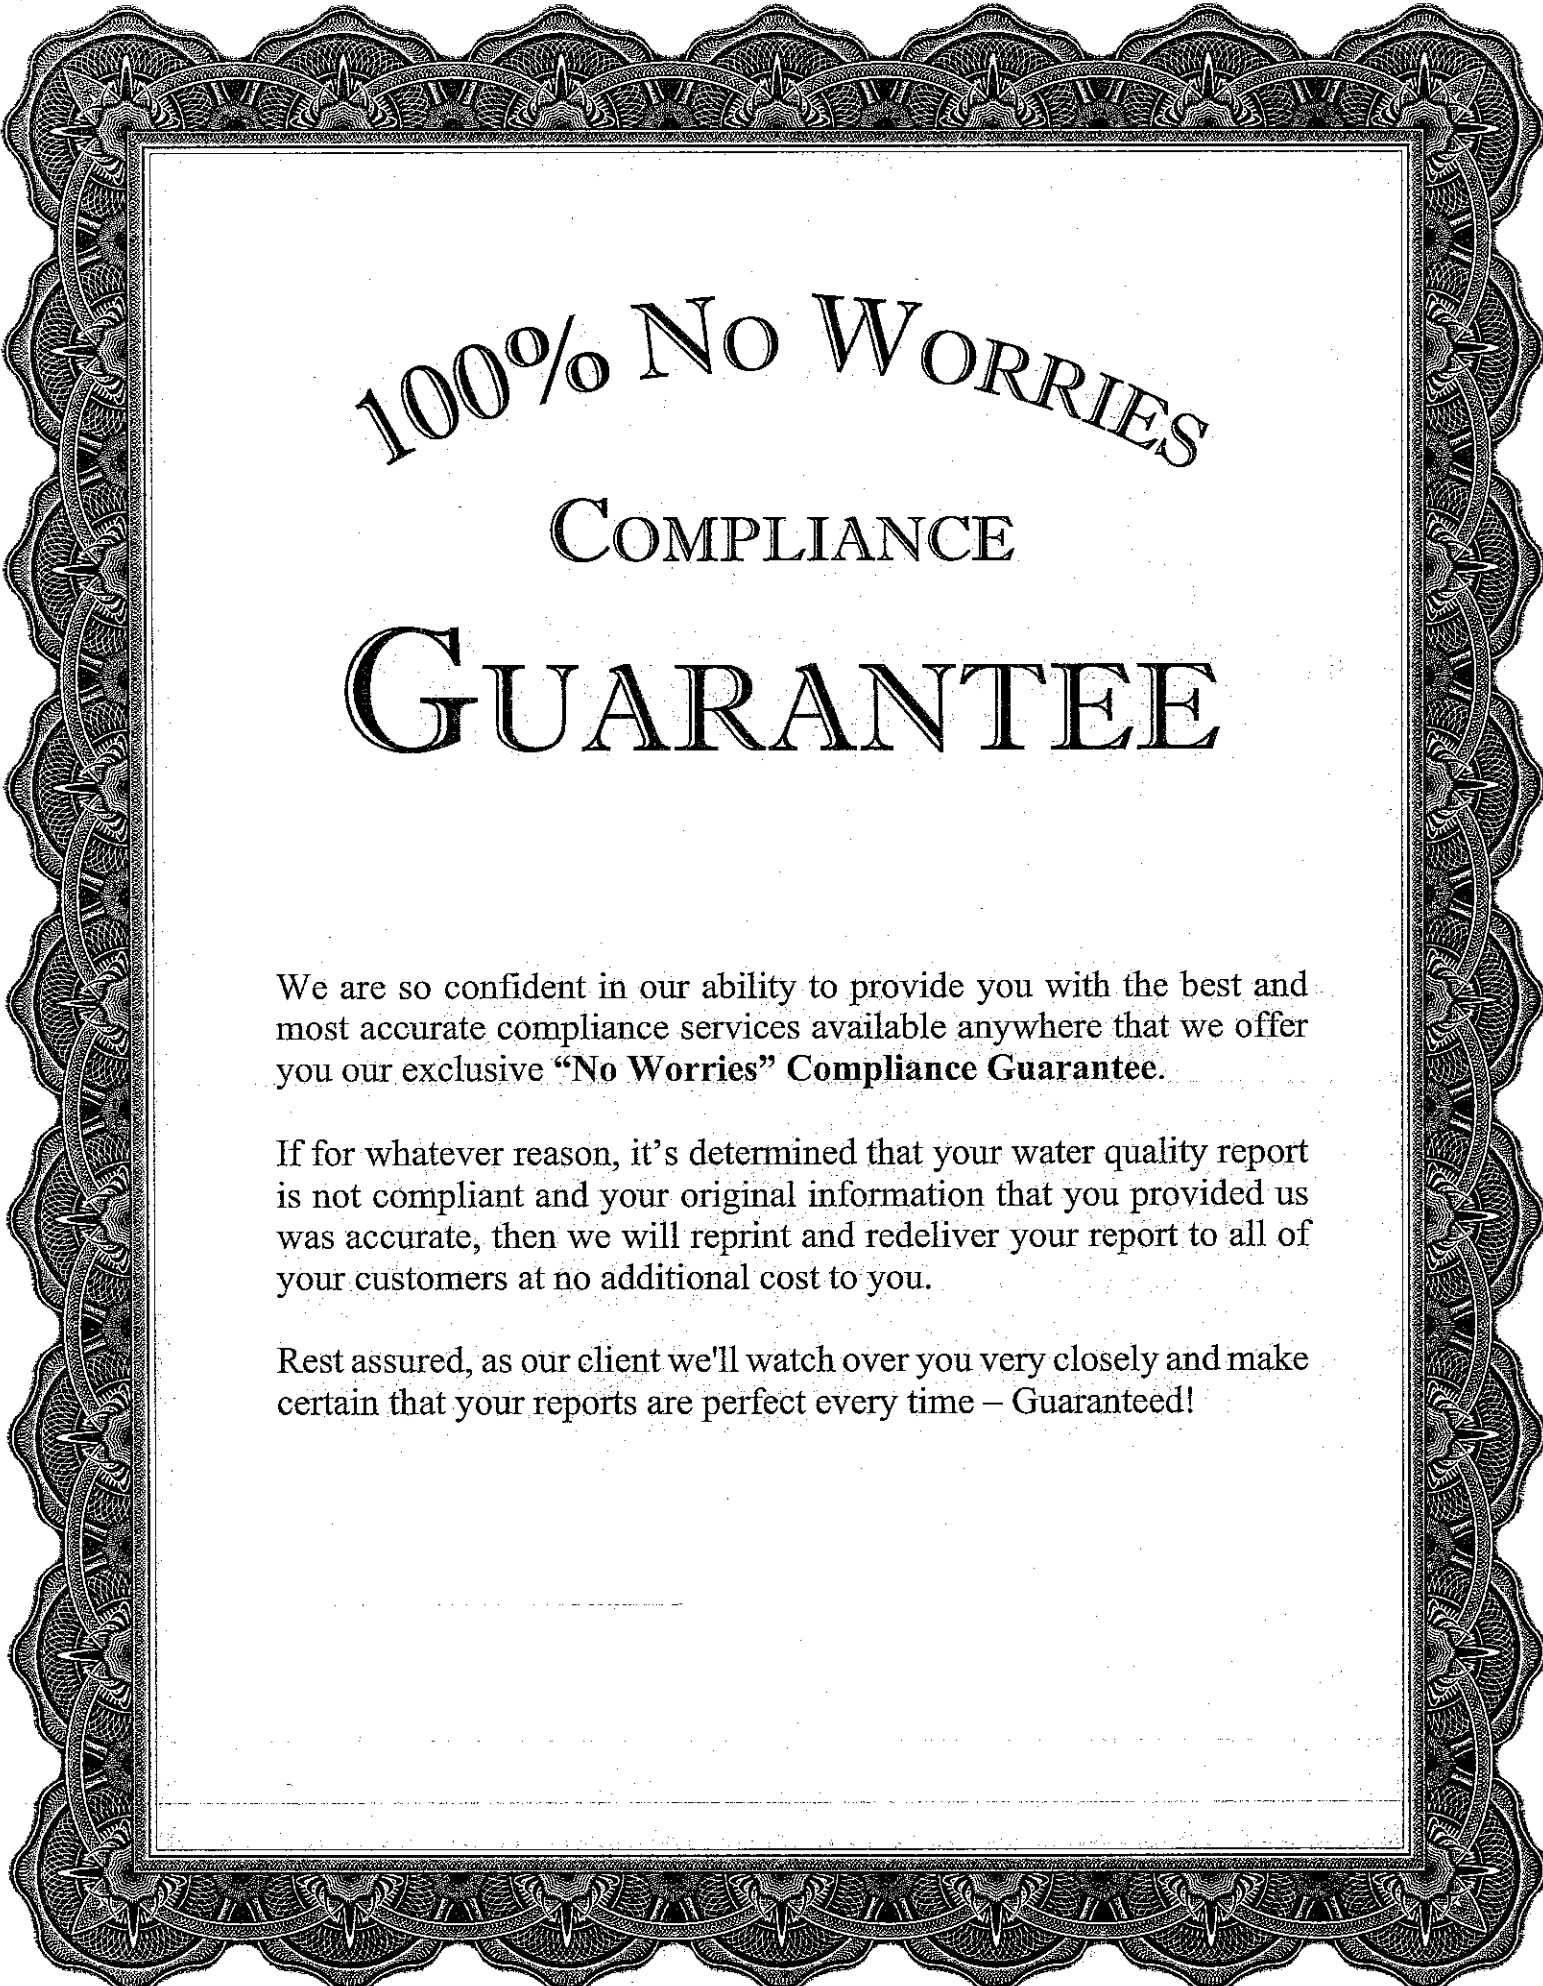

100% NO WORRIES
COMPLIANCE
GUARANTEE

We are so confident in our ability to provide you with the best and most accurate compliance services available anywhere that we offer you our exclusive **“No Worries” Compliance Guarantee**.

If for whatever reason, it's determined that your water quality report is not compliant and your original information that you provided us was accurate, then we will reprint and redeliver your report to all of your customers at no additional cost to you.

Rest assured, as our client we'll watch over you very closely and make certain that your reports are perfect every time – Guaranteed!

**CCR Management Service
Program Options For
Del Paso Manor County WD**

Please visit us on the Web at www.GemGrp.com to learn more about the options listed below.

Our process is quick, simple, and guaranteed to be perfectly compliant. We handle everything from start to finish. Once you complete the short interview using our online report generator, our compliance team reviews your report to make certain that all of your state's requirements are included. Your report then goes to an editor where it will be checked for correct spelling and grammar. We then design your report using your chosen brochure style and include colorful photos and illustrations (yours or ours), logos, maps, and so on. Finally, we send you a proof for your approval, and you're done!

- We'll help you write your report
- 100% No-Worries Guarantee - your CCRs will always be compliant
- Get a digital copy of your CCR for posting on your web page
- Printing, mailing, hosting, translations and much, much more
- Knowledgeable and friendly staff always here when you need us
- Unlimited access to compliance consultants to answer all your questions
- Educate your customers with engaging, prewritten and editable articles from our library

Traditional Delivery Option - including 2,000 report copies:

Most Popular	
C Style	A&B Styles
18% Discount	53% Discount
\$3,849	\$2,566

Electronic Delivery Option – with unlimited printing-on-demand: \$2,486

(For a more detailed quote, login to www.gemgrp.com, click 'My Project Center', then click 'Step 1')

Mailing Service

Our optional mailing service is based on an all-inclusive rate which includes postage, CASS Certification, setup, sorting, labeling, tabbing and delivery to the Post Office. If you provide us an electronic file of your mailing list your cost is \$0.33/mailer. If you mail to everyone in your code(s) your cost is \$0.31/mailer.

Please call us with any questions you may have (800) 254-9761

Visit us at www.GemGrp.com

Response to Recommendations

**DEL PASO MANOR WATER DISTRICT'S
RESPONSE TO GRAND JURY RECOMMENDATIONS**

- R1. The DPMWD should publish and distribute a district-wide report, to meet its public transparency obligations, disclosing the extent of the District's immediate and longer-term water quality, delivery, and fire flow infrastructure improvement needs, and the resulting cost impact to water district ratepayers. This report should be the subject of a Special Board Meeting as well. The Grand Jury recommends that this work should begin immediately and be completed within six months.**

Response to R 1.

This recommendation will be implemented, as proposed.

Del Paso Manor Water District's ("DPMWD" or "the District") new Board of Directors and General Manager have been working on this Recommendation and will fully comply with it.

For example, by the end of November 2021, DPMWD repaired or resolved almost all of the items on the list of maintenance and safety concerns prepared by Sacramento Suburban Water District ("SSWD") in summer 2020. DPMWD also made an agreement with SSWD on December 10, 2021 to automate all three tie-ins to their water system. This means water can flow either direction automatically, based on the system's pressures or needs, and increase fire flow on the west, north, and east sides of the District. It is expected that the automation of the interties will be completed by SSWD sometime in spring 2022. Additionally, DPMWD is refurbishing Well Nos. 2 and 4, and intends to update Well No. 7 so it can be used fulltime instead of for just fire flow or excess demand.

The District is further investigating options to remove Well No. 3 from standby. Standby means it will only be used for emergencies like fire. District staff has determined that this well could be used with full safety if two activated carbon filters are used, because activated carbon removes the contaminants. The activated carbon in the filters will need to be renewed approximately every five years. DPMWD is seeking a grant or other financing (Prop. 218 rate increase) because the steel-encased filters are expensive, and DPMWD does not presently have the funds to restore the well to full use.

The work identified in the 2009 Master Plan and later addressed in the Draft HydroScience Strategic Water Solutions ("HydroScience") Technical Memorandum, dated May 26, 2021 ("Technical Memorandum" or "Memorandum") will also need to be prioritized by the Board of Directors and implemented, based on acute needs. To fund these improvements, the District will need to conduct a Proposition 218 rate hearing and raise rates. The District further anticipates that a completed report disclosing the extent of the District's immediate and longer-term water quality, delivery, and fire flow infrastructure improvement needs will be available to the public no later than May 2022. Following that, the District will retain a professional consultant to assist with the Proposition 218 process.

- R2. The DPMWD should address the findings and recommendations of the May 2021 HydroScience Strategic Water Solutions Technical Memorandum, originally authorized by the DPMWD as a Proposed Update to its 2009 Water District Master Plan; formal public involvement should be documented to meet the requirements of the Brown Act. This process should begin immediately and be completed within 60 days.**

Response to R 2.

This recommendation has been implemented.

On December 10, 2021, DPMWD held a special meeting and open to the public (see **Exhibit 5**) to discuss the conclusions and recommendations of the Draft Technical Memorandum, attached hereto as **Exhibit 6**. HydroScience staff was in attendance to respond to questions and provide explanations for the information in the Draft Technical Memorandum.

The following conclusions and direction were made at that meeting:

1. HydroScience staff underscored that the Draft Technical Memorandum is intended to supplement, not supplant or override, any conclusions or recommendations included in the 2009 Master Plan. The information in the Memorandum merely updates certain information in the 2009 Master Plan using the limited data that was provided to HydroScience at the time it was awarded the contract for its services. HydroScience was never provided surface water surveys or condition assessments of any of the District's wells, and the firm was given incomplete flow data. The limited data restricted the level of detail and analysis HydroScience could offer in the Memorandum.
2. HydroScience staff suggested that preparing a conditions assessment of the District's wells would be especially beneficial. The General Manager confirmed that video surveys are scheduled for certain wells and additional evaluations are being scheduled for other wells.
3. In response to questions from the Board regarding Table 1-1 of the Draft Memorandum, HydroScience staff explained a.) Project Priority No. 1 "Pipe Replacement Projects 2-10" is recommended in order to achieve the required flow for the District's existing fire hydrants; and b.) Project Priority No. 5 "Install 15 Additional Fire Hydrants" is recommended to reduce the distance between the District's fire hydrants. Standards typically set by the Fire Marshal dictate that fire hydrants should be no more than 500 feet apart. The installation of an additional 15 fire hydrants would ensure compliance with that standard.
4. The Board of Directors requested that HydroScience recalculate and confirm the total amount of water delivered to residential and commercial/industrial/institutional customers in Section 1.2 "Water Demands and Planning Criteria."
5. The Board of Directors requested that HydroScience deliver the hydraulic modelling files used in preparation of the Memorandum to the District.
6. Upon recommendation of the General Manager, the Board of Directors agreed that the Draft Technical Memorandum could potentially be used to support an anticipated Proposition 218

rate-setting proceeding if it was revised to include discussion on the following items: a.) residential backyard mains; b.) surface water; and c.) size and position of a plume under Well No. 8. HydroScience agreed to provide these modifications to the Memorandum.

7. The Board of Directors agreed that the General Manager should provide HydroScience with any additional information or existing reports that would aid the firm in completing the requested Memorandum modifications.
8. The Board of Directors agreed that the future District Engineer, after appointed following the RFP process, should review and evaluate the modified Draft Technical Memorandum to further inform DPMWD's future decisions related to the Memorandum's findings and recommendations.

R3. A Municipal Service Review should be performed by LAFCO to study and analyze information about the Water District's governance structures and efficiencies. The Grand Jury also recommends that DPMWD fully cooperate with LAFCO to initiate this process by January 31, 2022 for completion of a new Municipal Service Review by June 30, 2022.

Response to R3.

This recommendation will be implemented as proposed.

DPMWD discussed conducting a new Municipal Service Review ("MSR") with the Executive Director of LAFCO, and respectfully requests an extended timeline to implement the Recommendation as proposed. LAFCO submitted a response to the Grand Jury Report on December 1, 2021, including Recommendation 3, requesting the same extension. A copy of that letter is attached as **Exhibit 7**. Given the new Board of Directors, new General Manager, and new legal counsel, the number of initiatives already underway to improve the condition of Well Nos. 2, 4, and 7, DPMWD suggested that the MSR be delayed for at least six months to allow the new team to execute these important improvements.

R4. The DPMWD should notify ratepayers in the required timeframe for any Notice of Violation, including when a water sampling test result exceeds the water Maximum Contaminant Level, along with its corrective actions. The DPMWD Board of Directors and staff should be trained on the public notification requirements and procedures. A new section in the DPMWD Policy Manual should be added to address these public notification requirements. The Grand Jury recommends that the DPMWD complete this training by January 31, 2022, and the Policy Manual should be updated accordingly by March 31, 2022.

Response to R4.

This recommendation will be implemented as proposed.

DPMWD has a "Water Quality Emergency Notification Plan" posted in the office and maintained for many years. It will be updated on or before March 31, 2022. The notification requirement is based on the tier of the violation. For example, even a minor coliform violation can have a 30-day notice requirement, while another violation could have a 15-day requirement.

The District has an existing Emergency Response Plan, last updated on July 6, 2017. Since only 618 out of a little less than 1,800 customers agreed to provide their emails and/or telephone numbers for emergency contacting, the first notification of an important issue is by bullhorn driving through the DPMWD boundaries. The entire District can now be covered in under an hour. The process is then repeated. Over the years, this has proven to be an efficient and effective means of urgent communication. DPMWD can then use paper notices and/or door hangers to either supplement the bullhorn, or as actual notice for less urgent issues.

While DPMWD does not presently have a mechanism for communicating with individual ratepayers without making one-on-one calls, DPMWD will look into systems that would allow this to occur for emergency communications. For example, it will contact Sacramento County and SSWD to see if there are opportunities for the District to utilize their communication channels for emergency communications.

The General Manager conducted a training for Directors and staff at a duly noticed special meeting on January 27, 2022 that included guidance on public notification for these emergency notices and other information that is publicly disseminated. DPMWD will review and update its process and make any appropriate changes to the Policy Manuel by March 31, 2022.

- R5. The DPMWD should prepare its 2021 Consumer Confidence Report and all subsequent annual reports to fully comply with the requirements issued by the State of California. The DPMWD should request that its draft 2021 Consumer Confidence Report be reviewed by DDW to ensure that it meets all of the State requirements before its final release. The review of this draft public document should be completed in May 2022.**

Response to R5.

This recommendation will be implemented as proposed.

The District has historically retained a consultant to assist with its Consumer Confidence Report. The District will commit to retaining a professional consultant to again assist with the preparation and submission of its 2021 Consumer Confidence Report to ensure compliance before submitting the report for Division of Drinking Water review.

- R6. The DPMWD board meeting agendas and minutes should be reviewed by their legal counsel to ensure that the documents have clear and unambiguous descriptions. The Grand Jury recommends that reviews begin immediately and continue for every meeting.**

Response to R6.

This recommendation will be implemented for the foreseeable future, and until such time that staff is adequately prepared and trained to draft and review meeting agendas and minutes.

Until his resignation in or about November 2019, DPMWD meeting agendas and minutes were reviewed and approved by long-term counsel, Adam Brown. There is no indication that the agendas or minutes during his long service to DPMWD were deficient or failed to comply with the Brown Act.

Subsequent to Mr. Brown's resignation, the law firm of White Brenner served as general counsel. Barbara Brenner of that firm was responsible for the review of and approval of meeting agendas and minutes.

At its November 18, 2021 meeting, the Board of Directors approved a legal services contract with Kronick, Moskovitz, Tiedemann & Girard ("Kronick") to serve as DPMWD's General Counsel. During the very brief period before the termination of White Brenner and retention of Kronick, the agendas were reviewed by Regional Government Services. The agendas and minutes of the meetings are now reviewed by counsel again. The District's new counsel has created agenda and staff report templates for staff use. These templates require sufficient description to provide the public with actual notice of each agenda item and demonstrate a marked improvement from the District's past practices. The District anticipates that counsel will continue to review the agendas and minutes for the foreseeable future, but reserves the right to have staff shoulder this responsibility once there is confidence in their ability to do so, and in order to preserve District resources and conserve costs.

- R7. The DPMWD board members and staff should attend annual and detailed Brown Act training sessions with an emphasis on developing unambiguous agenda descriptions. That Brown Act training could include participation in the California Special District Association's Certificate of Excellence Program for District Transparency. The Grand Jury recommends that the Board of Directors conduct its first training session by January 31, 2022, particularly as more than half of the Board members are new.**

Response to R7.

This recommendation will be implemented, as described below.

DPMWD will endeavor to have each Director participate in CSDA's Certificate of Excellence Program for District Transparency; however, the program takes three years of compliance with the requirements to earn the certificate, therefore this will be an ongoing effort. Prior to 2019, the previous Board of Directors and General Manager had nearly completed all requirements for the Certificate; however, DPMWD's participation was terminated by the 2019 Board of Directors and management. DPMWD must now start over.

Brown Act training for all Directors and staff was conducted by the General Counsel on January 27, 2022 at a duly notice special meeting. As part of its bi-annual ethics training, Board members will also receive supplemental training on the Brown Act when they obtain their AB 1234 certificate.

- R8. The DPMWD board members and staff must ensure that all materials in the board meeting packets are available to the public 72 hours prior to any Board meeting to avoid any Brown Act violations. The Grand Jury recommends that this begin immediately and continue for every meeting.**

Response to R8.

This recommendation has been implemented, as proposed.

DPMWD is now, and will continue, complying with all notice requirements of the Brown Act, as applicable. For example, packets will be available to the public 72 hours prior to any regular meeting. DPMWD meeting agendas, minutes, Board packets, and virtual meeting recordings are available in the DPMWD office for review, and are posted on DPMWD's website. The public has an opportunity to comment on agenda items before the Board takes action, and separately has an opportunity to make comments on items that are not on the agenda, but within the jurisdiction of the District. By way of example, a recent agenda and packet are attached as **Exhibit 8**, to demonstrate updated practices.

EXHIBIT 5



**SPECIAL MEETING OF THE BOARD OF DIRECTORS
DEL PASO MANOR WATER DISTRICT**

**December 10, 2021 6:30 PM
1817 Maryal Drive, Suite 300, Sacramento 95864**

The Del Paso Manor Water District Board of Directors meeting will be conducted virtually pursuant to the provisions of Assembly Bill 361 amending the Ralph M. Brown Act and Government Code Section 54953(e) and without compliance with Section 54953(b)(3) related to conducting public meetings during the COVID-19 pandemic based on the current State recommendations on social distancing.

Note: Given the state of emergency regarding the threat of COVID-19, the meeting will be held via teleconference only. Members of the public may call into the teleconference to participate. The District will also accept written public comment letters that are emailed to victoria@delpasomanorwd.org. Please include the specific agenda item and date of the meeting in the subject line of your email.

We encourage Board members and participants to join the teleconference 15 minutes early. Due to high call volumes, we ask that Board members and participants retry calling in if there is a busy signal or if you cannot successfully connect to the meeting when you call in.

Teleconference Information:

Join Zoom Meeting Link:

<https://zoom.us/j/97737667936?pwd=NnBxVmswRnRrZXVSVGhZbWd2b0FFUT09>

Meeting ID: 977 3766 7936 Passcode: 473630

Dial By Phone

US (SAN JOSE) +1 669 900 6833

US (TACOMA) +1 253 215 8782

A G E N D A

1. CALL TO ORDER:

2. ROLL CALL:

Chairman: Saunders
Directors: Dolk
Macias
Matteoli
Pratt

2157928.1 14685-001

3. ADOPTION OF AGENDA: Members may pull an item from the agenda.

4. PUBLIC COMMENTS: The Board of Directors welcomes participation at these meetings. Matters under the jurisdiction of the Board that are not posted on the agenda may be addressed by the public, California law prohibits the Board from acting on any matter which is not on the posted agenda, unless the members determines that it is an emergency or other situation specified in Government Code Section 54954.2. Public comments are limited to five (5) minutes per individual. Please make your comments directly to the DPMWD Chair. Comments will be accepted via teleconference and in writing.

5. CONSENT CALENDAR: All items under Consent Calendar will be considered together by one action of the Board, any Member or members of the public may request that an item be removed and considered separately.

Item 5.A: Approval of Warrants

Recommendation: Approval of Warrants

6. PUBLIC HEARING:

7. NEW BUSINESS:

Item 7.A: Review of May 2021 HydroScience Strategic Water Solutions Technical Memorandum.

Pursuant to the November 5, 2021 Grand Jury Report, discussion of the findings and recommendations of the May 2021 HydroScience Strategic Water Solutions Technical Memorandum, originally authorized by the DPMWD as a Proposed Update to its 2009 Water District Master Plan and request for public comment.

Recommendation: Allow staff to provide a presentation on the findings and recommendations of the May 2021 HydroScience Strategies Water Solutions Technical Memorandum, and provide staff with direction on next steps for the District to address such findings and recommendations, including, but not limited to prioritizing projects for the Engineering firm to be retained.

8. DIRECTORS COMMENTS: Verbal information, non-action comments.

9. GENERAL MANAGERS COMMENTS: Verbal report


10. ADJOURNMENT: Next Regular Board of Directors meeting is scheduled for January 4th, 2022

CERTIFICATION OF POSTING:

I, Victoria Hoppe, Secretary of the Board of the Del Paso Manor Water District, do hereby declare under penalty of perjury that the foregoing agenda for the Regular meeting of the Board of Directors has been posted at the administrative office, and District website of the District and at least 24 hours prior to the meeting date.

Date Posted: __December 9, 2021

Time posted: 6:30 p.m.

Signature: 
Secretary of the Board of Directors
Del Paso Manor Water District

OTHER IMPORTANT INFORMATION

The Board will discuss all items on its agenda, and may take action on any of those items, including information items and continued items. The Board may also discuss other items that do not appear on its agenda but will not act on those items unless action is urgent, and a resolution is passed by two-thirds (2/3) vote declaring the need for action arose after posting of the agenda.

This agenda has been prepared and posted in compliance with the provisions of the Ralph M. Brown Act, and specifically the provisions of Sections 54954.2 and 54954.3 of the Government Code. Board action may occur on any identified agenda item. Any member of the public may address the Board on any identified agenda item of interest after board discussion has ended on that item, and if there is a motion, before the vote is taken. Public comment on items within the jurisdiction of the Board is welcomed, subject to reasonable time limitations for each speaker.

PUBLIC COMMENTS: If you would prefer to submit public comments in writing, please email your comments to Victoria@delpasomanorwd.org if you are commenting on a specific agenda item, or items, please state the agenda item number(s) in the subject line of the email. All comments received via email will be provided to the Board in writing and included as part of the record of the meeting.

DISABLED OR SPECIAL NEEDS ACCOMMODATION:



In compliance with the Americans with Disabilities Act, Del Paso Manor Water District encourages those with disabilities to participate fully in the public hearing process. If you have a special need in order to allow you to attend or participate in our public meeting and public hearing processes, including receiving notices, agendas, and other writings in appropriate alternative formats, please contact our office at (916) 487-0419 at least 72 hours in advance of the public meeting or hearing you wish to attend so that we may make every reasonable effort to accommodate you.

ITEM #7A

Review of May 2021 HydroScience Strategic Water Solutions

Technical Memorandum



DEL PASO MANOR WATER DISTRICT BOARD MEETING STAFF REPORT

MEETING DATE: December 10, 2021

AGENDA ITEM 7.A Review of May 2021 HydroScience Strategic Water Solutions Technical Memorandum.

Allow staff to provide a presentation on the findings and recommendations of the May 2021 HydroScience Strategies Water Solutions Technical Memorandum, and provide staff with direction on next steps for the District to address such findings and recommendations, including, but not limited to prioritizing projects for the Engineering firm recently retained.

EXECUTIVE SUMMARY:

Pursuant to the November 5, 2021 Grand Jury Report, discussion of the findings and recommendations of the May 2021 HydroScience Strategic Water Solutions Technical Memorandum, originally authorized by the DPMWD as a Proposed Update to its 2009 Water District Master Plan and request for public comment.

STAFF REPORT:

Background:

I. Grand Jury Report

The Sacramento County Grand Jury published a report on or around November 5, 2021 that addressed the Del Paso Manor Water District (DPMWD) operations and activities.

On December 2, 2021, the District's new General Counsel sought additional clarification and a request for extension from the Grand Jury, due to the new leadership of the District and time constraints in providing a meaningful response. (See Attachment 1). On December 3, 2021, the Grand Jury responded to the District's request and allowed the preparation of one consolidated response, to be due on or before February 4, 2021. (See Attachment 2).

Notwithstanding this time extension, the Grand Jury Report required the District

to act on some recommendations before that deadline.

Included as part of its Recommendations was:

Recommendation R2: The DPMWD should address the findings and recommendations of the May 2021 HydroScience Strategic Water Solutions Technical Memorandum, originally authorized by the DPMWD as a Proposed Update to its 2009 Water District Master Plan; formal public involvement should be documented to meet the requirements of the Brown Act. This process should begin immediately and be completed within 60 days.

Pursuant to this recommendation, staff recommends a discussion of the May 2021 HydroScience Technical Memorandum, a copy which may be obtained on the District's website at:

<https://www.delpasomanorwd.org/files/be3933fc6/Board+Packet+01JUN21.pdf>, and also available in hard copy at the District's offices for inspection.

II. 2021 HydroScience Technical Memorandum

On October 20, 2020 the District retained HydroScience to perform their proposed September 22, 2020 limited update to its Master Plan for \$56,830. There were undocumented changes to the September 22, 2020 proposal that were not preserved in writing such as not performing the surface water analysis listed on page 9, excluding any discussion of ultimate replacement of the 1945 circa iron pipes, and the need to mention the plume under well 8 and allocating money to study the extent of the plume for possible outside monies to remediate it. If HydroScience were to amend the Technical Memo to include exhibits with this information that could cure the issues raise by the Board and staff.

The contract was executed on November 12, 2020. HydroScience was charged with "creating a supplemental but comprehensive update that provides the District the flexibility to make decisions now and in the future."

HydroScience prepared a technical memorandum which was then distributed to the then-board of directors.

The technical memorandum represented an amendment to the District's 2009 Water Master Plan (2009 WMP) to document data, policies, projects, and strategies that have been completed or updated in the intervening 11 years and provided a roadmap for reaching new policy and vision goals.

The District's water system is comprised of buried water mains, eight (8) groundwater wells, and individual service connections, and has generally been in continuous service for over 65 years. Since 2009, two wells were abandoned, two wells were developed and equipped as replacements, one well has been taken offline indefinitely due to contamination, another was placed on standby

due to high contaminant levels, and one well is being monitored for rising contaminant levels.

There are approximately 1800 water connections, of which 100 are commercial. This means that 95% of the connections are residential; however, based on water demands, commercial uses more water. Residential water use of 768,816 gpd represented approximately 49% of all water delivered while commercial/industrial/institutional represented 51%. The largest single water use account was the cooling towers at AT&T.

The TM updated specific aspects of the 2009 WMP as follows:

- Water demands and planning criteria.
- Water supply and wells.
- Hydraulic modeling utilizing updated system flow criteria to determine pipe and hydrant deficiencies.
- Identification of near term (0-5 years) prioritized projects to address the most significant deficiencies.
- Longer-term recommendations for additional studies and projects.

The 2021 Amendment did not commit the ratepayer to any specific discretionary action in order to implement policy goals, nor did the District implement any. The report is up for discussion tonight and amendments are recommended by staff as noted above.

In addition to updating the data and facilities to represent current conditions, the TM presented a preliminary Capital Improvement Plan (CIP) for near-term system improvements to supplement the longer-range improvements in the 2009 WMP.

III. DPMWD Next Steps and Recommendations

During its December 7, 2021 Board meeting, the Board directed staff to publish a Request for Proposals/Qualifications for Engineering Services. Included within that scope of work was design engineering services related to potable water facilities, including pipelines, pump stations, tanks, dams, and diversion facilities. Furthermore, the prospective engineering company will be asked to assist with support services during bidding and construction, and task orders would be issued by the General Manager to effectuate projects.

Staff recommends that once the District retains and approves a contract for said Engineering Firm, that they peer review the 2021 Technical Memorandum and advise the District on high priority, medium priority, and low priority projects in comparison to what was set forth in the Technical Memorandum, and then assist with implementing high priority projects.

Staff expects that high priority projects will include rehabilitation of Well 7 to

increase use from standby/emergency use to regular use, and the potential repair of Wells 2 and 4, among other projects. Well 8 has been taken offline indefinitely due to exceedances of the maximum contaminant level (MCL) for tetrachloroethylene (PCE) and staff does not recommend bringing that well back online for those reasons unless the plume is remediated. Well 5, which is in the same general vicinity, is being monitored to ensure that it is not impacted by the PCE plume migration from the McClellan Air Base, but staff supports the TM's recommendation to inspect and repair the casing hole as an intermediate priority. Following the State Water Resources Control Board inspection and 2019 report, Well 3's status was changed from active to standby/emergency due to exceedances of the MCL for 1,2,3 Trichloro propane (TCP). Additional testing will be required in order to apply for a change in status back to active and increasing the pedestal height to at least 18 inches may resolve this issue altogether.

Despite many of the District's wells being offline, its well system firm capacity (with Well 9 on standby) is 3,075 gpm, which is greater than the updated MDD of 1,396 gpm. Therefore, the District meets this waterworks standard.

The District must work on addressing Maximum Day and Fire Flow demands for the Commercial District, since it does not have a storage tank in its distribution system and the well capacity cannot meet the 3,500 gpm requirements for both the AT&T and WinCo facilities. Short term recommendations include the potential use of emergency water from its Mutual Aid Assistance agreement with Sacramento Suburban Water District or drilling a new well at Oroville Wright Park until such time that the District may make use of its surface water rights, or bring standby and inactive wells back online. However, the District has started the rehabilitation of Wells 2 and 4, and is doing the preliminary work to upgrade Well 7 to fully active.

Even though the District is considered a "Small Water District" and not an "Urban Water Supplier" and is not subject to Assembly Bill 2572, requiring metering of all connections, since the District is a signator to the Water Forum Agreement, it has agreed to convert all water connections to meters by 2030. At present, only commercial properties and multi-family connections are metered.

These immediate projects will ensure that the District has sufficient water for its customers in the near and immediate future. Once high priority projects are addressed, the District can begin working on medium and low priority projects to ensure efficiency and long-term viability. For example, as part of medium priority, the District can install additional fire hydrants. As part of important but lower priority projects, while the District has surface water rights to the American River, it has not been able to use such water due to the lack of infrastructure that would transmit to the water to the District jurisdiction.

ENVIRONMENTAL CONSIDERATIONS:

Consideration of the May 2021 HydroScience report is itself not a project under the California Environmental Quality Act. However, any future projects to implement improvements or repairs will be analyzed at the time of approval.

ATTACHMENTS:

1. December 2, 2021 Kronick Letter to Grand Jury
2. December 3, 2021 Grand Jury Email Allowing Consolidated Response
3. November 5, 2021 Grand Jury Report (available at <https://www.saccourt.ca.gov/grand-jury/docs/reports/21-22/dpmwd-investigative-report-110521.pdf>).
4. May 2021 HydroScience Strategic Water Solutions Technical Memorandum (available at <https://www.delpasomanorwd.org/files/be3933fc6/Board+Packet+01JUN21.pdf>)

STAFF RESPONSIBLE FOR REPORT: Alan Gardner, General Manager

12-10-2021

Date

EXHIBIT 6

To: Del Paso Manor Water District, Mr. Adam Coyan, General Manager
From: Alicia Brundage, PE, Project Manager
Reviewed By: Ligaya Kohagura, PE
Subject: 2021 Amendment to the DPMWD 2009 Water Master Plan - **DRAFT**
Date: May 26, 2021 (Updated Draft)

Section 1: Executive Summary

1.1 Purpose

This technical memorandum (TM) represents an amendment (2021 Amendment) to the District's 2009 Water Master Plan (2009 WMP) to document data, policies, projects, and strategies that have been completed or updated in the intervening 11 years and provides a roadmap for reaching new policy and vision goals. This 2021 Amendment updates specific aspects of the 2009 WMP as follows:

- Water demands and planning criteria.
- Water supply and wells.
- Hydraulic modeling utilizing updated system flow criteria to determine pipe and hydrant deficiencies.
- Identification of near term (0-5 years) prioritized projects to address the most significant deficiencies.
- Longer-term recommendations for additional studies and projects.

This 2021 Amendment does not commit the ratepayer to any specific discretionary action in order to implement policy goals. Updates to the 2009 WMP are presented in this TM, which is organized similarly to the 2009 WMP. The TM includes references to the 2009 WMP where appropriate, for convenience.

In addition to updating the data and facilities to represent current conditions, this 2021 Amendment presents a preliminary Capital Improvement Plan (CIP) for near-term system improvements to supplement the longer-range improvements in the 2009 WMP. There are significant liabilities facing the District in maintaining a high quality, reliable water supply and level of service. These liabilities are addressed by the recommended CIP.

1.2 Water Demands and Planning Criteria

The water use over the past two decades has reduced significantly due to ongoing drought conservation measures. It is expected that some conservation measures that were required during the extended drought periods have remained in use even when there is no longer a drought. The updated evaluation of water demands resulted in the following findings:

- The calculated average for the District is 2.56 persons per household. Using the staff reported number of 1,798 residential connections, the estimated population for the District of roughly 4,600 persons.
- The District reports that there are currently 1,798 residential connections and 100 commercial connections, which indicates that 95% of the District's connections are residential.
- The District provided monthly well meter data from 2014 through mid-July 2020 and monthly commercial meter reading from April 2020 through November 2020. In comparing the only recent overlapping data from April 2020 through July 2020, it is estimated that the residential water use of 768,816 gpd represented approximately 49% of all water delivered while commercial/industrial/institutional represented 51%. The largest single water use account was the cooling towers at AT&T.
- Usage metering is limited to commercial and multi-family residential connections. Commercial metering does not generally separate irrigation demands, making it difficult to quantify implementation of outdoor water use conservation policies.
- Based on historical well production data from January 2014 thru July 2020, the Average Day Demand (ADD) is estimated at 698 gpm. This represents a reduction from the historical water use of 1,680 gpm (1.5 MGD) reported in the 2009 WMP. ADD has remained low these past 6 years since the last significant drought year in 2015. This reduction is likely to be permanent due to conservation policies enacted during the multi-year drought of 2012-2016.
- The reduction in ADD water demand, despite a slight increase in population, can be attributed to continuing water conservation efforts and public awareness for drought potential. Based on the District's updated population of 4,600 persons, the estimated residential per capita water demand is 218 gpcd.
- Using the available well supply data (and previously noted 10% unaccounted for water losses), the estimated Maximum Day Demand (MDD) is 1,396 gpm for the years 2014-2019.
- For commercial customers, the largest user is the AT&T Telephone Service Center, which is located in the northwest of the service area. The hydraulic model considered a demand of 3,500 gpm for a 4-hour duration, driven by fire flow requirements at this location.
- A fire demand of 3,500 gpm for a 4-hour duration was considered for the WinCo Foods location at the southern end of the Country Club Plaza near the intersection of Watt Avenue and Butano Dr.
- As the State of California continues to take a hard look at water use, sustainability, climate change, and requires a more active approach in determining local water use patterns, the District is likely to be statutorily exempt from some requirements due to its small size but can expect increasing pressure to increase water conservation. Water conservation should continue to be a key element of managing the District's water supply.

1.3 Water Supply and Wells

The water supply and well evaluation contained in the 2009 WMP was updated with new information provided by the District including the results of a State Water Resources Control Board (SWRCB) inspection conducted in 2019. During the period since 2009, two wells were abandoned, two wells were developed and equipped as replacements, one well has been taken

offline indefinitely due to contamination, another was placed on standby due to high contaminant levels, and one well is being monitored for rising contaminant levels.

Per California Waterworks Standards (Title 22, Chapter 16), community water systems using only groundwater shall be capable of meeting MDD with the highest-capacity source off-line. Currently, the District's well system firm capacity (with Well 9 on standby) is 3,075 gpm, which is greater than the updated MDD of 1,396 gpm. So, the District meets this waterworks standard. Additionally, a system without a storage tank should be capable of meeting MDD plus the maximum Fire Flow (FF) demand, which is the AT&T facility's FF demand of 3,500 gpm, with the largest well out of service. Based on these conditions, the District's system does not currently meet this additional requirement.

In 2008, the District completed a Conjunctive Use Plan to evaluate alternatives for developing a surface water use program and participating in groundwater wheeling with neighboring districts to bring more surface water into the District and to offset groundwater pumping during wet years. Implementation of this plan has not progressed as of the date of this 2021 Amendment.

1.4 Facilities Replacement Planning and Implementation

Hydraulic modeling utilizing updated system flow criteria was performed to determine pipe and hydrant deficiencies and identify near-term capital improvement projects. The evaluation and identification of near-term CIP projects to address identified deficiencies is summarized in Table 1-1, next page.

Table 1-1: Near Term CIP Summary

Project Priority	Description	Need Addressed	Estimated Planning-Level Implementation Cost ¹
1	Install New Fire Hydrant on 12" Main	High fire flow at AT&T	\$16,000
2	Pipe Replacement Projects 2-10 (see Note 2)	Hydrant flow deficiency	\$580,000
3	Install New Water Supply Well(s) Totaling 1,800 gpm Additional Flow (See Note 3)	MDD+FF deficiency, improve system pressures, improve supply reliability	\$3,100,000
	Engineering Evaluation of New Supply Options	Select most cost-effective and feasible approach to augment supply.	\$50,000 – \$75,000
4	Install 260kW, 480VAC NG outdoor genset at Well 9 with sound enclosure; replace MTS with ATS (See Note 4)	Provide redundancy and reliability to the system	\$450,000
5	Install 15 Additional Fire Hydrants	Improve compliance with 500 ft max hydrant spacing	\$240,000
NP ⁵	Install 8" PRV Station and Intertie to SSWD, 3 Locations (see Note 6)	Connect supplemental water source for pressure support	\$320,000

Notes:

1. Rounded to two significant figures.
2. Pipe replacement projects can also be implemented individually or in smaller groups. Refer to prioritization in Attachment B, Cost Detail, for recommended order of implementation. Order is set based on level of existing fire flow deficiency addressed by the corresponding upgrade.
3. New well project is a placeholder for a well or other alternative to increase capacity and/or provide storage for fire flow. Alternatives include: alternate well locations, greater number of smaller new wells, rehabilitation/reboring of existing wells, and utilization of interties. Project cost will change depending on the type of project chosen. Cost of land acquisition is not included. The District should first evaluate potential impacts to residential metering and fluoridation requirements, as stated herein, prior to implementing this project. A budgetary amount for an engineering study to evaluate and select the preferred alternative is presented.
4. Genset cost excludes the cost of bringing natural gas onsite. If there is a natural gas pipeline in the street near the water main, the approximate added cost is \$10,000 for the natural gas service extension). Installation of genset at this location will require coordination with adjacent school.
5. NP=Not Prioritized.
6. The District should first evaluate potential impacts to residential metering and fluoridation requirements and need to update the existing agreement, as stated herein, prior to implementing this project.

Section 2: Introduction

2.1 Purpose of the 2021 Amendment to the 2009 Water Master Plan

The Del Paso Manor Water District (District) has long been committed to providing a safe and reliable water supply while, at the same time, maintaining low water rates. The 2009 Water System Master Plan (Master Plan) was the first District Master Plan to address the District's planning strategies and to develop projects to address aging infrastructure and changing water supply concerns. This 2021 Amendment to the DPMWD 2009 Water Master Plan (2021 Amendment) is not intended to be a full master planning effort but a documentation of data, policies, projects, and strategies that have been completed or updated in the intervening 11 years

and provides a roadmap for reaching new policy and vision goals. This 2021 Amendment updates specific aspects of the 2009 WMP as follows:

- Water demands and planning criteria
- Water supply and wells
- Hydraulic modeling utilizing updated system flow criteria to determine pipe and hydrant deficiencies
- Identification of near term (0-5 years) prioritized projects to address the most significant deficiencies
- Longer-term recommendations for additional studies and projects

This 2021 Amendment does not commit the ratepayer to any specific discretionary action in order to implement policy goals. Updates to the 2009 WMP are presented in this TM organized similarly to the 2009 WMP, for convenience.

Limited updated data was available regarding well condition and customer demands. Where data was not provided or was limited, the team made inferences based on knowledge of other nearby water districts and recent experiences on similar water system planning.

2.2 Background

The District is located in the Arden area of unincorporated Sacramento County, northeast of the City of Sacramento, as shown in the vicinity and location maps provided in Figures 1 and 2. The District service area is approximately 1.3 square miles and the District provides drinking water to approximately 1,800 residential, commercial, and institutional customers. The District is bounded on all sides by Sacramento Suburban Water District (SSWD), a large water purveyor in the Sacramento region. Figure 3 provides a map of the region and the District's location relative to neighboring water purveyors.

The District is fully built-out and is facing an increasing infrastructure liability as the aging pipelines and wells reach the end of their useful life. The District's water system is comprised of buried water mains, eight (8) groundwater wells, and individual service connections, and has generally been in continuous service for over 65 years. Figure 4 provides the location of each of the existing District wells and approximate locations and diameters of existing buried water distribution pipelines. The District's elected Board of Directors, recognizing that the aging system and water supply reliability impact water service, commissioned this update to the 2009 Water Master Plan. Over the next 5 to 30 years, the infrastructure needs will continue to rise as more older facilities fail. This update will provide an initial roadmap for distributing available funding.



FIGURE 1
 DEL PASO MANOR WATER DISTRICT
 WATER MASTER PLAN UPDATE
 VICINITY MAP

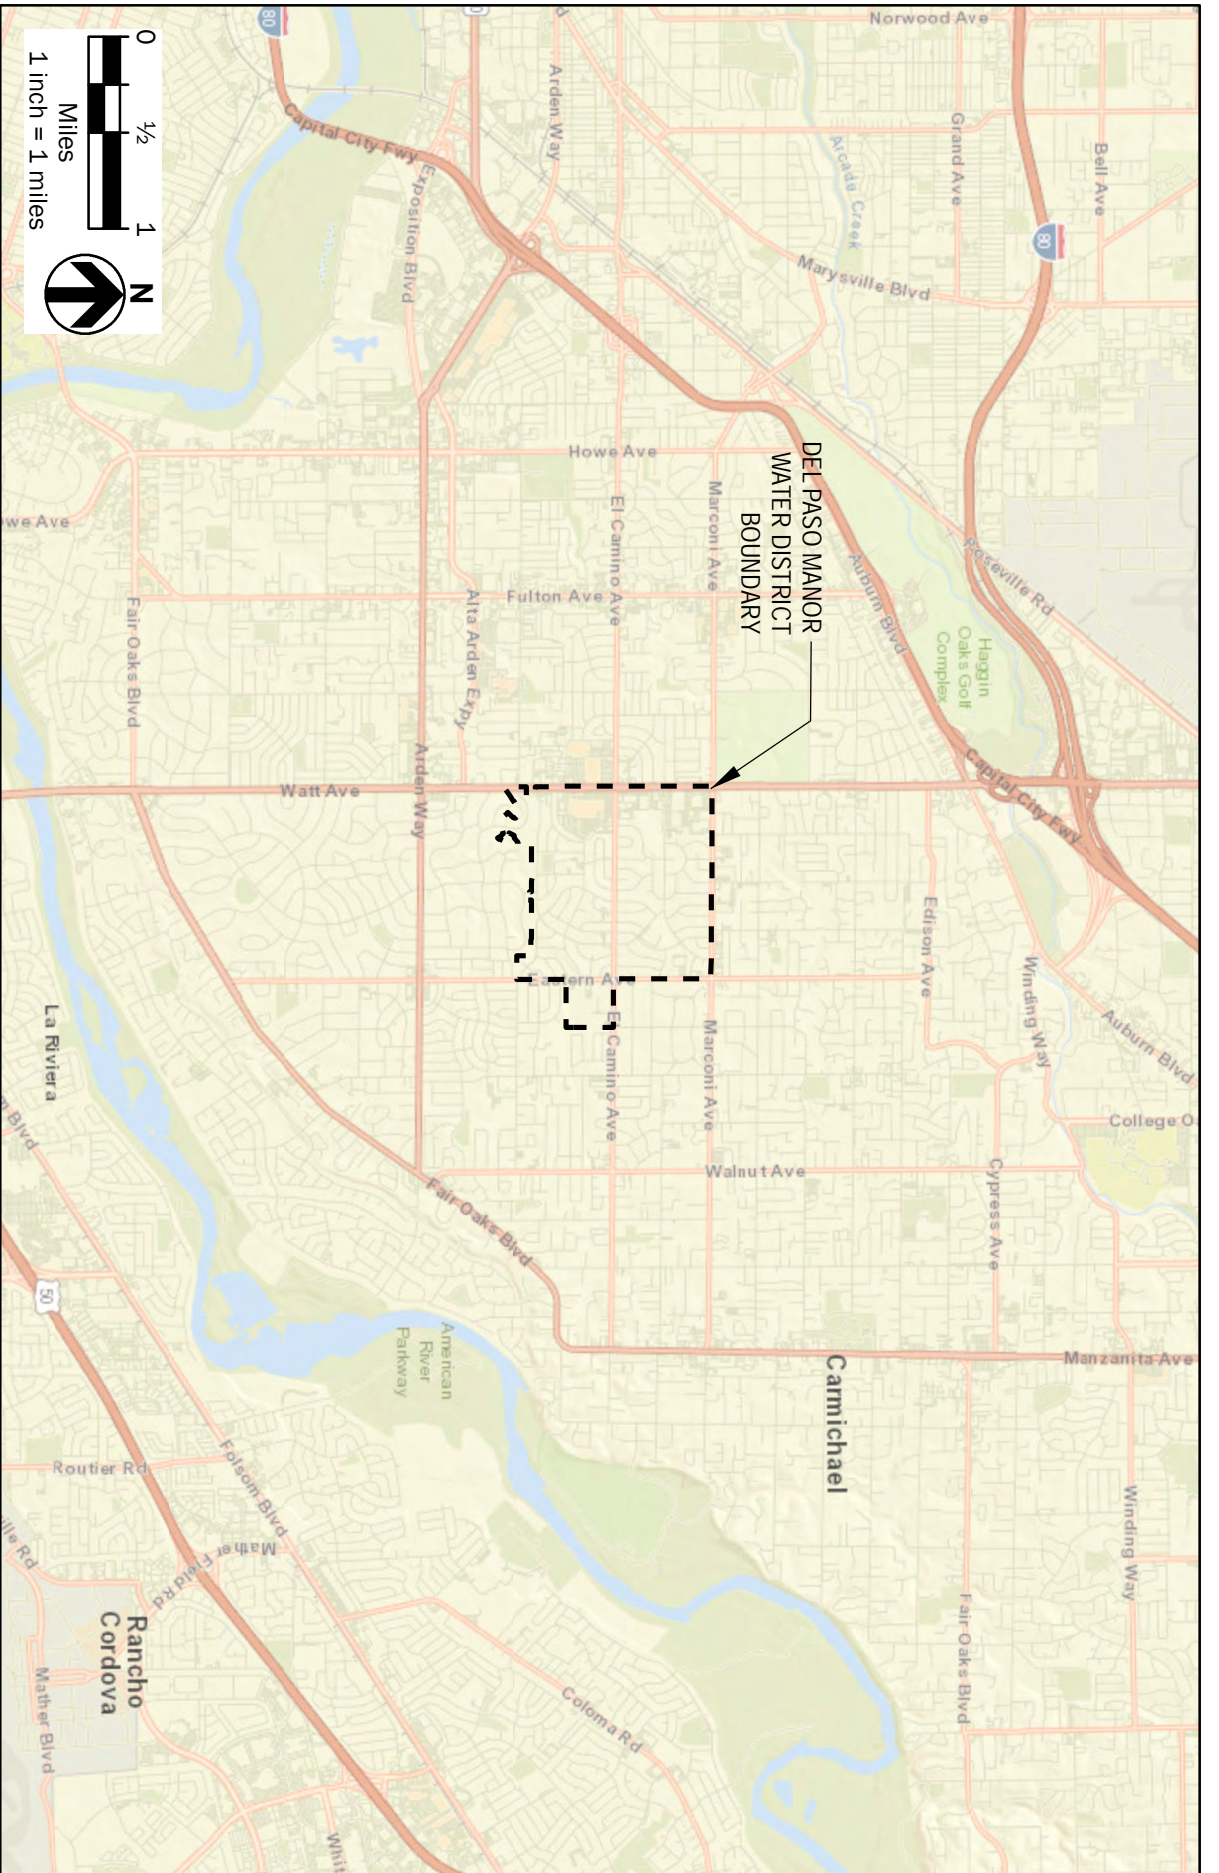


FIGURE 2
DEL PASO MANOR WATER DISTRICT
WATER MASTER PLAN UPDATE
LOCATION MAP

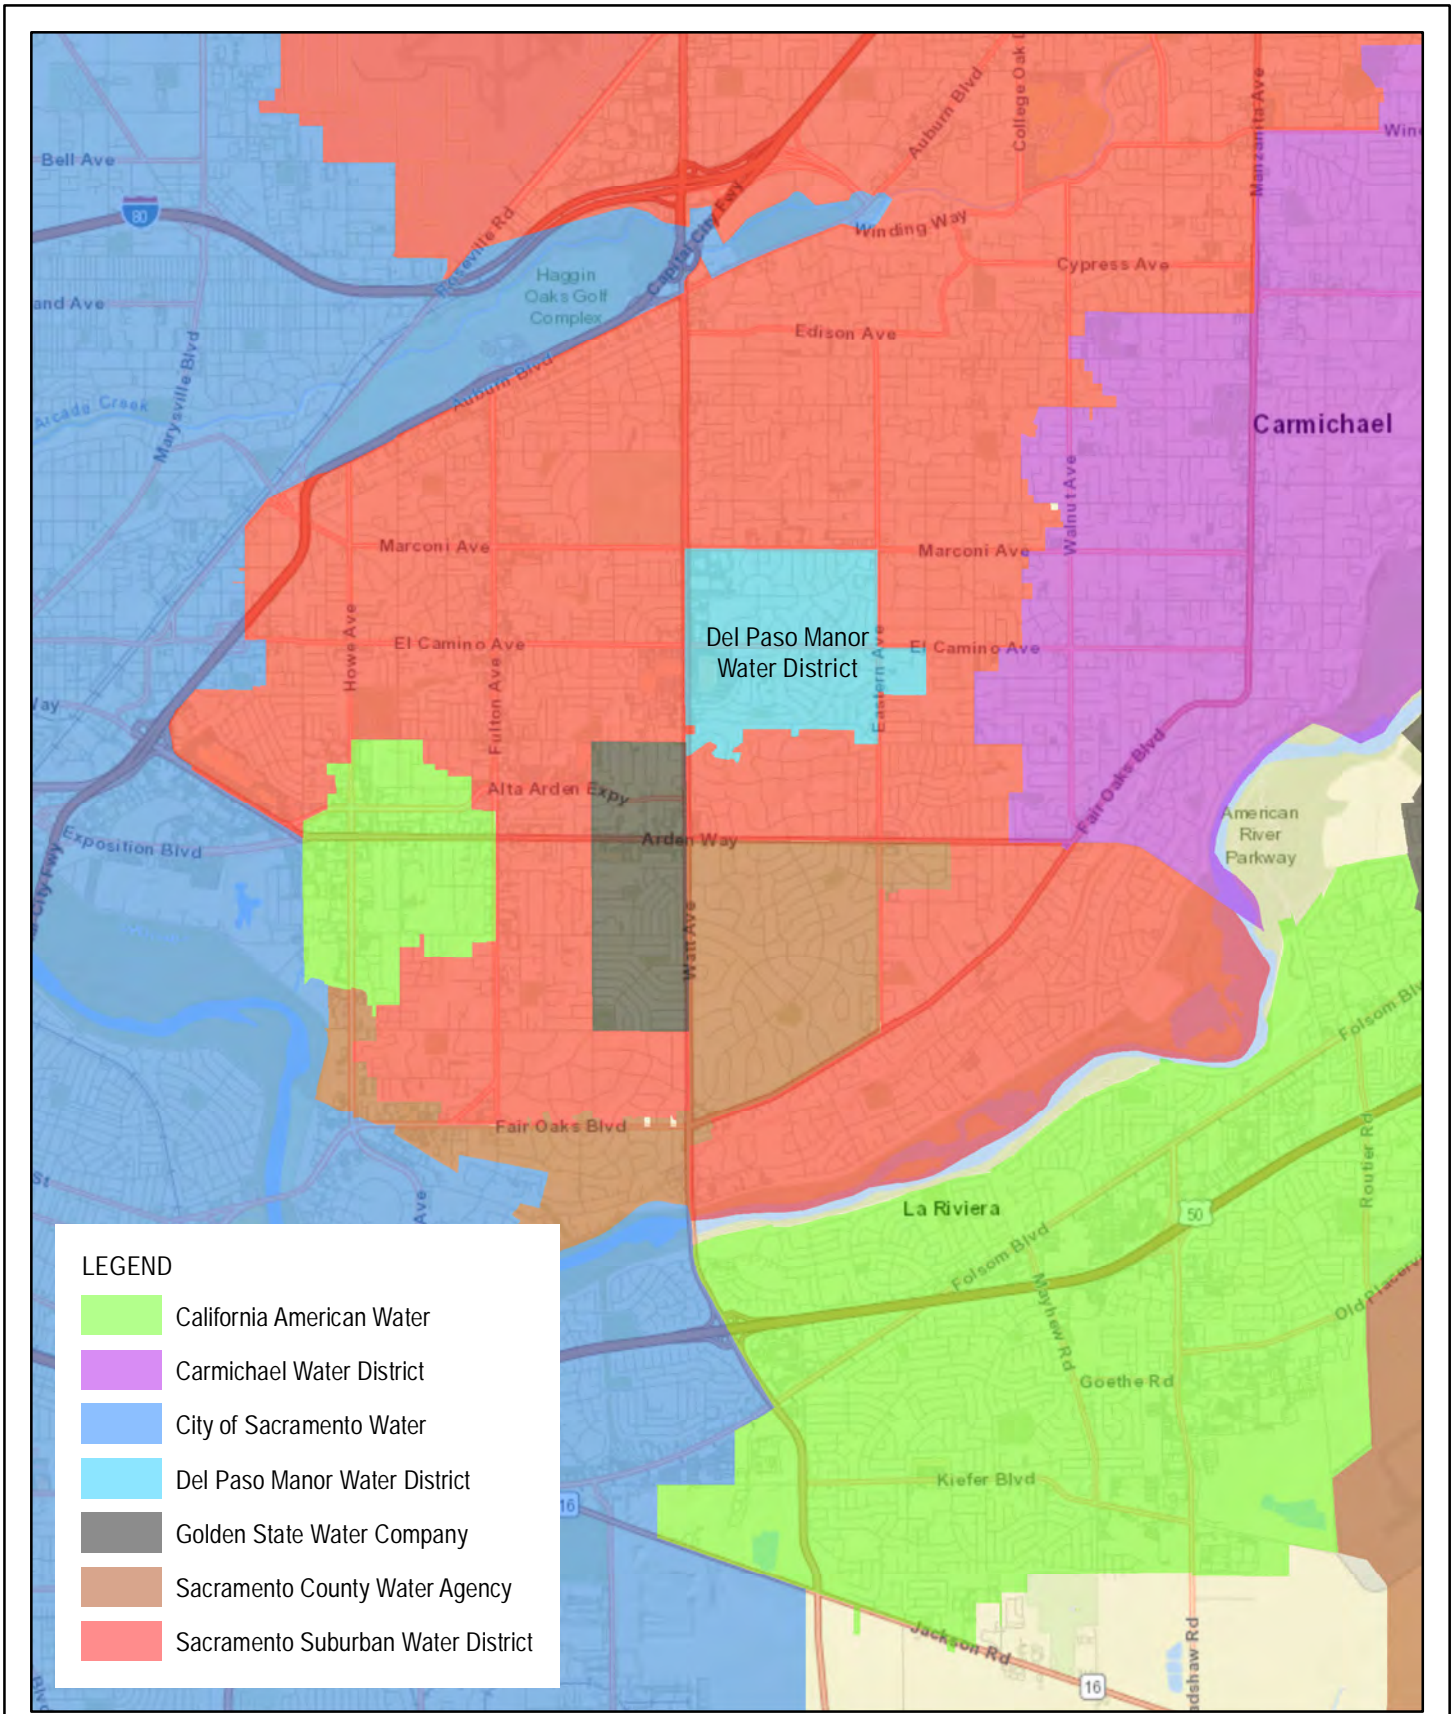


FIGURE 3
 DEL PASO MANOR WATER DISTRICT
 WATER MASTER PLAN UPDATE
 ADJACENT WATER DISTRICTS

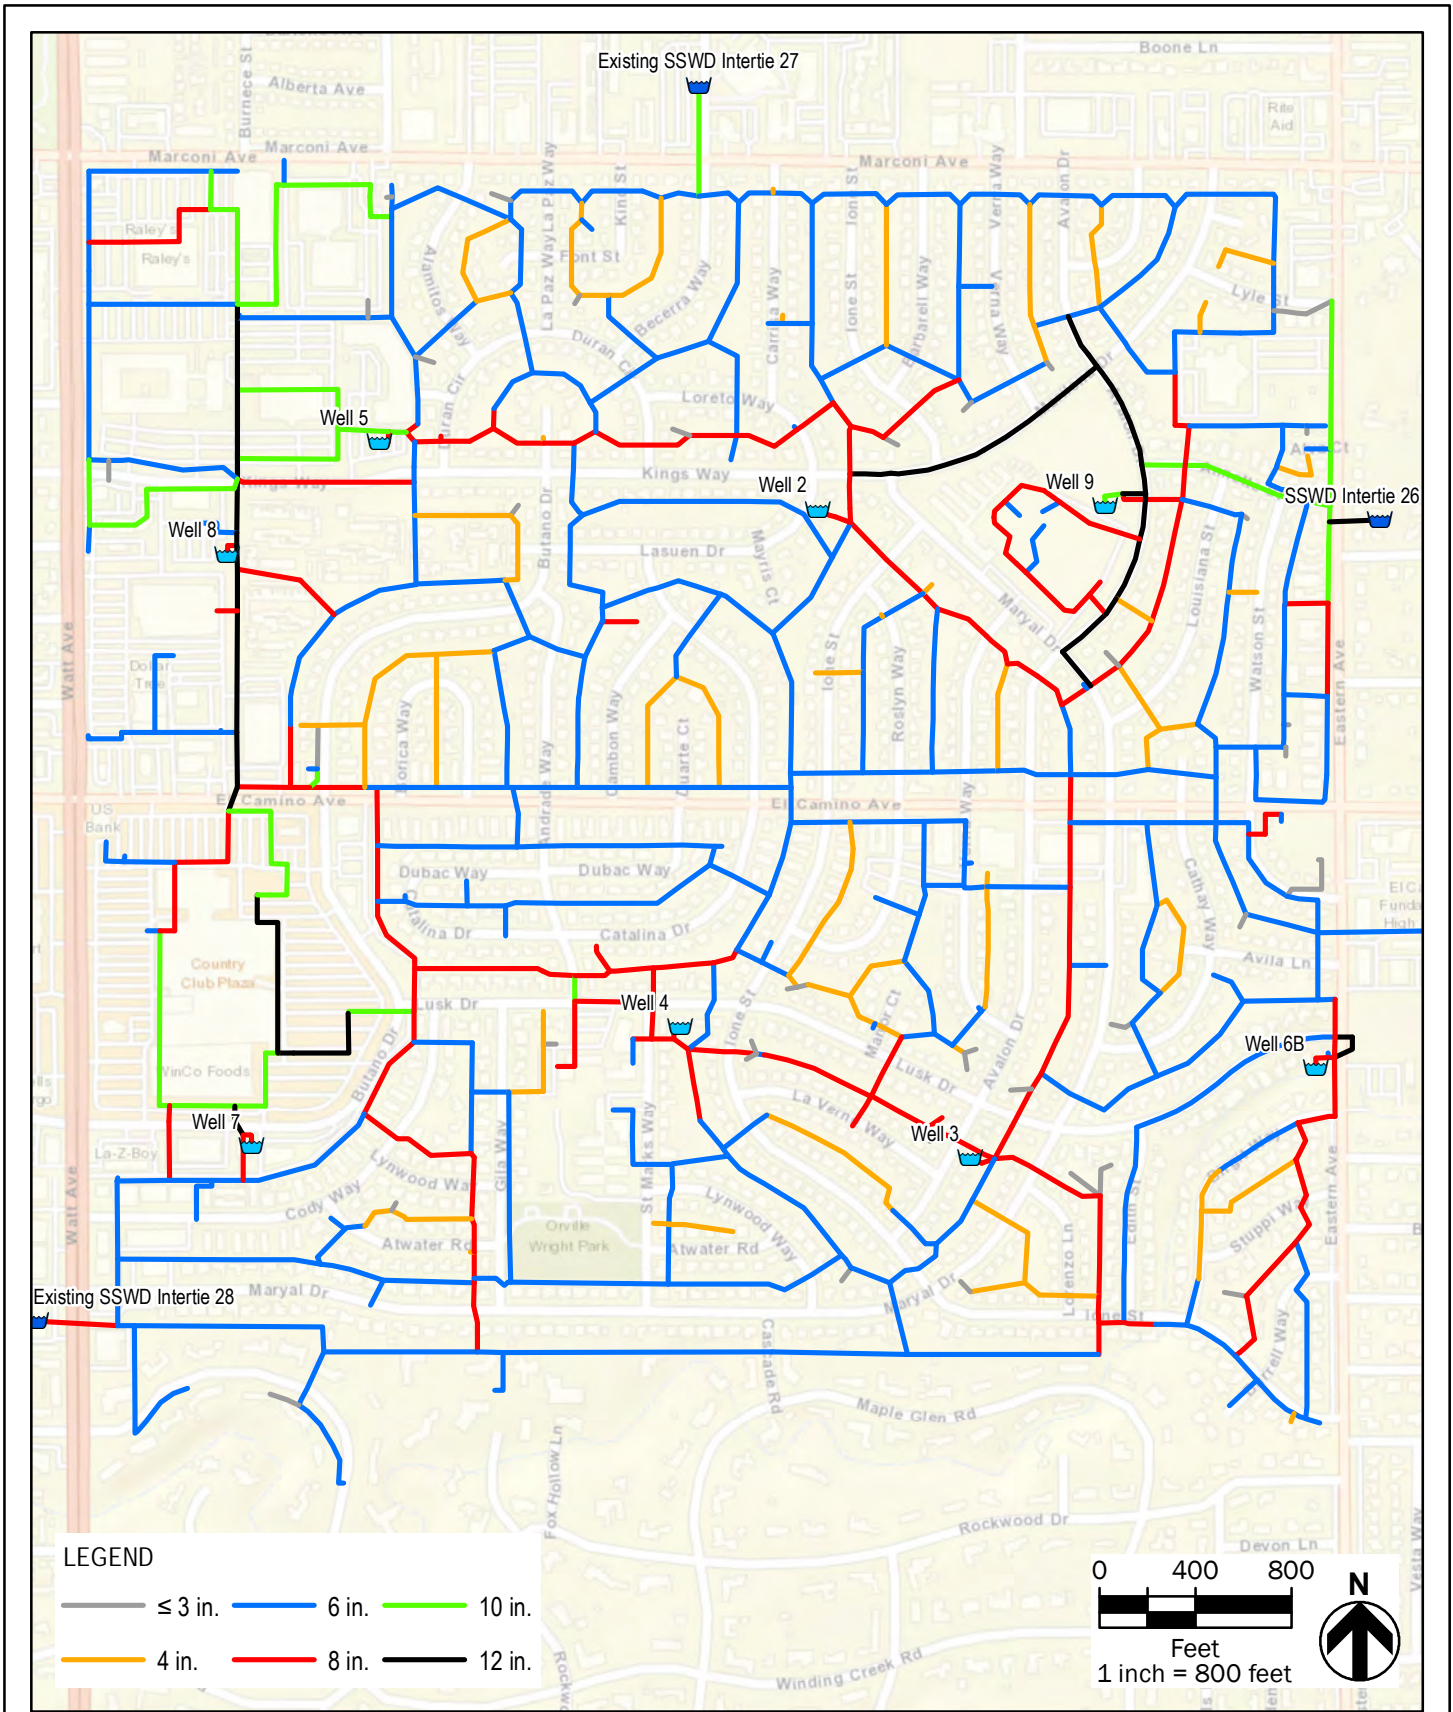


FIGURE 4
 DEL PASO MANOR WATER DISTRICT
 WATER MASTER PLAN UPDATE
 DISTRICT FACILITIES MAP

Section 3: Water Demands and Planning Criteria

This section provides updates to the water demands and planning criteria that were previously addressed by Section 3 of the 2009 WMP.

3.1 Introduction

The District is designated as a “Small Water District” and therefore does not meet the California threshold of an “Urban Water Supplier”. Since it neither serves more than 3,000 urban connections nor provides more than 3,000 acre-feet of water annually, the District is not subject to State of California Assembly Bill AB-2572, which would require metering of all municipal (residential and commercial) connections by January 1, 2025.

The District reports that its number of connections has remained stable since the previous master plan due to the service area being built-out.

3.2 Population and Growth

The District is not expected to experience significant population growth or demographic changes. The District has one elementary school, one high school and a commercial district, however the majority of service connections are residential. The land use change most anticipated is redevelopment of commercial properties with potentially different water needs. This should be accommodated in the record-keeping process moving forward so these potential changes can be considered during the evaluation of demand in subsequent master planning efforts.

The District encompasses a small geographic area within an unincorporated portion of Sacramento County whose population is not measured and reported through the usual sources for determining population and growth. Because population in the District area is not measured directly, this report determines the District’s population growth by investigating Census Designated Places (CDP) within the northern unincorporated areas of Sacramento that exhibit similar socio-economic and geographical characteristics. Table 3-1 (next page) shows the CDP areas used in the 2009 Master Plan and provides updated 2019 population and housing unit density for each CDP. The table below indicates that the Foothill Farms and the Gold River CDPs experienced significant growth indicating that the CDPs still had open tracts of land available for development. The District service area does not incorporate such tracks of developable land. therefore, Foothill Farms and Gold River CDPs were discounted in the estimate calculation of the population per household in the District’s service area. As projected in the 2009 Master Plan, the increase in estimated population per household is minor and can be attributed to the area’s demographics slowly changing from older single or two person residences to younger two to four person residences. This trend is expected to continue slowly. As shown in the table below, the calculated average for the District is 2.56 persons per household. Using the staff reported number of 1,798 residential connections, the estimated population for the District of roughly 4,600 persons.

Table 3-1: Population and Housing Unit Density

Geographic Area	Housing Units per square mile	Population per square mile	Population per Household	Change since 2000
Arden Arcade CDP	2,521.2	5,778.9	2.29	+0.15
Carmichael CDP	2,052.2	4,774.4	2.33	---
Citrus Heights City	2,486.0	6,153.0	2.48	+0.04
Fair Oaks CDP	1,222.4	2,873.3	2.35	-0.09
Foothill Farms CDP	3,036.9	8,543.1	2.81	+0.26
Florin CDP	1,823.3	5,466.1	3.00	+0.12
Gold River CDP	1,336.9	2,899.2	2.17	-0.28
La Riviera CDP	2,606.1	6,022.2	2.31	+0.02
Orangevale CDP	1,199.7	3,028.2	2.52	-0.12
Rio Linda CDP	518.1	1,652.4	3.19	+0.28
Del Paso Manor WD Estimated Population/Household Density			2.56 4,600 persons	+0.06

US Census 2019 American Community Survey 5-Year Estimates

3.3 Water Use

The District provided historical well production data from January 2014 thru July 2020 which was used to estimate system demands (Table 3-2). Based on typical water system data, we assumed that 10% of the water produced at the wells is unaccounted for water loss and the remaining 90% of water supply volume is the District demand.

Table 3-2: Annual Well Production and ADD Estimate

Year	Well Production	Well Production	Average Day Demand (ADD)
2014 ¹	1,447 AFY	1.29 MGD	897 gpm
2015	941 AFY	0.84 MGD	585 gpm
2016	1,113 AFY	0.99 MGD	690 gpm
2017	1,111 AFY	0.99 MGD	689 gpm
2018	1,100 AFY	0.98 MGD	682 gpm
2019	1,037 AFY	0.93 MGD	643 gpm
2020 ¹	1,125 AFY	1.00 MGD	698 gpm
AVERAGE	1,125 AFY	1.00 MGD	698 gpm

Notes:

1. Well production data for 2014 and 2020 available only for January through September and January through July, respectively. Usage totals were averaged over available months and projected for the total year.

The District reports that there are currently 1,798 residential connections and 100 commercial connections which indicates that 95% of the District's connections are residential. No additional breakdown of this information was available.

It is assumed that the customer service type breakdown (residential vs commercial) has not changed significantly since the 2009 Water Master Plan, since the water system has been considered built-out for a long period of time. Historical demand and water customer data for the period of 2009 to April 2020 was not available to confirm this.

In comparing the only recent overlapping data of well production and commercial meter reading from April 2020 through July 2020, it is estimated that the residential water use of 768,816 gpd represented approximately 49% of all water delivered while commercial/industrial/institutional represented 51%. The largest single water use account was the cooling towers at AT&T.

The District remains largely unmetered. Commercial and multi-family residential connections are metered while single-family residential services remain unmetered. The commercial metered connections do not generally have separate irrigation meters installed making it difficult to quantify implementation of outdoor water use conservation policies. Currently, there are no plans to implement a meter installation program within the District.

3.4 Water Demand Criteria

The following provides a discussion of the hydraulic model, updated with available recent data, used to determine water peaking factors and water supply need. Demand criteria is based on water use within the District and within similar water agencies in Sacramento County.

Hydraulic Modeling. The hydraulic model used for this update was previously created for the 2009 WMP and subsequently updated and calibrated for the 2014 Surface Water Report. This model was further updated with current demand criteria and used to evaluate the system for compliance with water system standards and design criteria. The overall model findings in the Normal Operations evaluation, shown in Figure A-3, were confirmed with the District as generally matching with real world observations made by District operations. A detailed explanation of the hydraulic modeling evaluations and results is provided in Attachment A.

Average Day Demand (ADD). The 2021 Amendment updated the District's system demands based on available data. The District's Average Day Demand (ADD) estimates were provided in Table 3-2. The 2009 Water Master Plan, relying on historical groundwater production records from 1998 through 2007, reported an ADD of 1.50 MGD. The District's current ADD is estimated as the average of estimated water demands from 2014 through 2020. As shown in Table 3-2, the District's current ADD is estimated as 697 gpm (1.00 MGD). The reduction in ADD water demand, despite a slight increase in population, can be attributed to continuing water conservation efforts and public awareness for drought potential. As discussed in Section 3-2, the District's updated population is 4,600. Therefore, the estimated residential per capita water demand is 218 gpcd. This estimated water use per capita is primarily used to determine whether conservation measures are having an impact on water use practices.

Maximum Day Demand (MDD). MDD represents peak water use during summer months (June through August). Using the available well supply data (and previously noted 10% unaccounted for water losses), the estimated MDD is 1,396 gpm for the years 2014-2019.

Peak Hour Demand (PHD). PHD represents the peak hourly use hour during a maximum demand day. Hourly well production data was unavailable at the time of this analysis. The existing hydraulic model used for the 2009 Master Plan used a diurnal curve indicating a peak hour factor

of 1.8 times MDD. No additional information on hourly well production was available. Therefore, using the 1.8 times the estimated MDD of 1,396, the estimated PHD is 2,513 gpm.

Peaking Factors. Water peaking factors are necessary to predict fluctuations in water demands throughout the year. This allows the District to identify possible deficiencies during high use events. Considering the estimated ADD of 698 gpm and MDD of 1,172 gpm, the calculated MDD peaking factor is 1.7. To provide a conservative analysis, an MDD peaking factor of 2 times ADD is recommended and was used for the model evaluations. Table 3-3 summarizes the recommended updated peaking factors for this analysis and the associated demands.

Table 3-3: Summary of Water Demands and Peaking Factors

Demand Type	Peaking Factor	Demands
Annual Average Day (ADD)	1.0	1,125 AFY (698 gpm)
Maximum Day Demand (MDD)	2.0 x ADD	2,250 AFY (1,396 gpm)
Peak Hour Demand (PHD)	1.8 x MDD	4,052 AFY (2,513 gpm)

Fire Flow Requirements. The District remains in the Sacramento Metropolitan Fire Department (SFMD) service area. For residential customers, the hydraulic model considered a fire flow demand of 1,500 gpm for a 2-hour duration. SFMD requires a fire flow demand of 3,500 gpm for a 4-hour duration at two locations in the District. The 2009 MWP indicated that a review of existing SFMD records identified a 3,500 gpm fire demand for the AT&T facility and a March 23, 2021 email from Angela Hampton of SMFD indicated that the fire demand for WinCo Foods, based off square footage and Type VB construction, would be between 3,250 to 4,000 gpm for a 4-hour duration. A mid-point value of 3,500 gpm at this site was used for the current analysis. The largest commercial fire flow demands at the AT&T Telephone Service Call Center and WinCo Foods are served by hydrants H-11P and H-1P, respectively. The locations for these fire flow services are shown on Figure A7.

Non-residential, commercial, industrial and park demands represented approximately 50% of all water use during the 4 months of 2020 for which records were available. This represents a very small data set. Based on the data available, the AT&T center's cooling tower is typically the largest single commercial water user. In addition to the small data set in the summer of 2020, the four months of overlapping supply and use data provided also coincided with the beginning months of a historic pandemic period where stay-at-home orders were enforced in Sacramento County. Schools, restaurants, department stores, and other businesses deemed "non-essential" were shuttered and many residents of Sacramento County were sheltered at their residences. The lack of data prior to the pandemic impacts the usefulness of the data for an analysis to predict trends and forecast future needs.

3.5 Water Conservation

While the 2009 Master Plan was written just after a multi-year drought period, this 2021 Amendment is being prepared at the early stages of another drought period. California's water reservoirs are expected to reach record lows by the end of the summer 2021. Significant conservation measures are likely to be placed on larger districts along with restrictions on the use of their surface water sources. These measures will result in increased pumping from the area's groundwater aquifers including the one relied upon by the District. The increased groundwater

pumping, although not quantified in this report, may have significant impact to groundwater levels and water quality available to the District.

As the State of California continues to take a hard look at water use, sustainability and climate change and requires a more active approach in determining local water use patterns, the District is likely to be statutorily exempt from some requirements due to its small size but can expect increasing pressure to increase water conservation. Water conservation should continue to be a key element of managing the District's water supply.

3.6 Water System Standards and Design Criteria

The water system standards presented in this section are based on standard water distribution system operating criteria. Minimum pressure criteria were established in accordance with California Waterworks Standards Section 64602. System pressure in the distribution system must operate within the required minimum and maximum range. Maximum velocity criteria are required to minimize head loss in the distribution mains. Pressure, velocity, and additional water system design criteria is provided in Table 3-4.

Table 3-4: Water System Criteria

Pressure	Criteria
Average water system pressure	50 psi
Minimum water system pressure under PHD	40 psi
Minimum water system pressure under MDD	40 psi
Minimum residual pressure under MDD+FF with Largest Supply Out of Service	20 psi
Maximum water system pressure	80 psi
Velocity	Criteria
Maximum velocity under ADD	3 fps
Maximum velocity under MDD	5 fps
Maximum velocity under PHD	7 fps
Target velocity under MDD+FF	10 fps
Maximum velocity under MDD+FF	13 fps
Other Design Criteria	Criteria
Hazen-Williams Roughness Coefficient	100-150 ¹
Maximum fire hydrant spacing	500 feet
Minimum pipe diameter for looped system	8 inch
Pipe diameter for dead-end runs	6 inch

Notes:

1. The Hazen-Williams coefficients for existing pipe segments were adopted from the 2014 hydraulic model provided to HydroScience. Coefficients varied by pipe material, age, and condition. See Appendix A for further detail.

Section 4: Water Supply and Wells

This section provides updates to the evaluation of existing water supply, water supply deficiencies, and approaches to address those deficiencies. These planning elements were previously addressed by Sections 4 and 5 of the 2009 WMP.

4.1 Groundwater Supply

The District remains an active member of regional groundwater planning organizations and initiatives, including the Sacramento Groundwater Authority (SGA) and the Regional Water Authority (RWA). There are several documents published by these organizations since the 2009 Master Plan which can be found at the web locations below.

- SGA Water Accounting Framework Phase III Effort Final, 2010 (<https://www.sgah2o.org/wp-content/uploads/2016/06/WAF-PhaseIII-Final-9-28-10.pdf>)
- SGA Groundwater Management Plan, Sacramento County, North Basin, 2014 (https://www.sgah2o.org/wp-content/uploads/2016/06/GMP_SGA_2014_Final.pdf)
- SGA Basin Management Report – 2016 Update (<https://www.sgah2o.org/wp-content/uploads/2017/01/pub-bmreport-2015.pdf>)
- RWA Regional Water Reliability Plan – May 2019 (https://rwah2o.org/wp-content/uploads/2019/05/RWRP_May2019b.pdf)

These documents indicate that the North Basin is in recovery and water levels, although still low, are rebounding. Continued pumping by the District will not impact the status of the groundwater basin. There is a potential for perchloroethylene (PCE) contamination in the northwest corner of the District stemming from the migration of the known contamination plume from the area formerly known as McClellan Air Base. More information regarding this plume and its migration can be found in the documents listed above.

The District currently maintains eight (8) wells to supply the District's water distribution system. Since the 2009 Master Plan was published, Well Nos. 1 and 6 were abandoned and Well Nos. 6B and 9 were developed and equipped as replacements, respectively. Currently, Well No. 8 has been taken offline indefinitely due to exceedances of the maximum contaminant level (MCL) for tetrachloroethylene (PCE). Well No. 5, which is in the same general vicinity, is being monitored to ensure that it is not impacted by the PCE plume migration. Well 7 is operable, but the current District practice is to only operate this well during emergency conditions. Due to its configuration in a vault, it requires confined space access for maintenance and refilling of chemical supplies. However, it is available if needed to meet demands.

The State Water Resources Control Board (SWRCB) performed an inspection of the District system on December 4, 2019 and issued the following report: "*2019 Compliance Inspection of the Del Paso Manor County Water District Public Water System (PWS No. 3410007)*", State Water Resources Control Board, January 28, 2020 (2019 Inspection). According to this inspection report, the Well No. 3 status was changed from Active to Standby due to exceedances of the MCL for 1,2,3 Trichloropropane (TCP). Additional testing will be required in order to apply for a change in status back to Active.

Well production capacity as provided by the District and documented in the SWRCB 2019 Inspection are shown in the following Table 4-1. The locations of the District wells are shown in Figure 5. Additional details on recent well history and the SWRCB 2019 Inspection are provided in Section 5.

Per California Waterworks Standards (Title 22, Chapter 16), community water systems using only groundwater shall be capable of meeting MDD with the highest-capacity source off-line. Currently, the District's well system firm capacity (with Well 9 on standby) is 3,075 gpm, which is greater than the updated MDD of 1,396 gpm. Therefore, the District meets this waterworks standard.

Since the District does not have any storage tanks in their distribution system, the District's well system's firm capacity should also be capable of meeting MDD + FF demand or 4,896 gpm (based on fire flow of 3,500 gpm at AT&T Telephone Service Center and estimated fire flow requirement of 3,500 gpm at Winco Foods in Country Club Plaza). Based on this best practice, the District has a well pumping deficit of 1,821 gpm. To meet this MDD+FF condition, new source(s) and/or improvement to existing sources may be needed.

The District currently has a Mutual Aid Agreement with Sacramento Suburban Water District, however, due to the time involved in making a request for emergency use, receiving an approval, and engaging the interties, it is not recommended that the interties be relied upon to regularly provide Firm Capacity or to meet Fire Flow demands.

Table 4-1: Groundwater Supply and Active Pumping Capacity

Well No	Year Built	Age In Years	Active Pumping Capacity	Well Status / Comments
2	1948	72	375 gpm	Video inspection scheduled for 2021
3	1949	71	--	Permitted Use is Standby, 1,2,3 TCP MCL Exceeded
4	1951	69	475 gpm	Video inspection scheduled for 2021
5	1955	67	450 gpm	
6B	2014	6	1,100 gpm	Primary well with standby generator, Used during low winter demands (down to 100 gpm)
7	1956	64	675 gpm ¹	District minimizes operation of this well. See Note 1.
8	1977	43	--	PCE detected. Well Offline. Expected complete loss
9	2011	9	1,500 gpm	Primary well, New Generator scheduled for 2021 installation
Total Capacity			4,575 gpm	PHD=2,513 gpm
Firm Capacity			3,075 gpm	MDD = 1,396 gpm, MDD+FF=4,896 gpm

Notes:

- Well 7 is available and would be operated by the District during a MDD+FF condition with the largest well (Well 9) out of service. However, the configuration of Well 7 in a vault requires confined space entry for local maintenance and replenishment of chemical supplies. Therefore, the District keeps this well on standby under normal operating conditions.

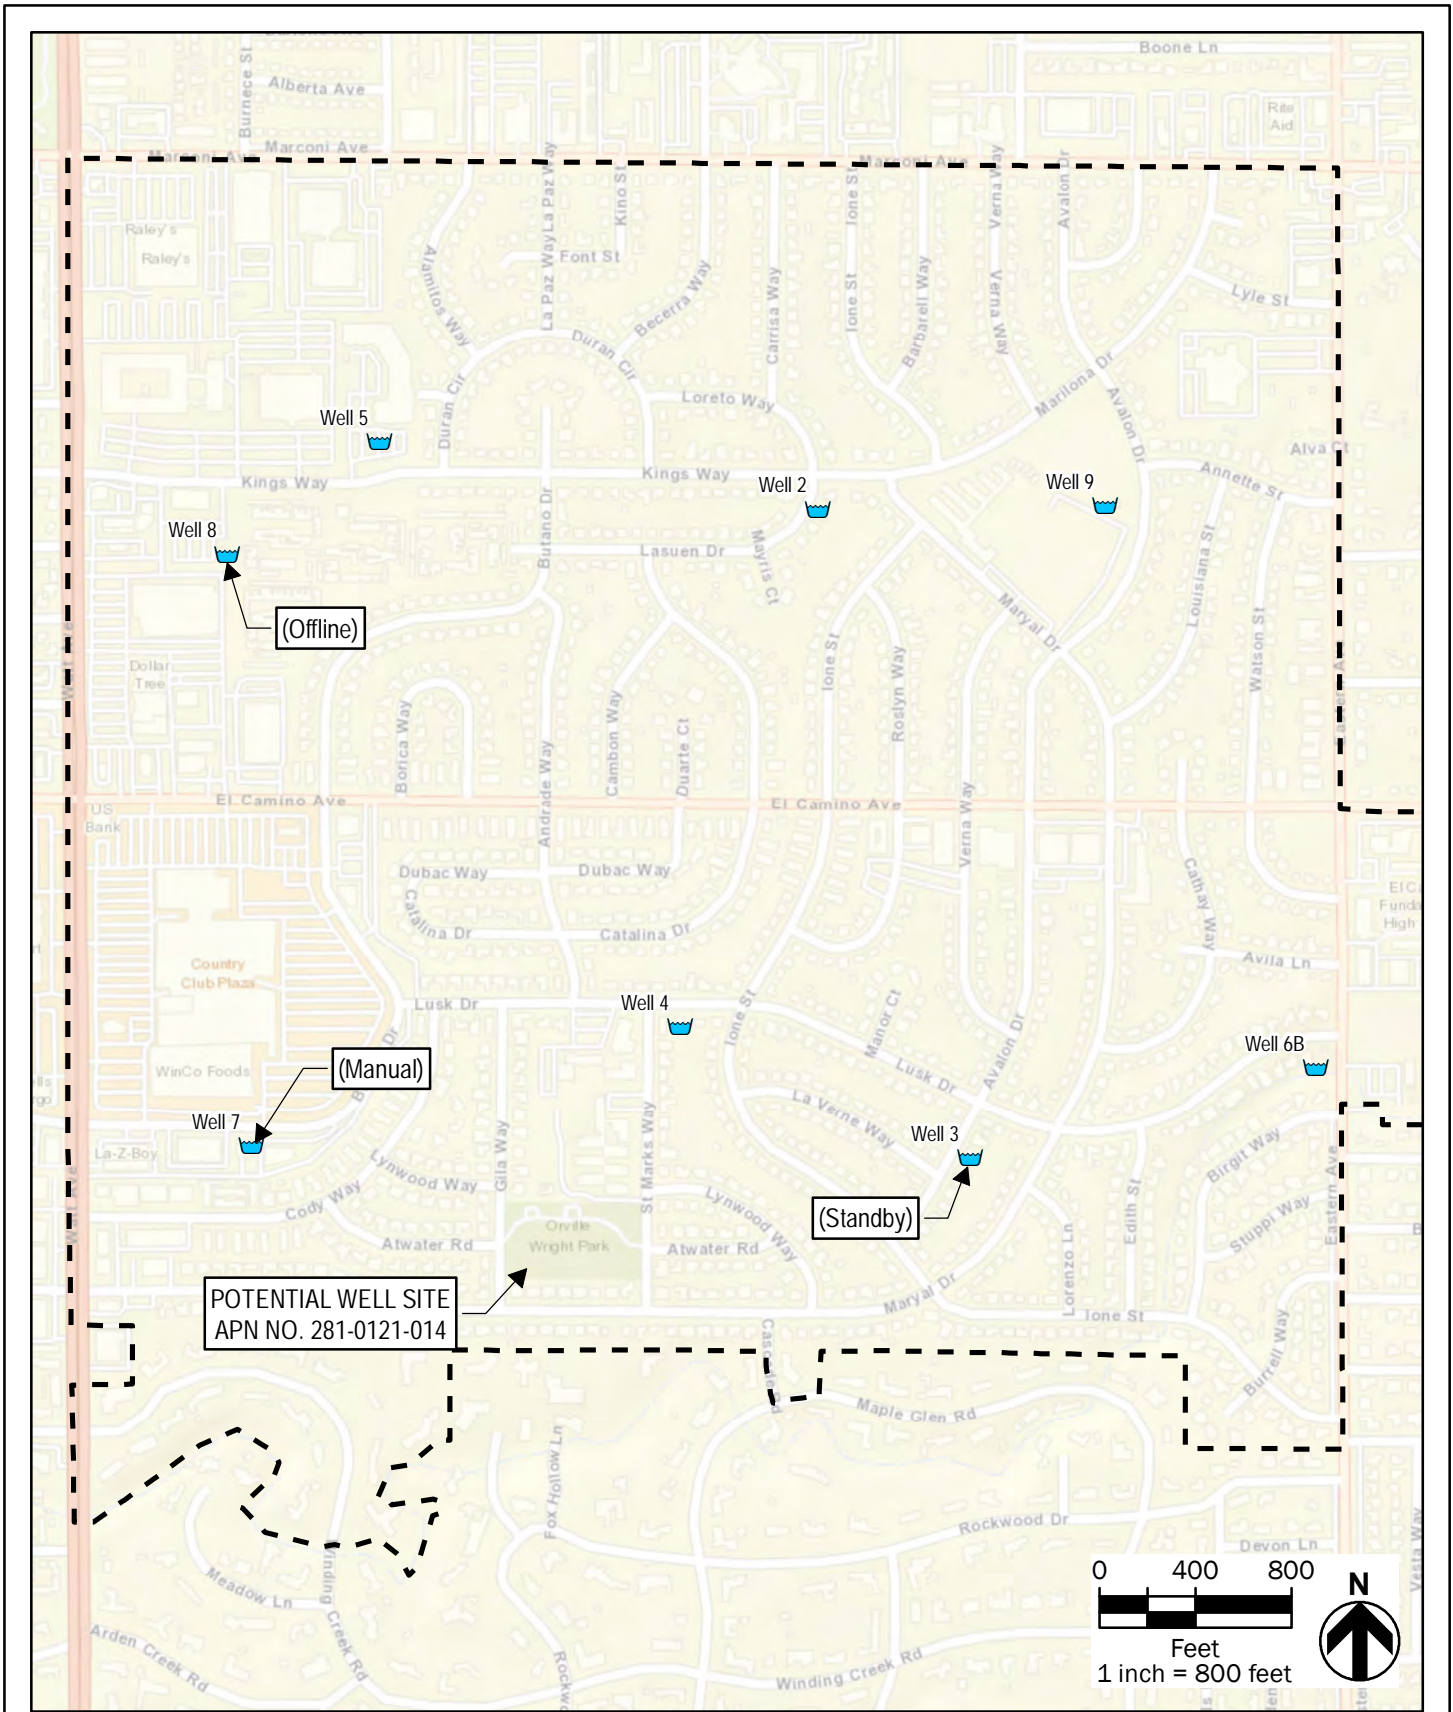


FIGURE 5
 DEL PASO MANOR WATER DISTRICT
 WATER MASTER PLAN UPDATE
 DISTRICT WELL LOCATIONS

4.2 Surface Water Supply

In 2008, the District completed a Conjunctive Use Plan to evaluate alternatives for developing a surface water use program and participating in groundwater wheeling with neighboring districts to bring more surface water into the District and to offset groundwater pumping during wet years.

The District continues to have a 1968 agreement with the City of Sacramento that establishes conditions for transfer of up to 6.8 cubic feet per second or 2,460 acre-feet annually to the District through the City's Area D water service area.

The District also has a current Mutual Aid and Assistance Agreement with Sacramento Suburban Water District (SSWD Mutual Aid Agreement), dated January 11, 2011, which remains in effect until terminated by one party after providing a written notice of termination. This agreement allows the transfer of water in the event of an emergency and assistance of support staff on a regular and ongoing basis. The District has three interties with SSWD for emergency water transfer. Each intertie is outfitted with manually operated valves. Outfitting the interties with automated valves or motor operated valves connected through SCADA would allow the interties to automatically open in emergency situations where pressure in the vicinity of the intertie drops below the setpoint of 30 psi. Prior to any decision regarding the installation of automated or motor operated valves, it is recommended the District investigate whether the action would subsequently require the installation of residential water meters and the need to revise the agreement.

Based on information provided for this update, no progress has been made in taking the next step.

Section 5: Facilities Replacement Planning and Implementation

This section provides selected updates to the assessment of existing facilities, planning for replacement and augmentation of facilities, a focused near term (0-5 years) prioritized CIP for the proposed projects, and recommendation for future studies, projects, and other actions. These planning elements were previously addressed by Sections 6 and 9 of the 2009 WMP.

5.1 Water Main and Hydrant Existing Condition and Capacities

The pipe network is a looped system of mostly small diameter (2-inch to 12-inch) transite, PVC, steel, and ductile iron pipe located mostly in backyards. As noted elsewhere in this TM, the District's system is more than 75 years old and, as indicated in the SWRCB 2019 Inspection Report, the distribution system is "suffering from age and wear and may be in need of increased maintenance". When compared to two other water systems in 2018 (located in close proximity to the District), the District was found to have experienced nine times the number of leaks and breaks as the other systems. An annual program of main replacement will be necessary for the District to maintain system reliability in the future.

The system includes approximately 3,000 linear feet of 3-inch or less pipe in the system at 39 locations, which do not meet the minimum water main diameter (4-inches) requirements specified in Title 22 of the California Code of Regulations (CCR). A significant portion of these non-compliant mains are small dead-end extensions located in cul-de-sacs and at the edge of the District's boundary.

The District utilizes a single pressure zone with the distribution system pressure maintained by hydropneumatic tanks at well sites throughout the system. Pressure is operationally maintained at 46 psi to 56 psi via well sources triggered by pressure switches at the pressure tanks.

The hydraulic model was used to evaluate the sufficiency of the water system to meet defined criteria (MDD, FF) under certain constraints (flow, pressure and velocity). The model shows that the system is capable of meeting MDD with the largest source removed, however low pressures are experienced (less than 40 psi) in the northeast quadrant of the District as indicated in Figure A4 of Attachment A. Additionally, evaluation of the model for MDD+FF with the largest source removed identified a number of fire hydrant flow deficiencies as indicated in Figure A6 of Attachment A.

The District maintains a network of fire hydrants connected to the system. California Fire Code Section C102 (Table C102.1) requires that fire hydrants be spaced an average of 500 feet apart in residential water distribution systems. Due to the District being mainly comprised of "backyard mains" rather than pipelines within street rights-of-way, this average spacing has not been accomplished. The system map was studied to determine locations where hydrant spacing maximums are not currently met and identify locations where:

- a fire hydrant can be served from a minimum 8-inch pipeline or at the intersection of three or more 6-inch pipelines, and
- is able to be placed within the public right-of-way.

Fifteen (15) locations were identified where the noted criteria is met for providing fire hydrant infill to the system.

Descriptions of the projects associated with correcting the noted deficiencies are provided in Section 5.3 below. Total costs associated with these projects are provided Table 5-1 and breakdown cost estimates are provided in Attachment B.

5.2 Existing Well Ages and Condition

This subsection provides available updated information about existing condition and operating status of each of the wells since the 2009 WMP.

The SWRCB 2019 Inspection Report documented a series of planned projects that the District had indicated would be implemented as near-term projects:

- Well 2 - Pulling the pump and TV examination of well casing was to be scheduled for Jan 2020. Had positive coliform tests last 2 quarters of 2019.
- Well 3 - Chemical feed system was to be repaired in December 2019.
- Well 5 - Well was scheduled for video inspection in 2018/2019 but was postponed .
- Well 7 - Necessary corrections were identified during inspection and new SCADA and PLC were in design at the time of the report and expected to be completed in Spring of 2020.
- Well 8 - Install rebuilt right angle drive for service during power outages.
- 2018 rate increase included budgets for inspections of Well 4 and 9 in 2020/2021, site paving and tank inspections in 2021/2022, and inspection of Well 6B in 2022/2023.

Of the projects listed above, the Well 2 well casing inspection project has not been completed. The Well 3 chemical feed system repairs were completed, but this well was placed in standby permit status due to contamination issues (see below).

The inspection report also noted the recent removal and replacement of 205-feet of 4-inch Transite with 6-inch ductile iron pipe (DIP).

The District provided for this update the following current status of each of the existing wells:

- Well No. 1 – Well has been abandoned, all facilities pulled and backfilled.
- Well No. 2 – Video inspection postponed until after the 2021 summer demands.
- Well No. 3 – Currently offline and on standby due to test samples showing trichloropropane (1,2,3, TCP) contaminant.
- Well No. 4 – Currently video inspection postponed until after the 2021 summer demands.
- Well No. 5 – No reported changes.
- Well No. 6 and 6B – Well No. 6 was replaced by Well No. 6B. The Well No. 6B generator transfer switch failed during power outage in 2020 and has since been repaired.
- Well No. 7 – Replacement needed.

- Well No. 8 – SWRCB 2019 Permit and Inspection Report indicated PCE was detected and had failed bacteriological testing. The well was switched to quarterly monitoring; however, due to continued presence of PCE this well has subsequently been removed from service indefinitely.
- Well No. 9 – This is a new well installed since the 2009 Master Plan. The SWRQCB 2019 Permit and Inspection Report set the design capacity at 1,500 gpm.

The resulting capacity and system redundancy based on these changes was previously summarized in Table 4-1.

5.3 Water Main, Hydrant, and Well Improvements

As a long-term goal, HydroScience recommends that the District plan to implement the distribution (water main) improvement system goals established in the 2009 WMP to extent feasible, which is to replace older failing backyard mains with upsized and well-looped 6-inch or greater diameter pipeline network. For near-term distribution piping improvements, this 2021 Amendment focuses on identifying high-priority improvements that address the following specific deficiencies:

- Pipe upgrades to address pressure, velocity, and flow deficiencies under normal operations and the design maximum condition of MDD+FF with the largest well source out of service.
- Hydrant upgrades to meet required fire flow demand and regulatory spacing requirements.

Coupled with the need to address distribution pipe network deficiencies is the need to provide sufficient well supply to meet MDD+FF with the largest well out of service. As documented in Section 4.1 and Table 4-1, there is currently a supply deficiency in meeting this condition, with the capacity shortfall estimated at 1,821 gpm. The near-term recommended CIP project to address this well pumping deficiency is to install one or two new groundwater wells in a non-contaminated area to supply the system with this additional flow.

Attachment A details the modeling run that was performed to test addition of a new 1,821 gpm well source to the system. The selected well site location for this model run was at Orville Wright Park.

Alternatives to installation of a single new well source at Orville Wright Park that should be evaluated before implementation of a water supply improvement project include:

- Utilization of SSWD interties to provide supplemental flow addressing some or all of the shortfall. This would require updating the current agreement with SSWD to allow for regular service of the connection in order to count it towards the firm capacity and addressing any needs to meter or fluoridate if applicable.
- Construction of two or more smaller wells to provide equal or greater additional flow. More than one well is preferred to avoid establishing a larger maximum sized well than the existing maximum sized well (currently Well 9 at 1,500 gpm) that would need to be assumed to be offline during a MDD+FF event for the purpose of redundancy analysis.
- Determine optimal site(s) for installation of new well(s) and address land acquisition costs in the final cost estimates.

- Construct one new well and perform rehabilitation/improvements to one or more existing wells to provide a total increase to source capacity of at least 1,821 gpm. This alternative should be based on condition assessment results that show the existing well is in suitable condition for rehabilitation. Available condition assessment information was not available to sufficiently evaluate this alternative. Reborings existing well(s) to increase capacity can also be evaluated.
- Construction of a storage tank and booster pump station sized to meet a maximum fire flow demand of 3,500 gpm for a 4-hour duration at the two locations (AT&T and WinCo Foods) where this higher fire flow is required. This alternative would be in lieu of sizing the well supply and upgrading pipelines to meet this fire flow requirement.

For simplicity, this 2021 Amendment establishes the construction of a single new 1,821 gpm well in the CIP as a placeholder for any of these improvement options. A future study should further evaluate these options in consideration of District goals and priorities and select a best-value option for implementation. An engineering budget cost range is included in the CIP to conduct this evaluation.

The SWRCB Inspection Report and District documentation indicated a number of condition issues that should be addressed either as ongoing maintenance projects or as part of a comprehensive well rehabilitation or replacement project. The more significant items include:

- Well 5 – Inspect and repair casing hole.
- Wells 3 and 5 – Increase pedestal height to at least 18-inches to reduce the risk of contamination.

Other near-term priority pipe network and fire hydrant improvements to address water system standards and design criteria (see Section 3.6) resulting from updated hydraulic model runs (see Attachment A) are summarized below:

- Install New Fire Hydrant on 12" Main at AT&T: Location 1 in Figure 6 below is situated in the north-western portion of the District at the AT&T Call Center where the required fire flow of 3,500 gpm cannot be supplied. This location includes the installation of one fire hydrant serviced from the 12-inch main located near the existing fire hydrant H-11P which will increase the available fire flow from 1,229 gpm to 2,125 gpm.
- Pipe Replacement Projects: The District model was evaluated for Maximum Day Demand plus a 1,500 gpm Fire Flow for 2 hours. The results of that evaluation can be found in Attachment A, Figure A5. The hydrants found to be deficient are shown in red with the available fire flow in gallons per minute provided under the hydrant label. The System Upgrades Project, shown in Figure 6, contains the new hydrant described above at Location 1 and nine (9) other discreet locations where minor system improvements will result in all hydrants being capable of meeting the 1,500 gpm fire flow demand and the high fire flow of 3,500 gpm at hydrants, H-11P (AT&T) and H-1P (WinCo Foods).
- Generator at Well 9: Install a generator at the well site with automatic transfer switch to provide backup power during a utility outage. This project would need to be coordinated with the adjacent school.
- Install 15 Additional Fire Hydrants: Install new fire hydrants to resolve the spacing issue previously discussed.

- Install 8" PRV Station: Installation of two automated PRV valves set to open the SSWD interconnections if the pressure in the District drops below the setpoint. The District should first evaluate potential impacts to residential metering and fluoridation requirements, as stated herein, prior to implementing this project.

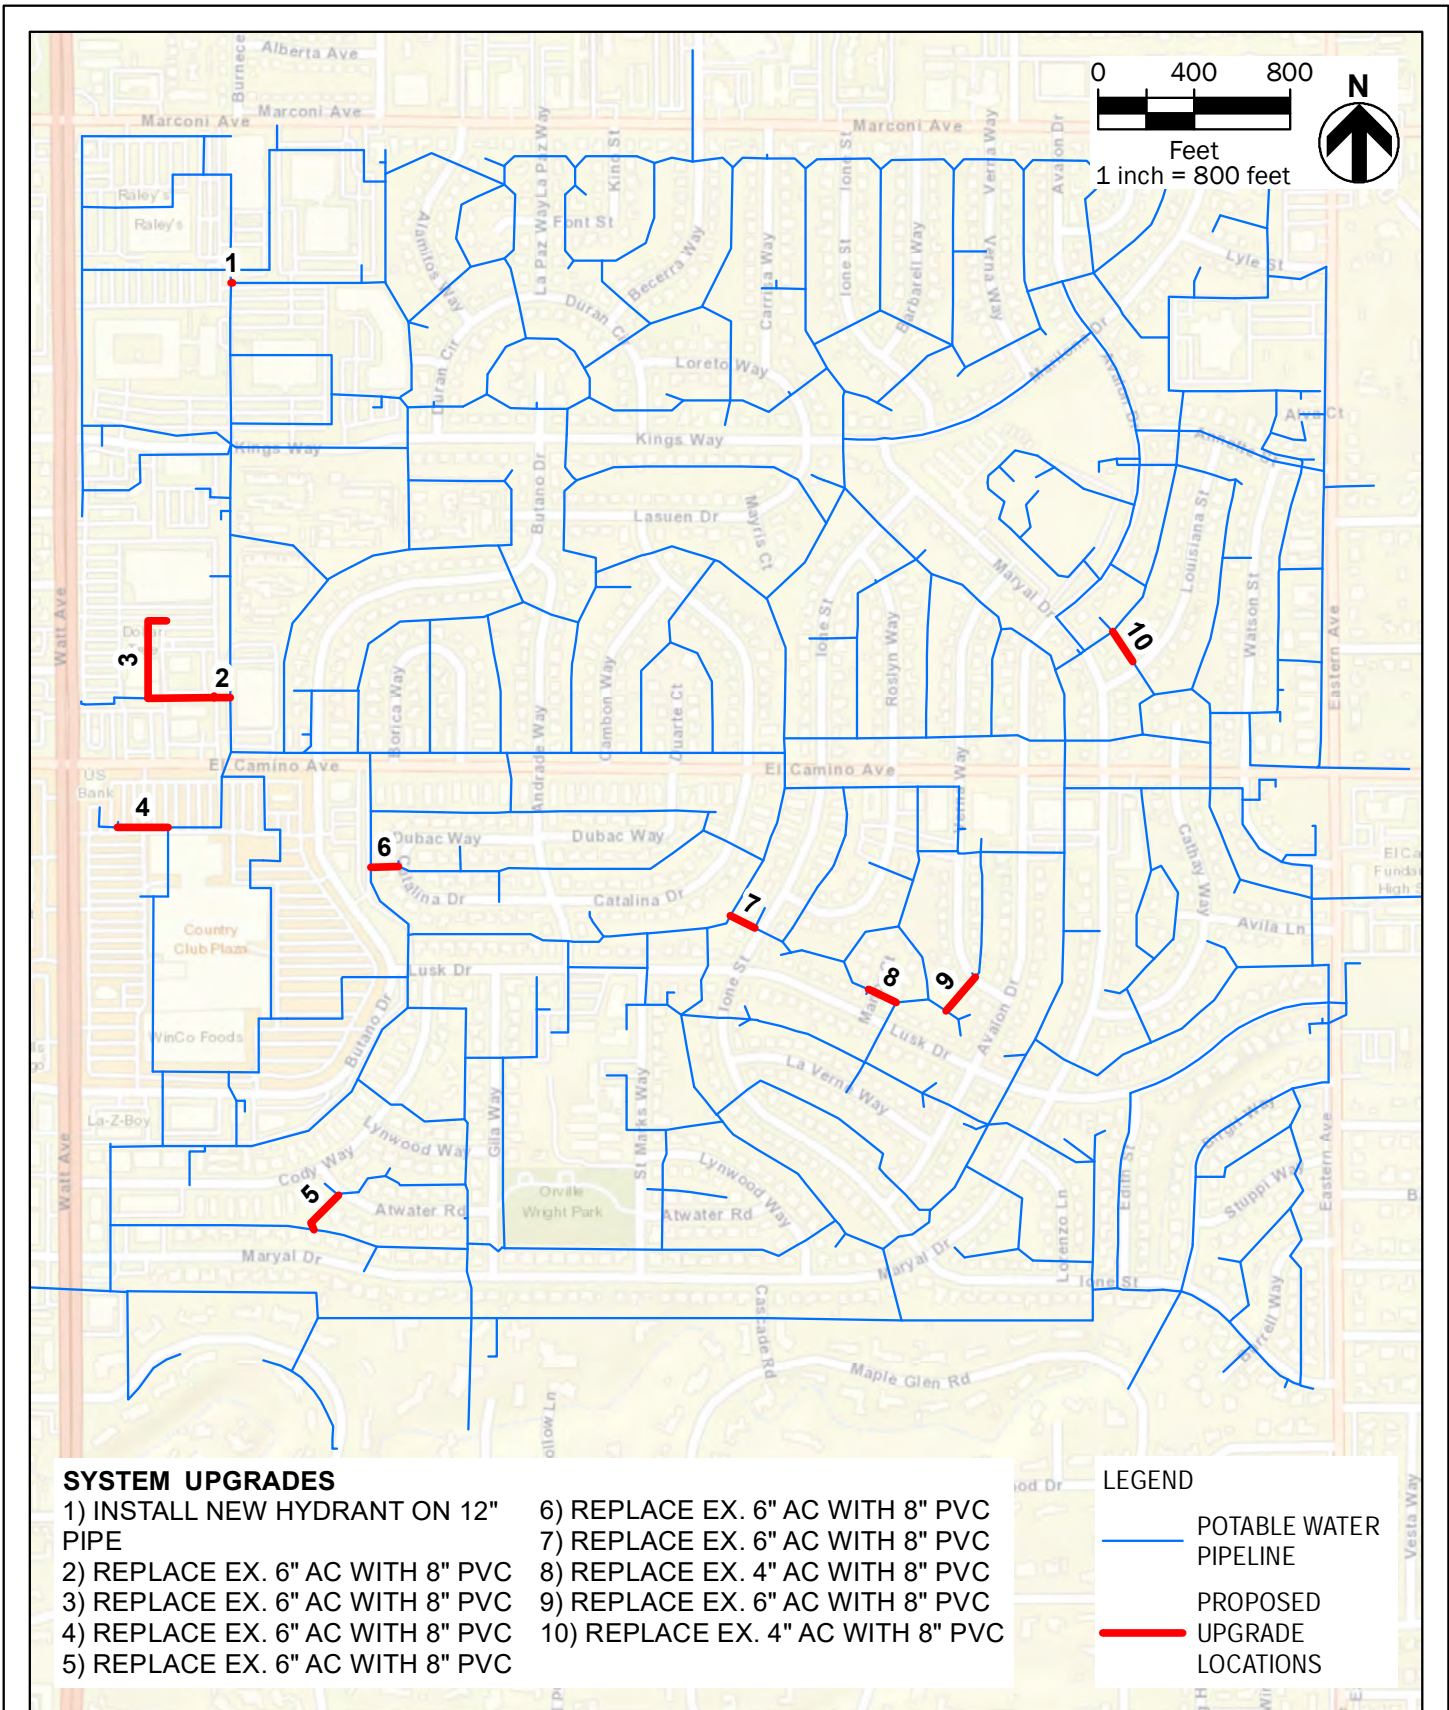


FIGURE 6
DEL PASO MANOR WATER DISTRICT
WATER MASTER PLAN UPDATE
SYSTEM UPGRADE LOCATIONS

5.4 Capital Improvement Recommendations

Near-term prioritized CIP projects to address immediate and critical deficiencies is addressed in this subsection. Refer to the 2009 WMP for longer-term recommendations related to replacing Transite pipe, relocating mains from backyards to streets, rehabilitating or replacing existing wells that are beyond their remaining useful lives, and implementing alternative supplies. The recommendations presented herein, coupled with the recommendations in the 2009 WMP, are made in consideration of the District's established policy of performing capital improvement projects as funding allows with a focus on hydraulically critical regions first and condition/age second.

Descriptions of the planned capital improvement projects are given in Table 5-1 below, with priorities. A detailed cost estimate for each project is provided in Attachment B.

Table 5-1: Near Term CIP Summary

Project Priority	Description	Need Addressed	Estimated Planning-Level Implementation Cost ¹
1	Install New Fire Hydrant on 12" Main	High fire flow at AT&T	\$16,000
2	Pipe Replacement Projects 2-10 (see Note 2)	Hydrant flow deficiency	\$580,000
3	Install New Water Supply Well(s) Totaling 1,800 gpm Additional Flow (See Note 3)	MDD+FF deficiency, improve system pressures, improve supply reliability	\$3,100,000
	Engineering Evaluation of New Supply Options	Select most cost-effective and feasible approach to augment supply.	\$50,000 – \$75,000
4	Install 260kW, 480VAC NG outdoor genset at Well 9 with sound enclosure; replace MTS with ATS (See Note 4)	Provide redundancy and reliability to the system	\$450,000
5	Install 15 Additional Fire Hydrants	Improve compliance with 500 ft max hydrant spacing	\$240,000
NP ⁵	Install 8" PRV Station and Intertie to SSWD, 3 Locations (see Note 6)	Connect supplemental water source for pressure support	\$320,000

Notes:

1. Rounded to two significant figures.
2. Pipe replacement projects can also be implemented individually or in smaller groups. Refer to prioritization in Attachment B, Cost Detail, for recommended order of implementation. Order is set based on level of existing fire flow deficiency addressed by the corresponding upgrade.
3. New well project is a placeholder for a well or other alternative to increase capacity and/or provide storage for fire flow. Alternatives include: alternate well locations, greater number of smaller new wells, rehabilitation/reboring of existing wells, and utilization of interties. Project cost will change depending on the type of project chosen. Cost of land acquisition is not included. The District should first evaluate potential impacts to residential metering and fluoridation requirements, as stated herein, prior to implementing this project. A budgetary amount for an engineering study to evaluate and select the preferred alternative is presented.
4. Genset cost excludes the cost of bringing natural gas onsite. If there is a natural gas pipeline in the street near the water main, the approximate added cost is \$10,000 for the natural gas service extension). Installation of genset at this location will require coordination with adjacent school.
5. NP=Not Prioritized.
6. The District should first evaluate potential impacts to residential metering and fluoridation requirements and need to update the existing agreement, as stated herein, prior to implementing this project.

5.5 *Other Recommendations*

The following are some additional near-term recommendations to improve District's operations and business strategies, which would ensure continued sustainability.

- **Record Keeping.** Since the District residential areas are built-out, the commercial properties have greatest potential impacts to the District's water demands and operations. Commercial properties are also currently metered. Therefore, the District's new accounting system may be improved, if not currently available, to maintain electronic records of water consumption from existing meters. This electronic record-keeping process will provide improved water use information for future evaluations and subsequent master planning efforts.
- **Conjunctive Use Plan.** The 2009 WMP included a significant analysis of developing water for implementation of a Conjunctive Use Plan. The 2021 Amendment did not include a comprehensive review of the current potential for implementing a conjunctive use plan. District staff discussed the following potential for future conjunctive use evaluations:
 - If surface water use is considered beyond emergency use, we recommended the District investigate whether this operational change may require the installation of residential water meters or the fluoridation of the water system.
 - Due to changes in regional surface water strategies, continue vetting opportunities to participate in conjunctive use arrangements.
- **Regional Planning.** Maintain active participation in SGA and RWA.

ATTACHMENT A
Hydraulic Model Update

Attachment A: Hydraulic Modeling

The existing District potable water model was updated with changes since the 2009 Master Plan to determine system capacity under peak demand conditions and identify deficiencies. The service area was modeled as a single pressure zone and system.

Provided below is a discussion of the hydraulic model updates and analysis performed.

A.1 Model Development

The District potable water model was initially developed in 2014 using Bentley OpenFlows WaterGEMS software. Baseline water demands for existing conditions were estimated based on the water demand analysis presented in the previous section and updated in the model.

The Hazen-Williams coefficients were adopted from the 2014 hydraulic model. Table A-1 shows the pipe roughness coefficients for each pipe material. Certain pipe materials utilized different roughness coefficients. This is generally due to difference in age or pipe condition.

Table A-1: Hazen-Williams Roughness Coefficients

Pipe Material	Hazen-Williams Coefficient						
	100	110	115	120	130	140	150
Asbestos Cement	X	X	X	X	X		
Ductile Iron				X	X		
PVC						X	X
Steel	X						

Development and analysis of the hydraulic model was based on the data received and the resulting data allocation. Data used for the development of the existing condition hydraulic model were as follows:

- Well 9 Yard Pipe Calcs (.xls)
- Well 9 Flow Calculations (.xls)
- DPM Well 9 Record Set (.pdf)
- Del Paso Manor Water District Master Plan 2009 (.pdf)
- City of Sacramento – Fire Sprinkler Systems Requirements (.pdf)
- Meter Read Consumption (.pdf)
- Western States Fire Protection Co. Fire Flow Test Results (.pdf)
- Hydraulic Modeling Workshop_v51 FINAL (.pdf)
- Distribution System As-Builts (.pdf)
- Fire Flow Analysis Summary – DISTRICT MP KJ (.pdf)

-
- DISTRICT Surface Water Utilization Road Map (.pdf)
 - LEAK LOG – MASTER (.xlsx)
 - Response to District Water Model and Fire Flow Analysis – DISTRICT MP KJ (.pdf)
 - State Water Resources Control Board – DISTRICT 2019 Inspection Report (.pdf)
 - Well Production (2019-2020) (.xlsx)
 - Well Production 2014 to current (.xlsx)
 - Well pumping capacity 2019 (.docx)

A.2 Modeling Scenarios

The District service area was analyzed for existing conditions using the data provided. The scenarios analyzed are discussed below:

- **Maximum Day Demand (MDD) – Normal Operations:** This analysis identifies deficiencies in the system simulating maximum day demands under normal system supply operations.
- **Maximum Day Demand (MDD) – Largest Source Removed:** This analysis identifies deficiencies in the system simulating maximum day demands with the largest supply source (Well 9) removed.
- **Maximum Day Demand + Fire Flow (MDD+FF) – Normal Operations:** This analysis identifies deficiencies within the system when simulating maximum day demands under normal operations and a related fire flow event concurrently. Fire flow is simulated at existing hydrants in the system and fire flow rates are determined by the most conservative land use type at the respective hydrant.
- **Maximum Day Demand + Fire Flow (MDD+FF) – Largest Source Removed:** This analysis identifies deficiencies within the system simulating maximum day demands and a concurrent fire flow event with the largest supply source (Well 9) removed.
- **Maximum Day Demand + Fire Flow (MDD+FF) – Largest Source Removed – With System Upgrades and New Well #10:** This analysis tests whether fire flow at hydrants is met simulating maximum day demands and a related fire flow event occurring concurrently with the largest supply source (Well 9) removed and after the addition of new Well #10 and implementation of recommended pipe improvements.

A.3 Hydraulic Modeling Results

The entire District service area was modeled and evaluated based on the flow, velocity and pressure performance criteria limits presented in Table 3-4. The results are discussed below.

System-wide Conditions with Normal Operations

MDD: The system was modeled with normal operations under a maximum day demand scenario and analyzed as a 24-hour extended period simulation. This type of simulation allows for the analysis of the peak hour demand while also observing system operations throughout a simulated maximum day. The system was able to stay below the maximum velocity criteria. During the peak

hour (05:00 AM) some pressures in the system fall below the minimum pressure threshold of 40 psi. Pressure ranges for this deficiency is approximately 38 – 51 psi (see **Figure A3**).

MDD+FF: The system was modeled with normal operations under a maximum day demand plus fire flow scenario. This type of simulation is a 2-hour period providing an iterative analysis at each hydrant while systematically increasing the fire flows. Fire hydrant flows are reported as the maximum flow recorded prior to any of the constraints of pressure (>20 psi) or velocity (<13 fps) being exceeded. During MDD+FF conditions, the system exhibited fire hydrant flow deficiencies. Eleven of thirty-three hydrants did not meet required fire flow demand (3,500 gpm at H-11P and 1,500 gpm all others) while staying within the established criteria (see **Figure A5**). Nine of the eleven violations are due to velocity restrictions in the adjacent pipelines.

System-wide Conditions with Largest Source Removed

MDD: The system was modeled with the largest supply source (Well/Pump 9) removed. The system was able to meet the maximum velocity criteria. During the peak hour (05:00 AM), some pressures in the system fall below the minimum pressure threshold of 40 psi. Pressures throughout the system were approximately 4 psi lower than with MDD under normal operations simulation. Pressure ranges for this deficiency is approximately 34 – 48 psi (see **Figure A4**).

MDD+FF: The system was modeled with the largest supply source (Well/Pump 9) removed under a maximum day demand plus fire flow scenario. This type of simulation is a 2-hour period providing an iterative analysis at each hydrant while systematically increasing the fire flows. Fire hydrant flows are reported as the maximum flow recorded prior to any of the constraints of pressure (>20 psi) or velocity (<13 fps) being exceeded. During MDD+FF conditions, the system exhibited fire hydrant flow deficiencies results similar to those with normal operations. Ten of thirty-three hydrants did not meet fire flow demand (3,500 gpm at H-11P and 1,500 gpm all others) while staying within the established criteria (see **Figure A6**). There is one hydrant, J453, that did not satisfy fire flow demand with normal operations but improved with Pump 9 off. Hydrant J453 experienced velocity violations with normal operations that were not violated when Pump 9 was removed.

MDD+FF – With System Upgrades and New Well #10: The system was modeled during MDD+FF conditions with the largest supply source removed and following system upgrades and the addition of a new Well #10 (rated for 1,800 gpm). The results indicate that all hydrants including the new hydrant at AT&T satisfy all fire flow conditions (see **Figure A7**).

A.4 Summary of Results

Table A-2 provides a summary of the results of the hydraulic analyses. Results shown are based on the results as they relate to the performance criteria limits provided in Table 3-4.

Table A-2: Hydraulic Analysis Results

Performance Criteria		Meets Criteria?	
		Current Conditions	After CIP Implementation
Pressure			
Minimum water system pressure under PHD	40 psi	No	No ¹
Minimum water system pressure under MDD	40 psi	No	No ¹
Minimum residual pressure under MDD+FF with Largest Supply Out of Service	20 psi	No	Yes
Maximum water system pressure	80 psi	Yes	Yes
Velocity			
Maximum velocity under MDD	5 fps	Yes	Yes
Maximum velocity under PHD	7 fps	Yes	Yes
Maximum velocity under MDD+FF	13 fps	No	Yes
Other Design Criteria			
Hazen-Williams Roughness Coefficient	100-150 ⁴	N/A	N/A
Maximum fire hydrant spacing	500 feet	No	No ²
Minimum pipe diameter for looped system	8 inch	No	No ³
Pipe diameter for dead-end runs	6 inch	No	Yes

Notes:

1. The system continues to experience low pressure in the northwest corner of the service area. Proposed new well improves the number of services experiencing low pressure but does not completely eliminate them.
2. The proposed CIP, which includes addition of 15 new fire hydrants, will not create a complete system of hydrants at maximum 500-foot spacing, but it will improve conformance to this requirement and reduce the areas currently not serviced by a hydrant.
3. The proposed CIP includes piping improvements that will meet the requirement for dead-end runs of pipe to be 6-inches or greater. However, it does not address the requirement for looped pipes to be 8-inches or greater.
4. The Hazen-Williams coefficients for existing pipe segments were adopted from the 2014 hydraulic model provided to HydroScience. Coefficients varied by pipe material, age, and condition. See Table A-1 for further detail.

A.5 Detailed Modeling Results

Figures depicting model results output and model output tables follow.

ATTACHMENT A:

DEL PASO MANOR WATER DISTRICT – WATER DISTRIBUTION SYSTEM MODELING RESULTS

<u>FIGURES</u>	<u>PAGE</u>
• FIGURE A1 – MODEL JUNCTION LABELS	1
• FIGURE A2 – MODEL PIPE LABELS	2
• FIGURE A3 – MAX DAY DEMAND RESULTS – NORMAL OPERATIONS	3
• FIGURE A4 – MAX DAY DEMAND RESULTS – WELL 9 OFF	4
• FIGURE A5 – MAX DAY DEMAND PLUS FIRE FLOW – NORMAL OPERATIONS	5
• FIGURE A6 – MAX DAY DEMAND PLUS FIRE FLOW – WELL 9 OFF	6
• FIGURE A7 – MAX DAY DEMAND PLUS FIRE FLOW – WELL 9 OFF WITH SYSTEM UPGRADES	7

<u>TABLES</u>	
• TABLE 1 – MAX DAY DEMAND RESULTS – NORMAL OPERATIONS	8-29
• TABLE 2 – MAX DAY DEMAND RESULTS – WELL 9 OFF	30-53
• TABLE 3 – MAX DEMAND PLUS FIRE FLOW – NORMAL OPERATIONS	54
• TABLE 4 – MAX DAY DEMAND PLUS FIRE FLOW – WELL 9 OFF	55
• TABLE 5 – MAX DAY DEMAND PLUS FIRE FLOW – WELL 9 OFF WITH SYSTEM UPGRADES	56

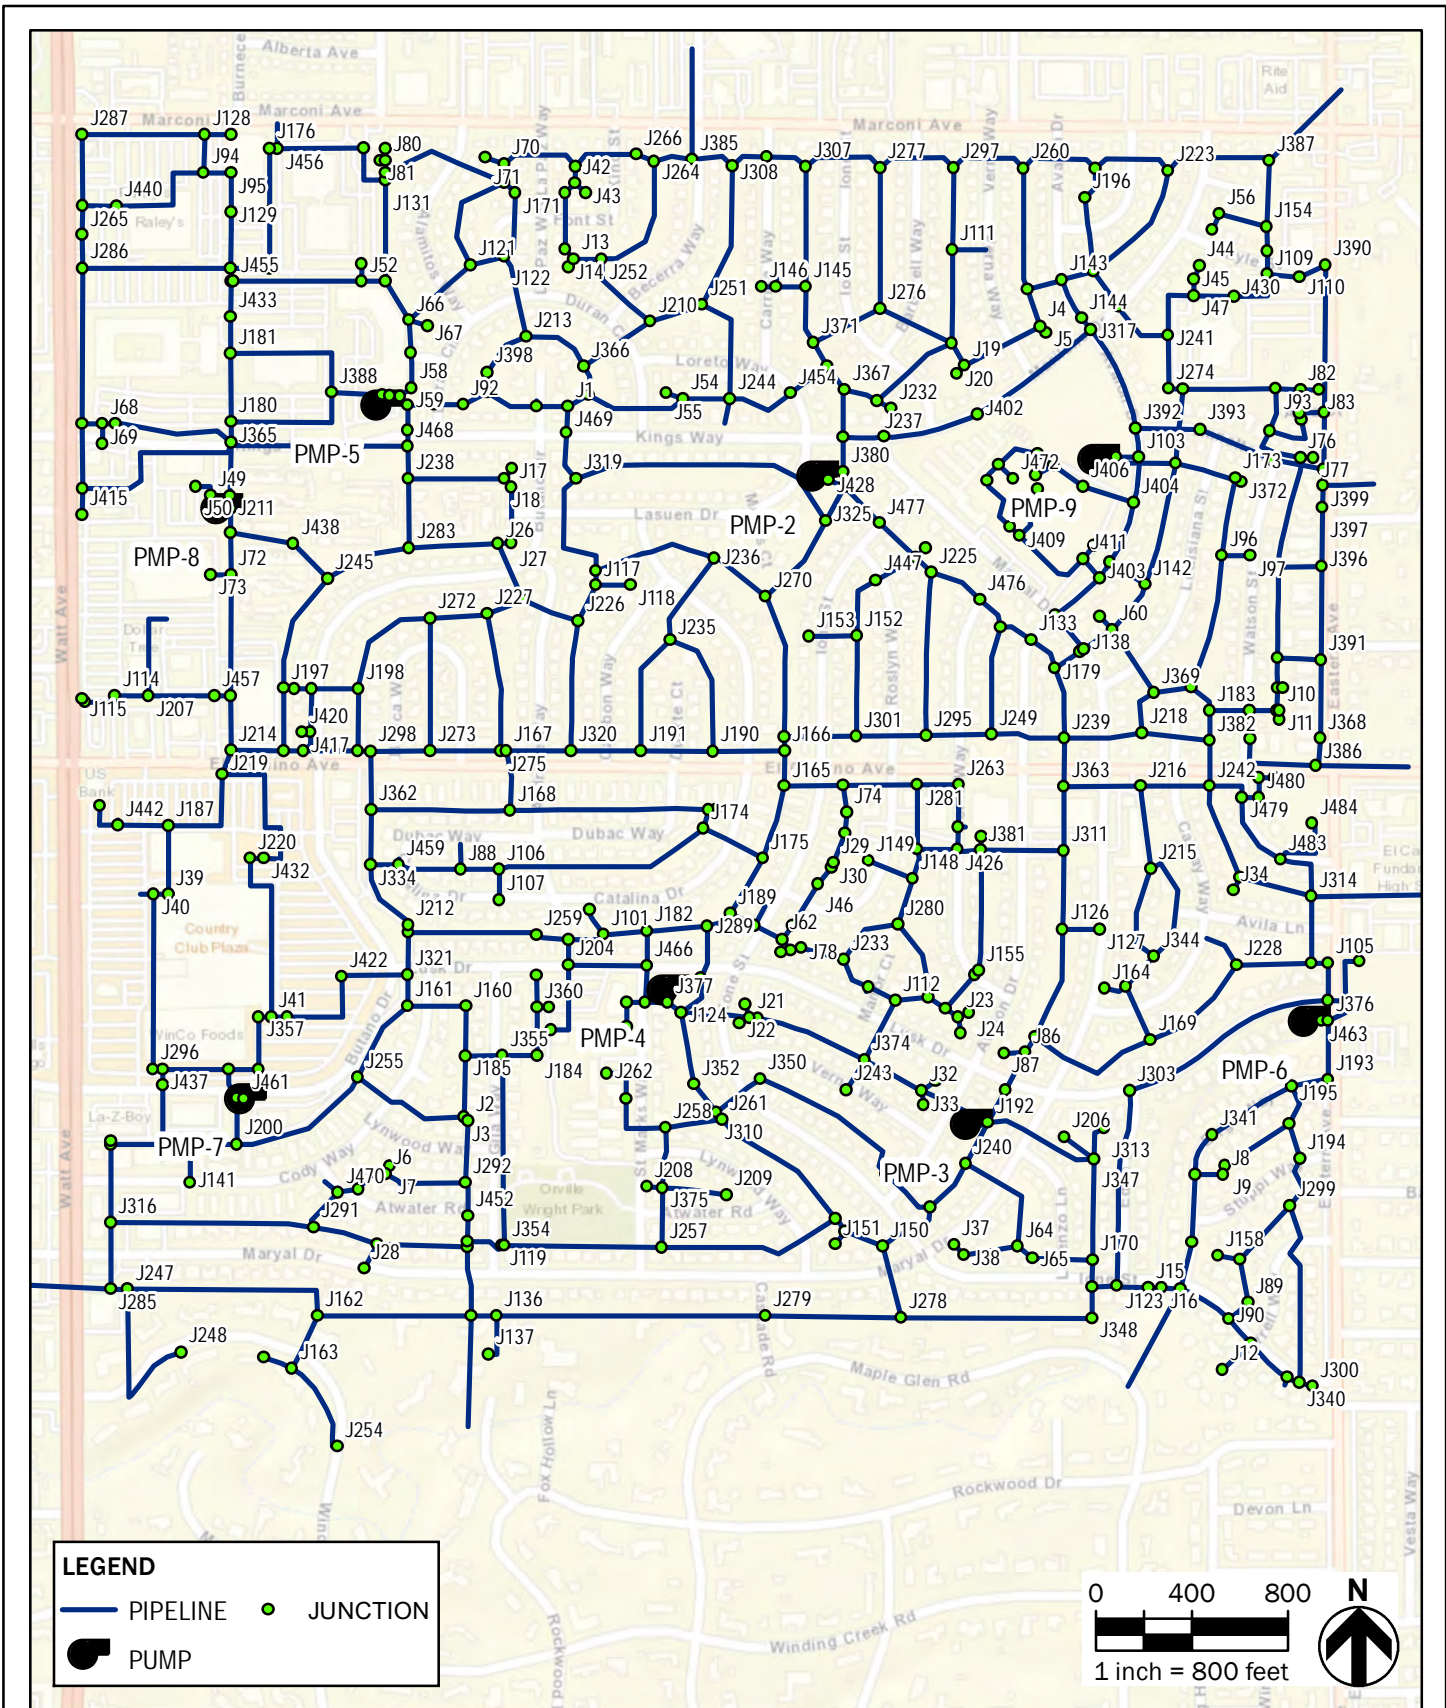


FIGURE A1
DEL PASO MANOR WATER DISTRIBUTION SYSTEM
JUNCTION LABELS

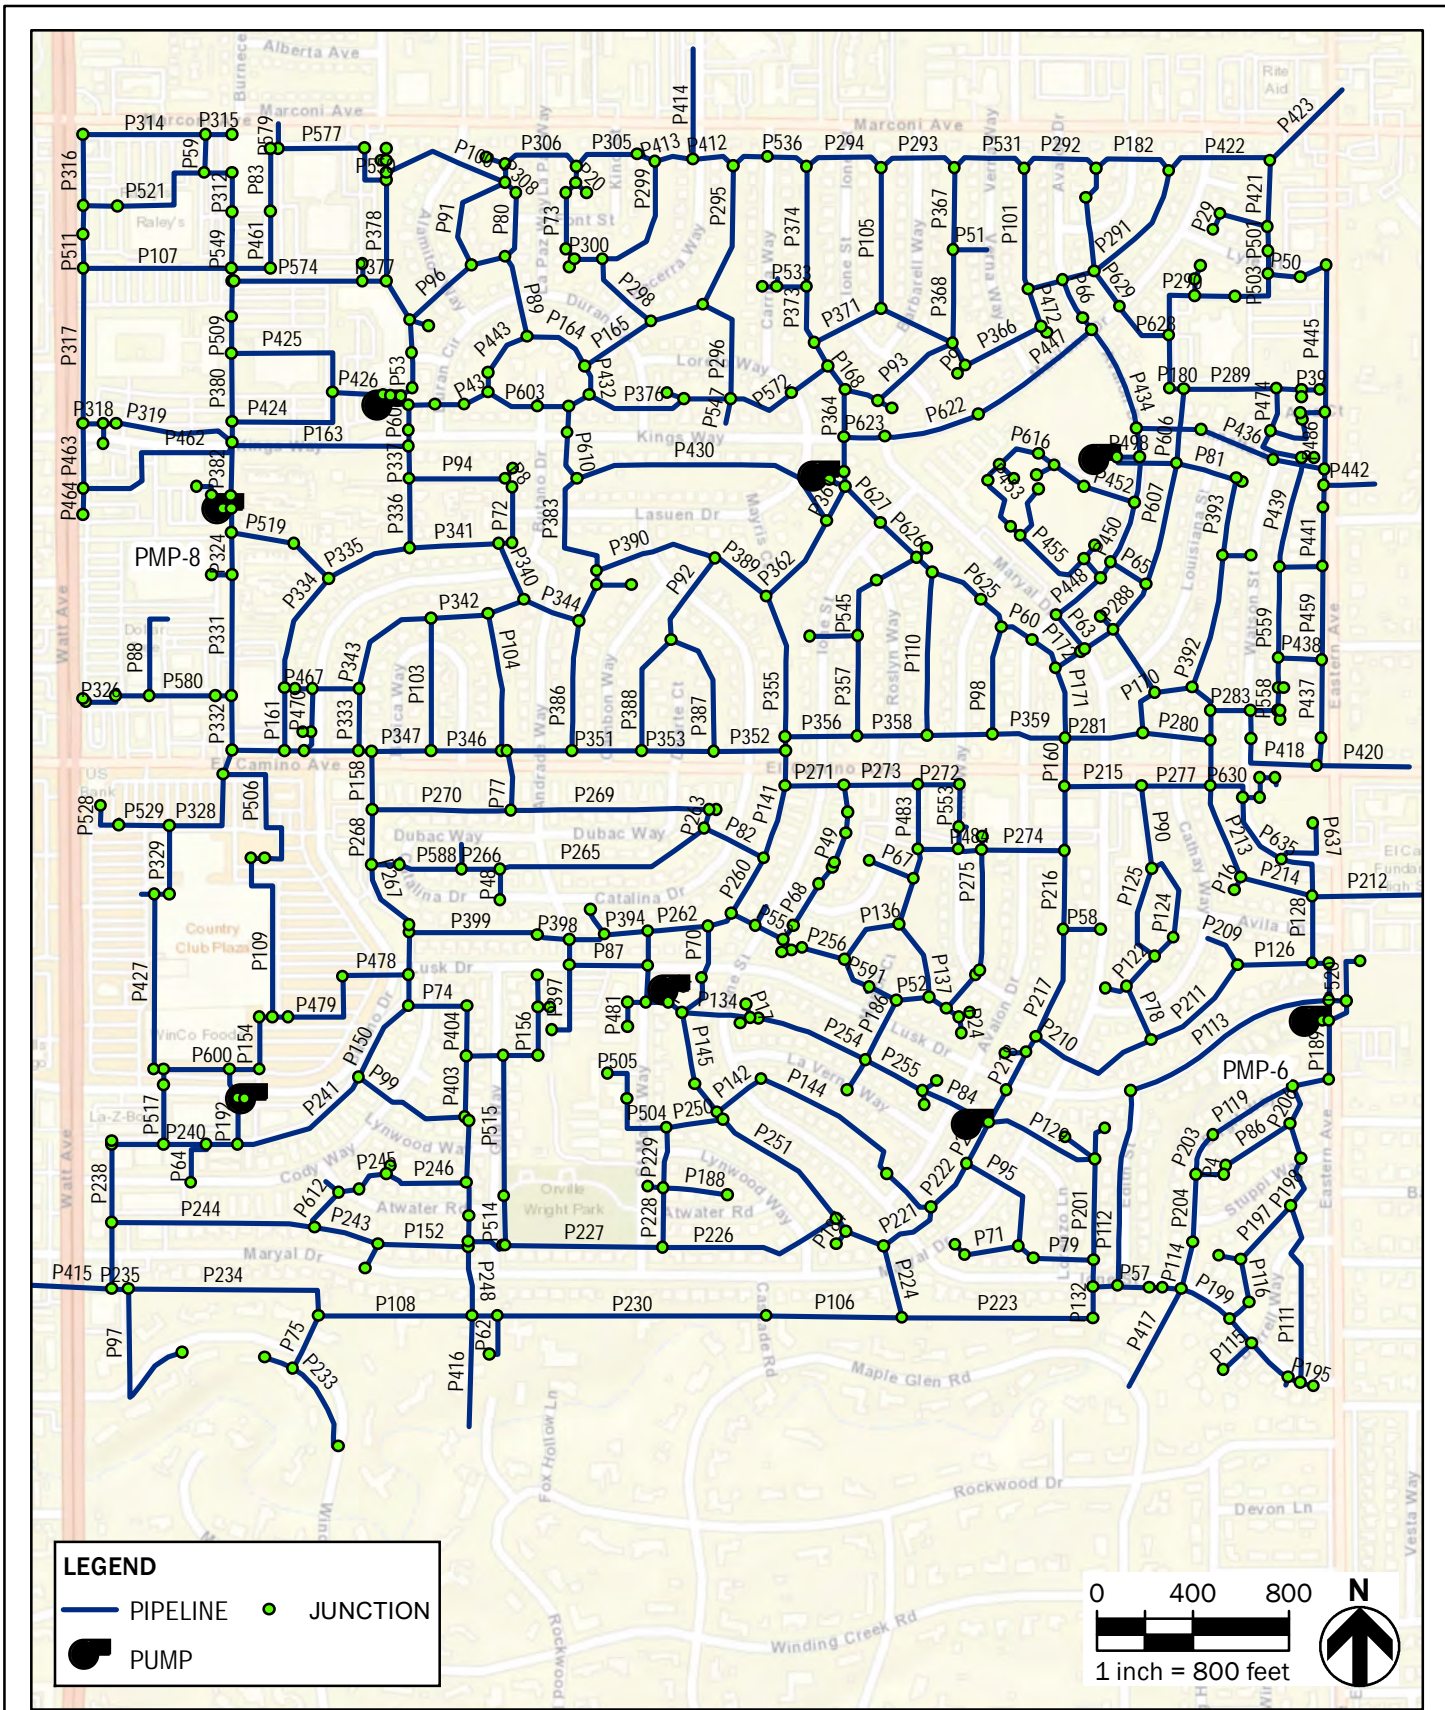


FIGURE A2
DEL PASO MANOR WATER DISTRIBUTION SYSTEM
PIPE LABELS

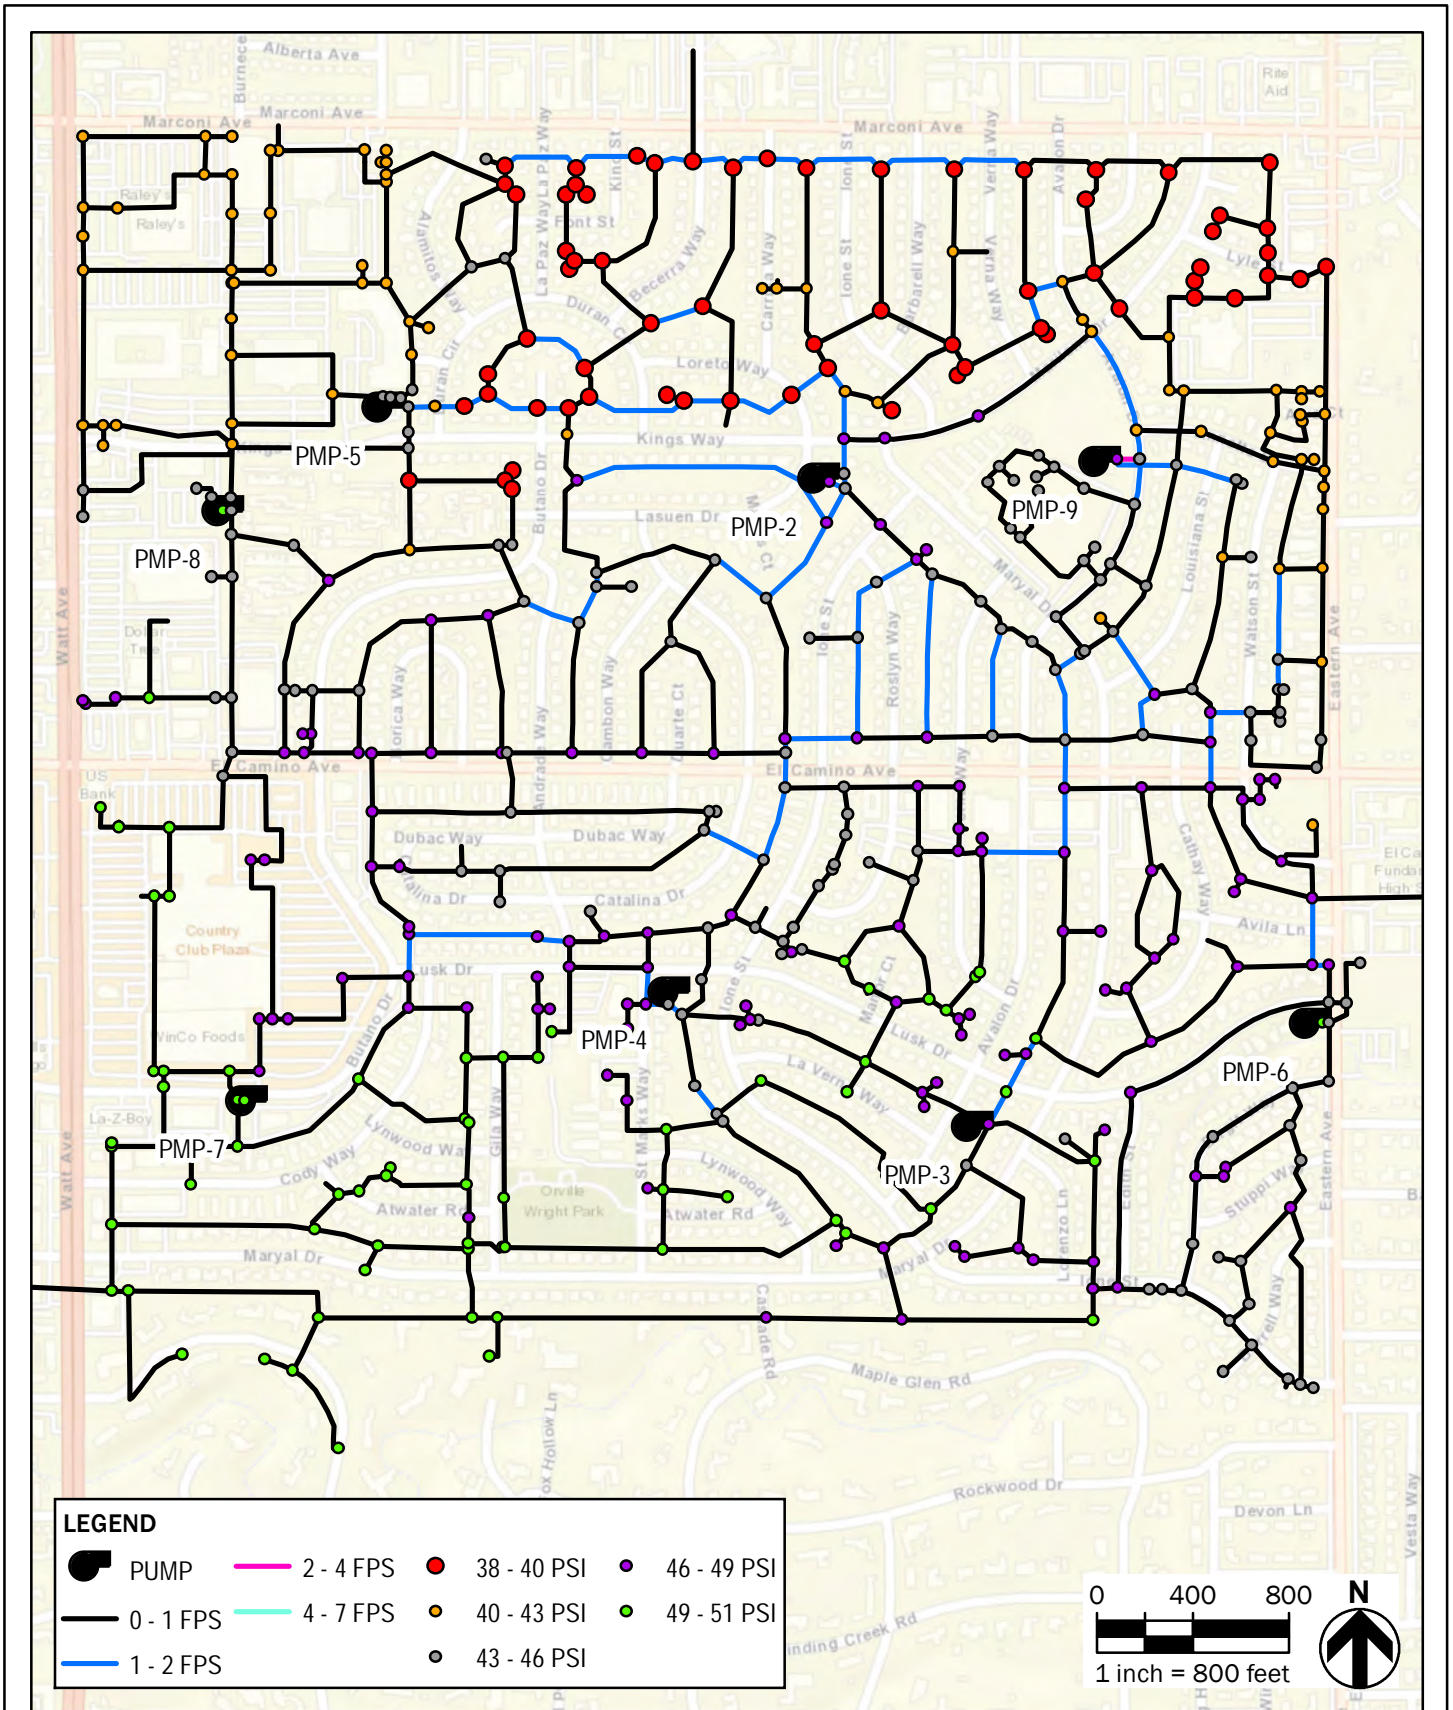


FIGURE A3
DEL PASO MANOR WATER DISTRIBUTION SYSTEM
MDD MIN. PRES. AND MAX. VEL. - NORMAL OPERATIONS

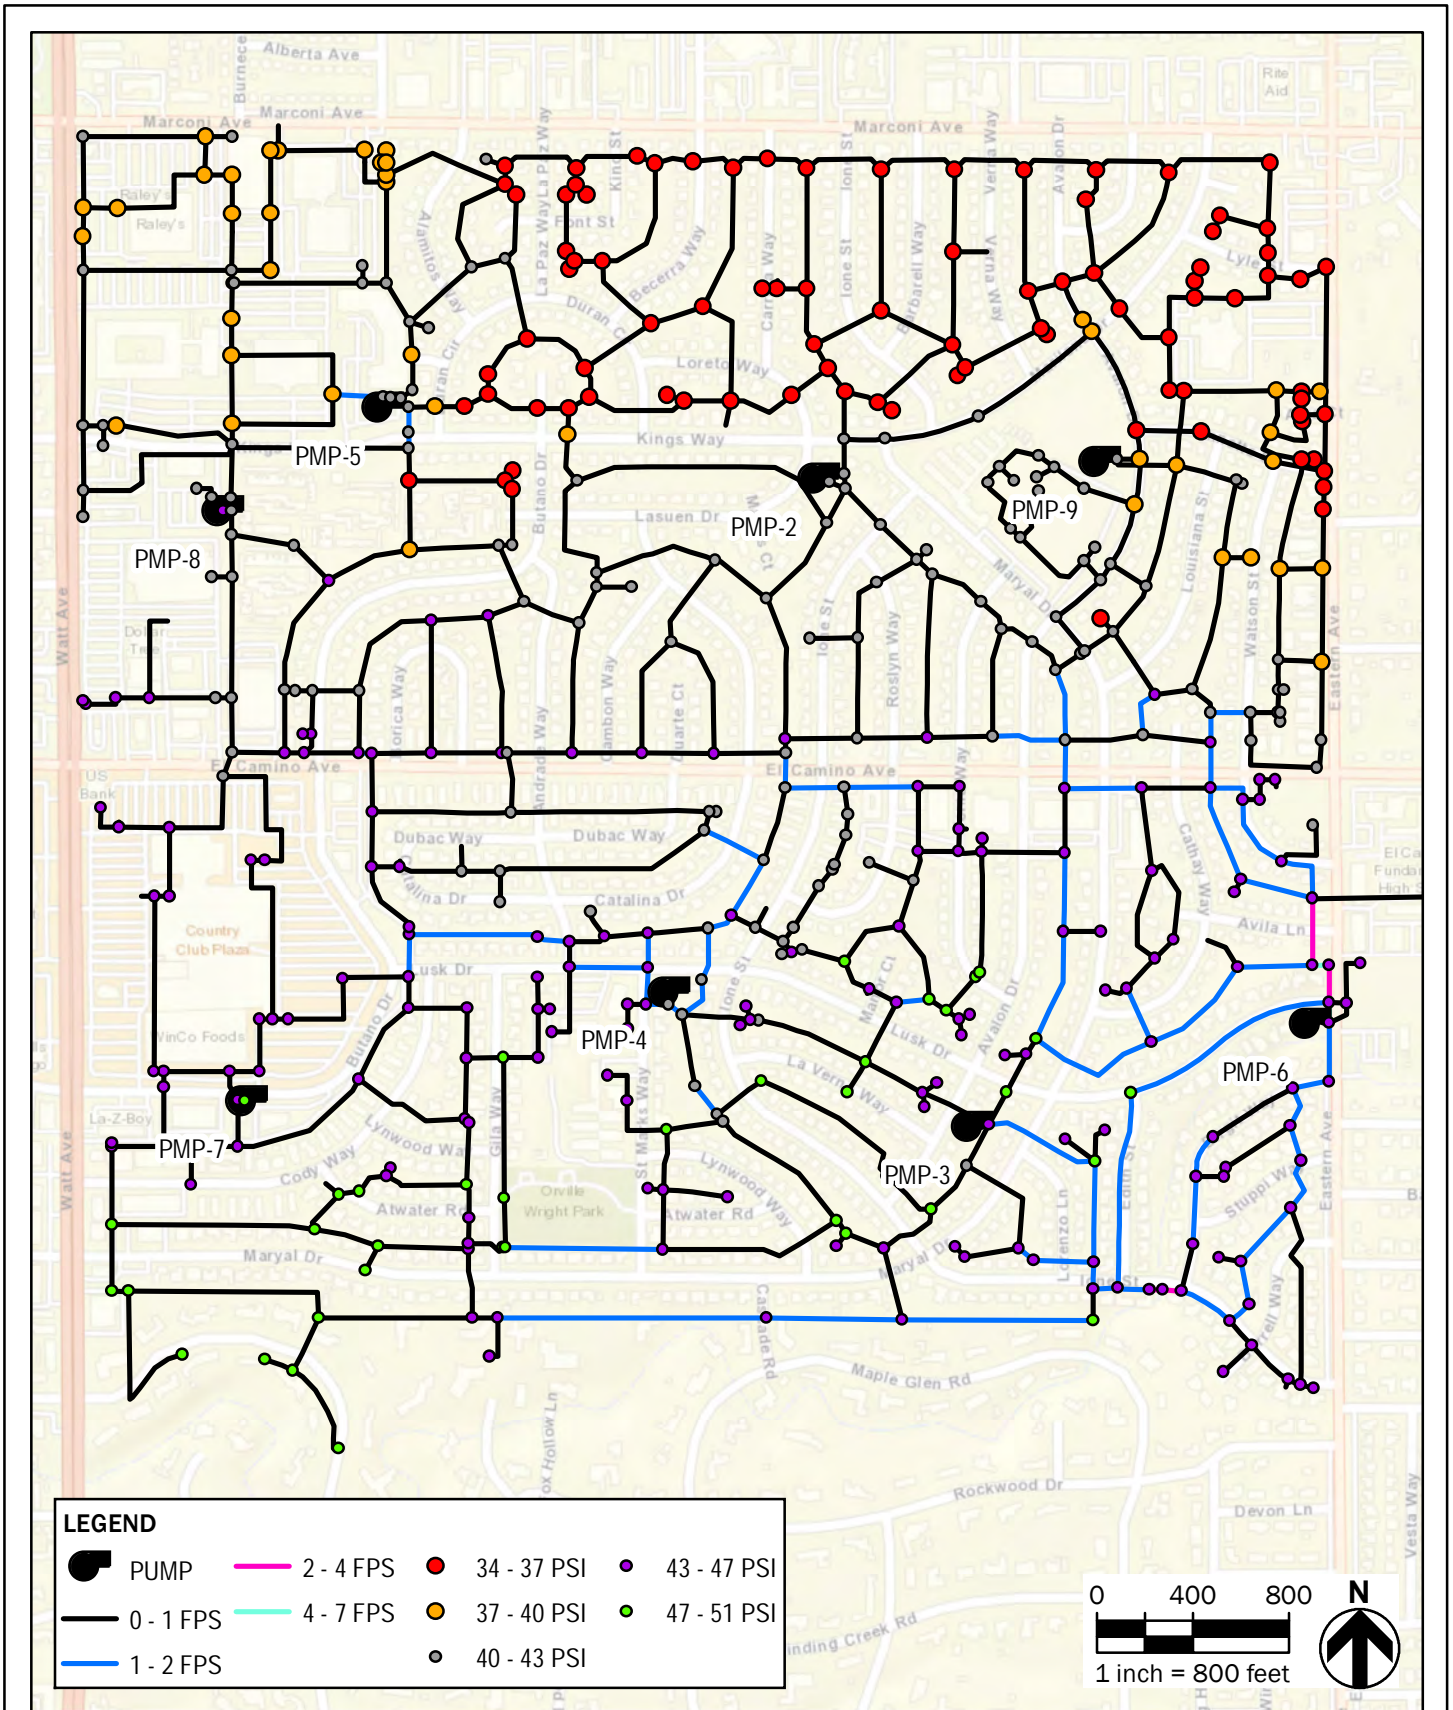


FIGURE A4
DEL PASO MANOR WATER DISTRIBUTION SYSTEM
MDD MIN. PRES. AND MAX. VEL. - PUMP 9 OFF

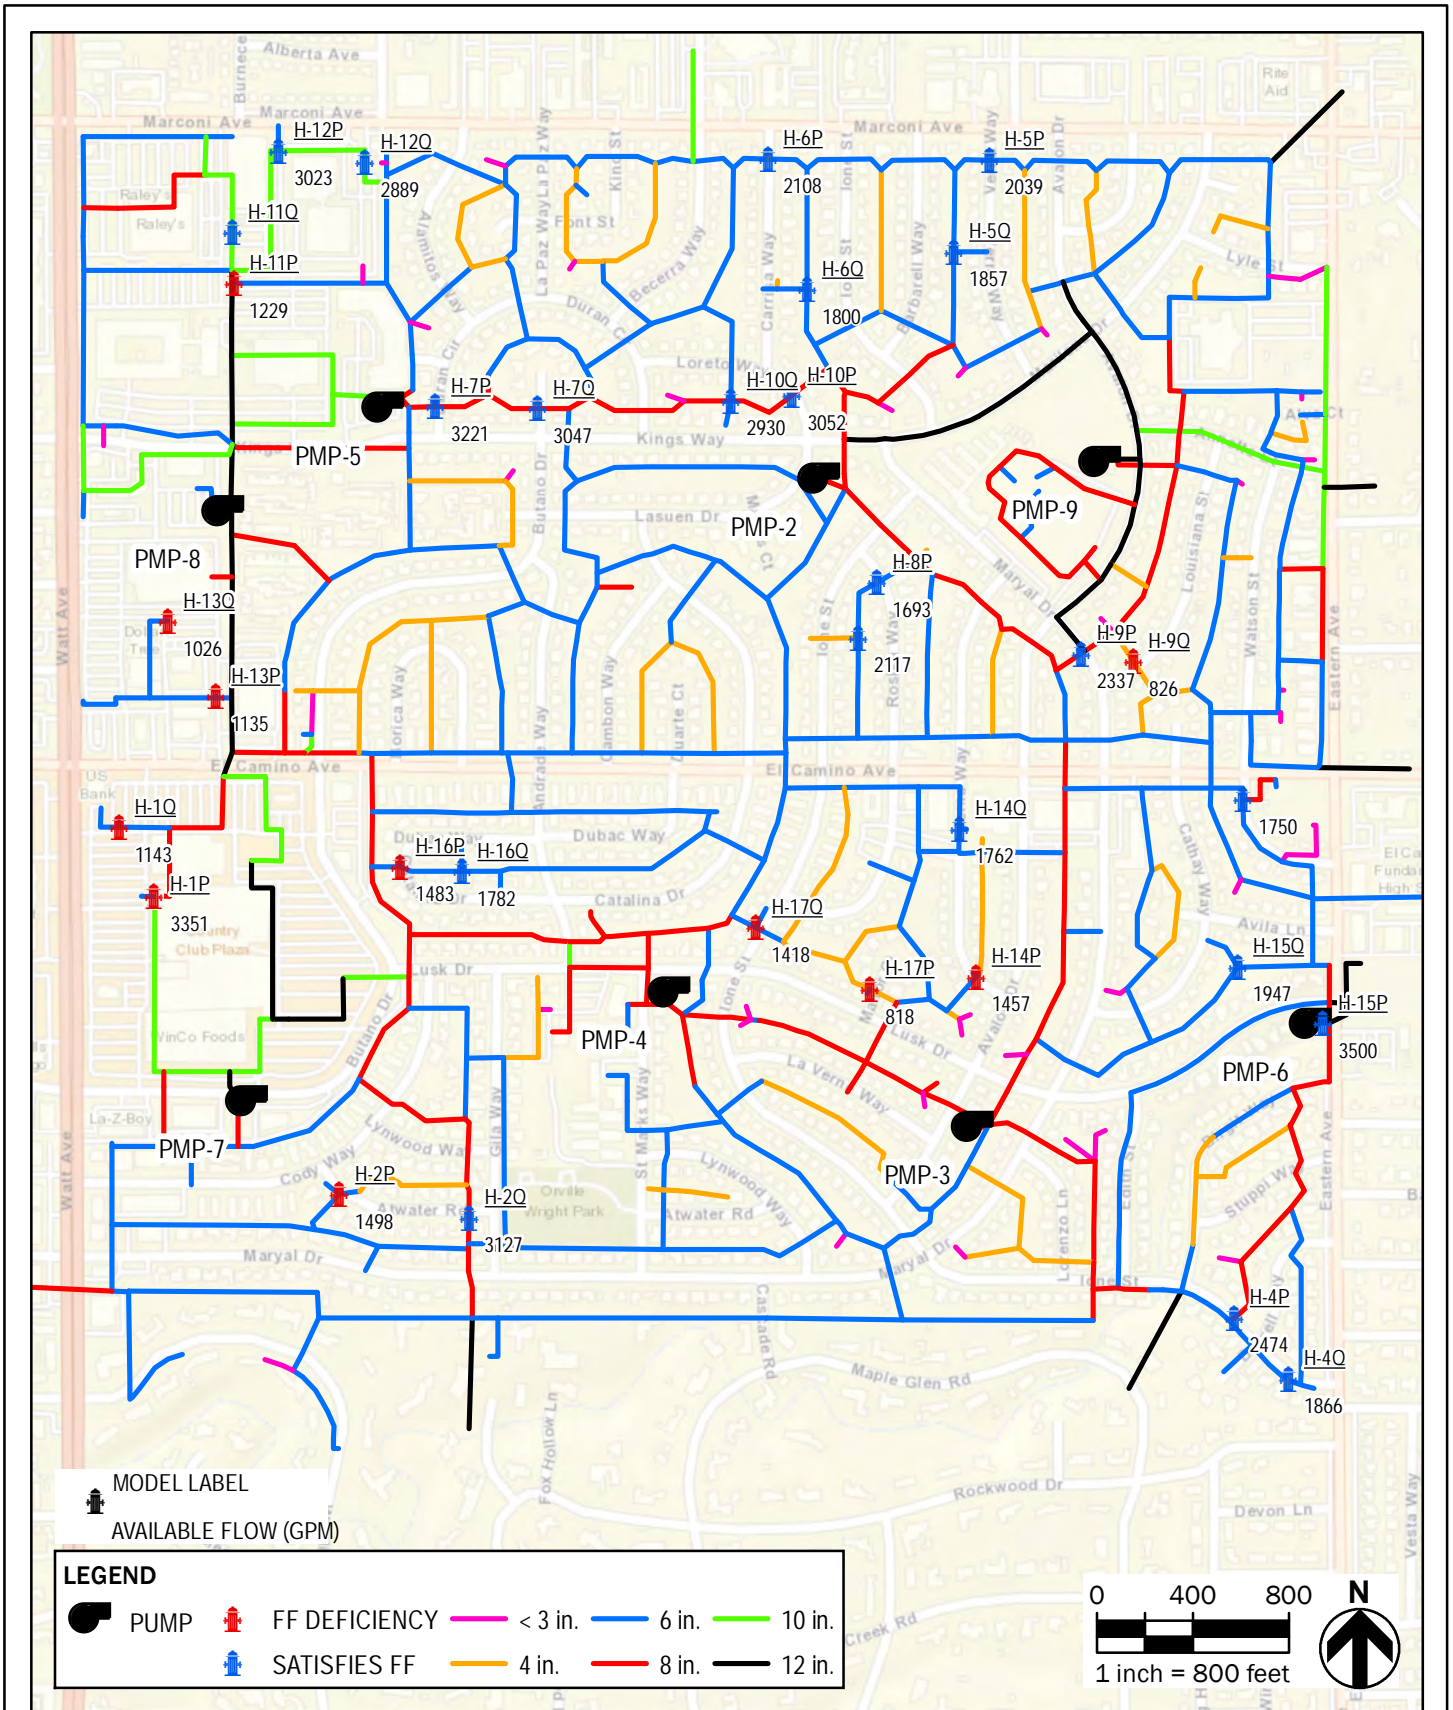


FIGURE A5
 DEL PASO MANOR WATER DISTRIBUTION SYSTEM
 MDD+FF AVAILABLE FIRE FLOW - NORMAL OPERATIONS

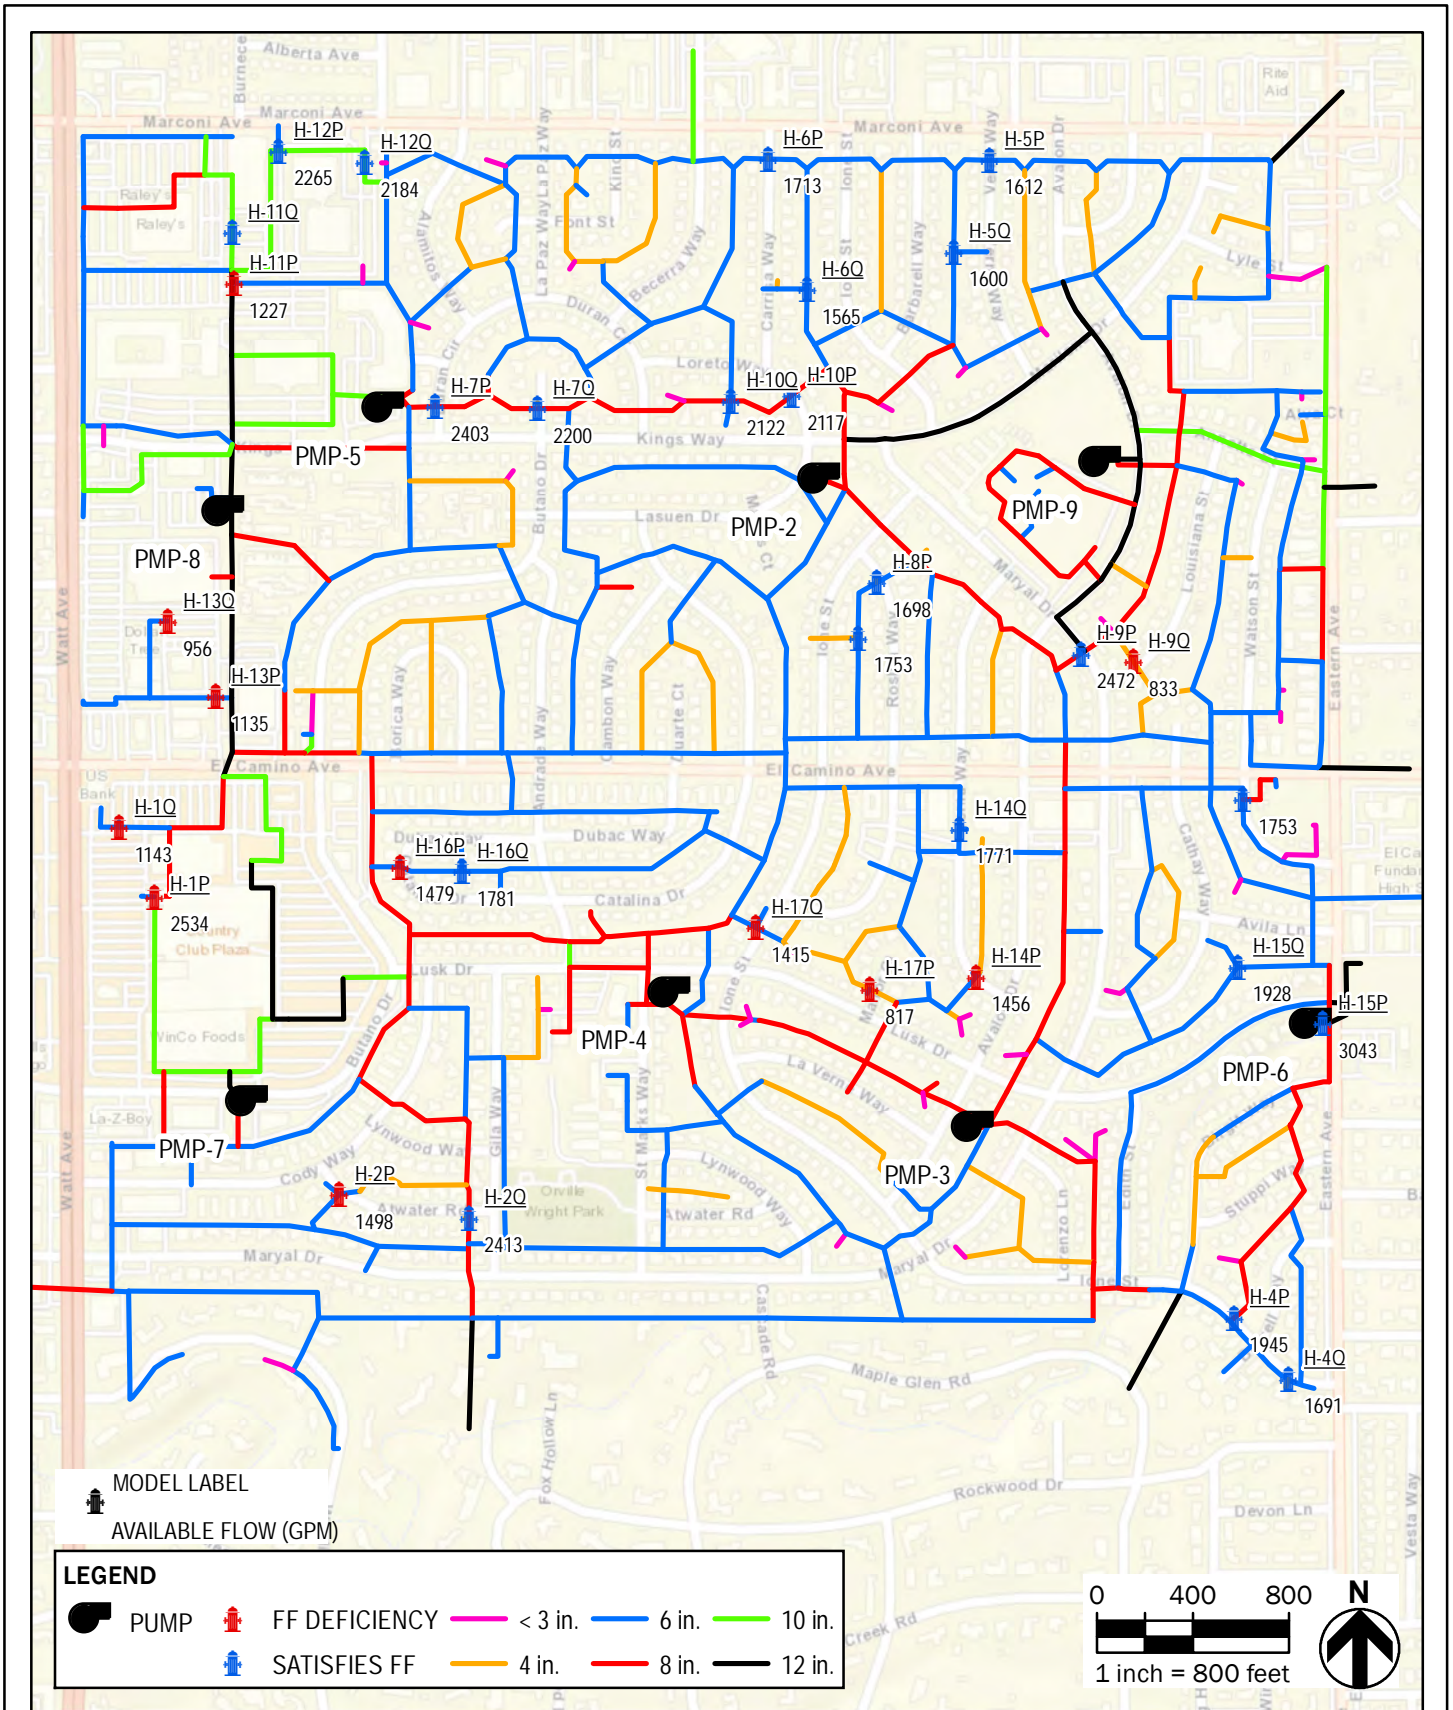


FIGURE A6
 DEL PASO MANOR WATER DISTRIBUTION SYSTEM
 MDD+FF AVAILABLE FIRE FLOW - PUMP 9 OFF

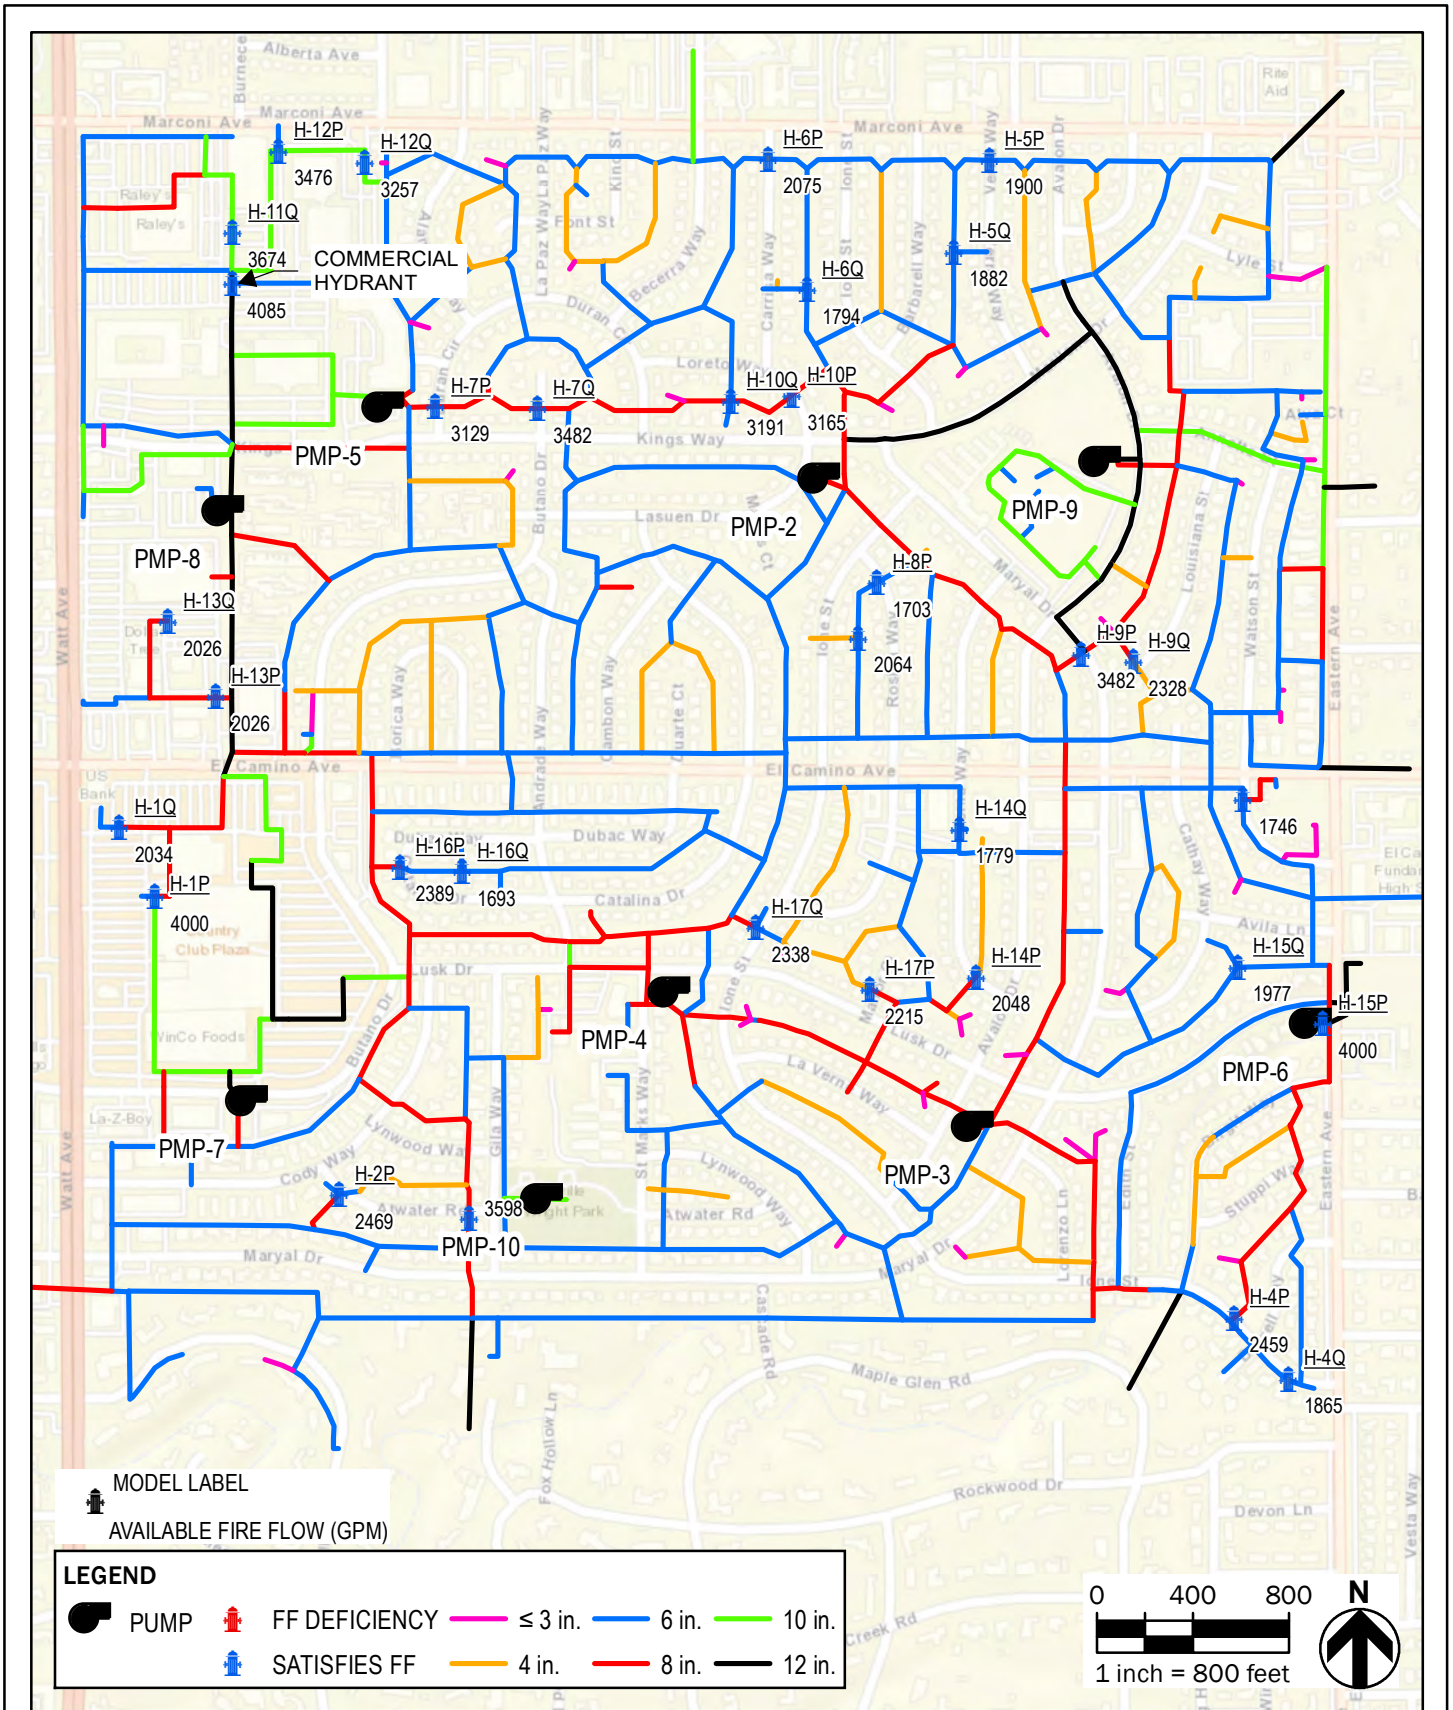


FIGURE A7
 DEL PASO WATER DISTRIBUTION SYSTEM
 MDD+FF AVAILABLE FIRE FLOW - PUMP 9 OFF - WITH SYSTEM UPGRADES

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J1	86	3	187	44	176	39
J2	62	3	187	54	176	49
J3	62	3	187	54	176	49
J4	90	3	187	42	179	38
J5	88	3	187	43	179	39
J6	62	3	187	54	175	49
J7	62	3	187	54	175	49
J8	68	3	187	51	176	47
J9	68	3	187	51	176	47
J10	74	3	187	49	179	45
J11	73	4	187	49	179	46
J12	71	3	187	50	176	46
J13	86	3	187	44	176	39
J14	86	3	187	44	176	39
J15	71	3	187	50	176	46
J16	71	3	187	50	176	46
J17	87	3	187	43	176	38
J18	87	3	187	43	175	38
J19	87	3	187	43	179	40
J20	87	3	187	43	179	40
J21	70	3	187	51	177	46
J22	70	3	187	51	177	46
J23	70	3	187	51	177	46
J24	70	3	187	51	177	46
J25	87	3	187	43	175	38
J26	70	3	187	51	176	46
J27	70	3	187	51	176	46
J28	60	3	187	55	175	50
J29	76	3	187	48	177	44
J30	76	3	187	48	177	44
J31	60	3	187	55	175	50
J32	70	3	187	51	177	46
J33	70	3	187	51	177	46
J34	70	3	187	51	177	46
J35	70	3	187	51	177	46
J36	70	3	187	51	177	46
J37	68	3	187	51	176	47
J38	68	3	187	51	176	47
J39	62	3	187	54	175	49
J40	62	3	187	54	175	49
J41	64	3	187	53	175	48
J42	87	3	187	43	176	39
J43	86	3	187	44	176	39
J44	90	3	187	42	179	39
J45	90	3	187	42	179	39
J46	76	3	187	48	177	44
J47	90	3	187	42	179	39
J48	68	3	187	52	177	47
J49	74	3	187	49	175	44
J50	74	3	187	49	175	44
J51	68	3	187	52	177	47
J52	76	3	187	48	175	43
J53	76	3	187	48	175	43
J54	86	3	187	44	177	39
J55	86	3	187	44	177	39
J56	90	3	187	42	179	39
J57	90	3	187	42	179	39
J58	76	3	187	48	176	43
J59	76	3	187	48	176	43
J60	76	3	187	48	180	45

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J61	85	3	187	44	180	41
J62	72	3	187	50	177	45
J63	74	3	187	49	177	44
J64	68	3	187	52	176	47
J65	68	3	187	51	176	47
J66	76	3	187	48	175	43
J67	76	3	187	48	175	43
J68	76	3	187	48	175	43
J69	76	3	187	48	175	43
J70	86	3	187	44	176	39
J71	76	3	187	48	176	43
J72	74	3	187	49	175	44
J73	74	3	187	49	175	44
J74	74	3	187	49	177	44
J75	74	3	187	49	177	44
J76	85	3	187	44	179	41
J77	85	3	187	44	179	41
J78	74	3	187	49	177	44
J79	74	3	187	49	177	44
J80	78	3	187	47	175	42
J81	78	3	187	47	175	42
J82	85	3	187	44	179	41
J83	82	3	187	45	179	42
J84	78	3	187	47	175	42
J85	78	3	187	47	175	42
J86	64	3	187	53	177	49
J87	64	3	187	53	177	49
J88	72	3	187	50	176	45
J89	74	3	187	49	176	44
J90	74	3	187	49	176	44
J91	72	3	187	50	177	45
J92	85	3	187	44	176	39
J93	82	3	187	45	179	42
J94	80	3	187	46	175	41
J95	80	3	187	46	175	41
J96	82	3	187	45	179	42
J97	78	3	187	47	179	44
J98	85	3	187	44	176	39
J99	85	3	187	44	176	39
J100	68	3	187	51	176	47
J101	70	3	187	51	177	46
J102	72	3	187	50	177	45
J103	78	3	187	47	180	44
J104	71	3	187	50	180	47
J105	70	3	187	51	176	46
J106	72	3	187	50	176	45
J107	72	3	187	50	176	45
J108	80	3	187	46	175	41
J109	90	3	187	42	179	39
J110	90	3	187	42	179	39
J111	85	3	187	44	179	40
J112	64	3	187	53	177	49
J113	62	3	187	54	177	50
J114	68	3	187	51	175	46
J115	68	3	187	51	175	46
J116	80	3	187	46	176	41
J117	72	3	187	50	176	45
J118	73	3	187	49	176	45
J119	60	3	187	55	176	50
J120	62	3	187	54	176	49

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J121	76	3	187	48	176	43
J122	76	3	187	48	176	43
J123	66	3	187	52	176	48
J124	72	3	187	50	177	45
J125	65	3	188	53	177	48
J126	70	3	187	51	177	46
J127	70	3	187	51	177	46
J128	78	3	187	47	175	42
J129	78	3	187	47	175	42
J130	80	3	187	46	175	41
J131	80	3	187	46	175	41
J132	80	3	187	46	175	41
J133	76	3	187	48	179	45
J134	76	3	187	48	179	45
J135	72	3	187	50	177	45
J136	62	3	187	54	176	49
J137	61	3	187	54	176	50
J138	76	3	187	48	180	45
J139	75	3	187	49	180	45
J140	62	3	187	54	175	49
J141	62	3	187	54	175	49
J142	76	3	187	48	180	45
J143	84	3	187	45	179	41
J144	82	3	187	45	179	42
J145	85	3	187	44	178	40
J146	85	3	187	44	178	40
J147	74	3	187	49	176	44
J148	72	3	187	50	177	45
J149	72	3	187	50	177	45
J150	64	3	187	53	176	49
J151	64	3	187	53	176	49
J152	75	3	187	49	178	45
J153	75	3	187	49	178	45
J154	90	3	187	42	179	39
J155	62	3	187	54	177	50
J156	74	3	187	49	175	44
J157	62	3	187	54	176	49
J158	74	3	187	49	176	44
J159	85	3	187	44	176	40
J160	65	3	187	53	176	48
J161	64	3	187	53	176	48
J162	60	3	187	55	175	50
J163	60	3	187	55	175	50
J164	70	3	187	51	177	46
J165	72	3	187	50	177	45
J166	72	3	187	50	177	45
J167	70	3	187	51	176	46
J168	70	3	187	51	176	46
J169	66	3	187	52	177	48
J170	64	3	187	53	176	49
J171	86	3	187	44	176	39
J172	70	13	187	51	177	46
J173	76	3	187	48	179	45
J174	72	3	187	50	176	45
J175	72	3	187	50	176	45
J176	78	3	187	47	175	42
J177	90	3	187	42	179	39
J178	90	3	187	42	179	39
J179	75	3	187	49	179	45
J180	78	3	187	47	175	42

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J181	78	3	187	47	175	42
J182	70	3	187	51	177	46
J183	72	3	187	50	179	46
J184	62	3	187	54	175	49
J185	62	3	187	54	176	49
J186	62	3	187	54	175	49
J187	62	3	187	54	175	49
J188	70	3	187	51	177	46
J189	70	3	187	51	177	46
J190	68	3	187	52	177	47
J191	68	3	187	51	176	47
J192	70	3	187	51	177	46
J193	70	3	187	51	176	46
J194	72	3	187	50	176	45
J195	72	3	187	50	176	45
J196	90	3	187	42	179	39
J197	70	3	187	51	175	46
J198	70	3	187	51	176	46
J199	62	3	187	54	175	49
J200	62	3	187	54	175	49
J201	62	3	187	54	175	49
J202	64	3	187	53	175	48
J203	72	3	187	50	176	45
J204	68	3	187	52	176	47
J205	72	3	187	50	177	45
J206	72	3	187	50	176	45
J207	62	3	187	54	175	49
J208	64	3	187	53	176	49
J209	62	3	187	54	176	49
J210	86	3	187	44	176	39
J211	74	3	187	49	175	44
J212	64	3	187	53	176	48
J213	86	3	187	44	176	39
J214	74	3	187	49	175	44
J215	68	3	187	52	177	47
J216	68	3	187	52	177	47
J217	74	3	187	49	179	45
J218	72	3	187	50	178	46
J219	72	3	187	50	175	45
J220	64	3	187	53	175	48
J221	74	3	187	49	179	45
J222	74	3	187	49	179	46
J223	90	3	187	42	179	39
J224	86	3	187	44	176	39
J225	73	3	187	49	179	46
J226	73	3	187	49	176	45
J227	68	3	187	51	176	47
J228	68	3	187	51	177	47
J229	66	3	187	52	176	48
J230	62	3	187	54	176	50
J231	73	3	187	49	179	46
J232	86	3	187	44	178	40
J233	62	3	187	54	177	50
J234	86	3	187	44	179	40
J235	72	3	187	50	177	45
J236	74	3	187	49	177	44
J237	86	3	187	44	179	40
J238	86	3	187	44	175	39
J239	73	3	187	49	178	45
J240	73	3	187	49	176	45

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J241	86	3	187	44	179	40
J242	68	3	187	52	177	47
J243	62	3	187	54	177	50
J244	86	3	187	44	177	39
J245	68	3	187	51	175	46
J246	72	3	187	50	175	45
J247	60	3	187	55	175	50
J248	60	3	187	55	175	50
J249	73	3	187	49	178	46
J250	74	3	187	49	175	44
J251	86	3	187	44	177	39
J252	86	3	187	44	176	39
J253	60	3	187	55	175	50
J254	60	3	187	55	175	50
J255	62	3	187	54	176	49
J256	74	3	187	49	176	44
J257	62	3	187	54	176	49
J258	62	3	187	54	176	49
J259	64	3	187	53	176	49
J260	90	3	187	42	179	39
J261	72	3	187	50	176	45
J262	64	3	187	53	176	49
J263	70	3	187	51	177	46
J264	86	3	187	44	176	39
J265	78	3	187	47	175	42
J266	86	3	187	44	176	39
J267	68	3	187	52	177	47
J268	72	3	187	50	179	46
J269	72	3	187	50	179	46
J270	72	3	187	50	177	45
J271	72	3	187	50	176	45
J272	68	3	187	51	176	47
J273	68	3	187	51	176	47
J274	84	3	187	45	179	41
J275	68	3	187	51	176	47
J276	86	3	187	44	178	40
J277	86	3	187	44	178	40
J278	63	3	187	54	176	49
J279	64	3	187	53	176	48
J280	68	3	187	52	177	47
J281	68	3	187	52	177	47
J282	86	3	187	44	176	39
J283	78	3	187	47	175	42
J284	62	3	187	54	175	49
J285	60	3	187	55	175	50
J286	76	3	187	48	175	43
J287	76	3	187	48	175	43
J288	76	3	187	48	175	43
J289	72	3	187	50	177	45
J290	62	3	187	54	176	49
J291	60	3	187	55	175	50
J292	60	3	187	55	176	50
J293	76	3	187	48	175	43
J294	76	3	187	48	175	43
J295	70	3	187	51	178	47
J296	62	3	187	54	175	49
J297	90	3	187	42	179	38
J298	64	3	187	53	176	48
J299	68	3	187	51	176	47
J300	74	3	187	49	176	44

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J301	70	3	187	51	178	47
J302	64	3	187	53	176	48
J303	64	3	187	53	176	49
J304	62	3	187	54	177	50
J305	62	3	187	54	177	50
J306	72	3	187	50	176	45
J307	86	3	187	44	178	40
J308	86	3	187	44	177	39
J309	60	3	187	55	176	50
J310	72	3	187	50	176	45
J311	68	3	187	52	177	47
J312	84	3	187	45	180	41
J313	68	3	187	51	176	47
J314	68	3	187	51	177	47
J315	74	3	187	49	176	44
J316	60	3	187	55	175	50
J317	82	3	187	45	179	42
J318	70	3	187	51	179	47
J319	70	3	187	51	176	46
J320	68	3	187	51	176	47
J321	66	3	187	52	176	47
J322	60	3	187	55	176	50
J323	70	3	187	51	176	46
J324	64	3	187	53	175	48
J325	70	3	187	51	178	47
J326	76	3	187	48	175	43
J327	74	3	187	49	179	45
J328	85	3	187	44	179	41
J329	66	3	187	52	176	47
J330	76	3	187	48	175	43
J331	62	3	187	54	175	49
J332	60	3	187	55	176	50
J333	72	3	187	50	176	45
J334	64	3	187	53	176	48
J335	72	3	187	50	176	45
J336	74	3	187	49	179	45
J337	70	3	187	51	177	46
J338	90	3	187	42	179	39
J339	72	3	187	50	176	45
J340	74	3	187	49	176	44
J341	72	3	187	50	176	45
J342	66	3	187	52	176	48
J343	68	3	187	52	177	47
J344	68	3	187	52	177	47
J345	68	3	187	52	177	47
J346	68	3	187	51	177	47
J347	62	3	187	54	176	50
J348	62	3	187	54	176	49
J349	62	3	187	54	177	50
J350	62	3	187	54	176	50
J351	62	3	187	54	176	50
J352	72	3	187	50	177	45
J353	64	3	188	53	177	49
J354	60	3	187	55	176	50
J355	60	3	187	55	176	50
J356	60	3	187	55	175	50
J357	64	3	187	53	175	48
J358	64	3	187	53	175	48
J359	64	3	187	53	175	48
J360	64	3	187	53	175	48

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J361	64	3	187	53	175	48
J362	64	3	187	53	176	48
J363	68	3	187	52	177	47
J364	76	3	187	48	175	43
J365	76	3	187	48	175	43
J366	86	3	187	44	176	39
J367	86	3	187	44	179	40
J368	74	3	187	49	179	46
J369	70	3	187	51	179	47
J370	86	3	187	44	178	40
J371	86	3	187	44	178	40
J372	76	3	187	48	179	45
J373	85	3	187	44	179	41
J374	62	3	187	54	177	50
J375	62	3	187	54	176	49
J376	72	3	187	50	176	45
J377	72	3	188	50	177	45
J378	62	3	187	54	175	49
J379	72	3	187	50	175	45
J380	73	3	187	49	179	46
J381	68	3	187	52	177	47
J382	70	3	187	51	178	47
J383	76	3	187	48	180	45
J384	74	3	187	49	176	44
J385	86	3	187	44	177	39
J386	74	3	187	49	179	45
J387	90	3	187	42	179	39
J388	78	3	187	47	175	42
J389	72	3	187	50	176	45
J390	91	3	187	42	179	38
J391	80	3	187	46	179	43
J392	84	3	187	45	180	41
J393	85	3	187	44	180	41
J394	83	3	187	45	180	42
J395	80.2	3	187	46	179	43
J396	83	3	187	45	179	42
J397	86	3	187	44	179	40
J398	86.7	3	187	43	176	39
J399	86.6	3	187	44	179	40
J400	85	3	187	44	179	41
J401	86	3	187	44	179	40
J402	70	3	187	51	179	47
J403	75.8	3	187	48	180	45
J404	77.2	3	187	48	180	44
J405	76	3	187	48	180	45
J406	76	3	187	48	180	45
J407	76	3	187	48	180	45
J408	76	3	187	48	180	45
J409	76	21	187	48	180	45
J410	76	3	187	48	180	45
J411	76	3	187	48	180	45
J412	76	3	187	48	180	45
J413	78	3	187	47	175	42
J414	75	3	187	48	175	43
J415	75	3	187	48	175	43
J416	70	3	187	51	176	46
J417	64	3	187	53	175	48
J418	70	3	187	51	176	46
J419	66	3	187	52	175	47
J420	66	3	187	52	175	47

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J421	83.3	3	187	45	179	42
J422	65.2	3	187	53	175	48
J423	64	3	187	53	175	48
J424	64	3	188	53	177	49
J425	70.7	3	187	50	177	46
J426	68.6	3	187	51	177	47
J427	86.9	3	187	43	179	40
J428	72	3	188	50	179	47
J429	90	2	187	42	179	39
J430	90	3	187	42	179	39
J431	63.2	9	187	54	176	49
J432	64	7	187	53	175	48
J433	77	156	187	48	175	43
J434	77.1	8	187	47	175	43
J435	74	13	187	49	175	44
J436	60	10	187	55	176	50
J437	62	19	187	54	175	49
J438	69.7	45	187	51	175	46
J439	72	43	187	50	176	45
J440	78.4	0	187	47	175	42
J441	74	0	187	49	176	44
J442	62	0	187	54	175	49
J443	85	0	187	44	178	40
J444	86	0	187	44	177	40
J445	86	0	187	44	176	39
J446	80.3	0	187	46	176	41
J447	73.2	0	187	49	179	46
J448	69.1	0	187	51	177	47
J449	72.9	0	187	50	177	45
J450	75	5	187	49	179	45
J451	75	0	187	49	179	45
J452	62.8	0	187	54	176	49
J453	75.9	0	187	48	180	45
J454	86	0	187	44	178	40
J455	76	0	187	48	175	43
J456	78.2	0	187	47	175	42
J457	71.7	0	187	50	175	45
J458	62	0	187	54	177	50
J459	66.5	0	187	52	176	47
J460	63.1	0	187	54	177	49
J461	60	0	187	55	175	50
J462	61	0	187	54	175	50
J463	60	0	187	55	176	50
J464	62	0	187	54	175	49
J465	86	0	187	44	176	39
J466	68	0	187	52	177	47
J467	78	0	187	47	180	44
J468	76	0	187	48	175	43
J469	80.5	0	187	46	176	41
J470	60	0	187	55	175	50
J471	76	0	187	48	180	45
J472	76	0	187	48	180	45
J473	76	0	187	48	180	45
J474	76	0	187	48	180	45
J475	70	0	187	51	179	47
J476	75	0	187	49	179	45
J477	72.5	0	187	50	179	46
J478	88.4	0	187	43	179	39
J479	68	0	187	52	177	47
J480	68	0	187	52	177	47

TABLE 1

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J481	68	0	187	52	177	47
J482	68	0	187	52	177	47
J483	68	0	187	52	177	47
J484	79	0	187	47	177	42

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P1	8	12	0.08	0.005	ACP
P2	2	4	0.46	0.692	ACP
P3	2	4	0.46	0.693	ACP
P4	4	4	0.09	0.016	ACP
P5	2	6	0.64	1.3	ACP
P6	2	4	0.46	0.693	ACP
P7	6	33	0.37	0.152	DI
P8	4	15	0.39	0.236	ACP
P9	2	4	0.46	0.693	ACP
P10	2	4	0.46	0.693	ACP
P11	2	4	0.46	0.693	ACP
P12	2	4	0.46	0.692	ACP
P13	4	24	0.62	0.549	ACP
P14	4	24	0.6	0.516	ACP
P15	2	4	0.46	0.692	ACP
P16	2	4	0.46	0.692	ACP
P17	2	4	0.46	0.693	ACP
P18	2	4	0.46	0.693	ACP
P19	8	24	0.15	0.016	PVC
P20	6	4	0.05	0.003	ACP
P21	4	4	0.11	0.024	ACP
P22	4	20	0.52	0.398	ACP
P23	4	9	0.23	0.085	ACP
P24	2	4	0.46	0.692	ACP
P25	6	4	0.05	0.003	ACP
P26	8	4	0.03	0.001	ACP
P27	2	4	0.46	0.692	ACP
P28	2	4	0.46	0.693	ACP
P29	4	4	0.11	0.024	ACP
P30	2	4	0.46	0.693	ACP
P31	4	20	0.51	0.384	ACP
P32	4	8	0.2	0.068	ACP
P33	2	4	0.46	0.693	ACP
P34	2	4	0.46	0.693	ACP
P35	2	4	0.46	0.693	ACP
P36	8	4	0.03	0.001	ACP
P37	4	30	0.76	0.795	ACP
P38	2	4	0.46	0.693	ACP
P39	6	4	0.05	0.003	ACP
P40	2	4	0.46	0.692	ACP
P41	6	0	0	0	ACP
P42	4	33	0.84	0.954	ACP
P43	8	223	1.42	1.544	ACP
P44	10	19	0.08	0.004	ACP
P45	4	4	0.11	0.024	ACP
P46	4	4	0.11	0.021	ACP
P47	8	4	0.03	0.001	ACP
P48	6	4	0.05	0.003	ACP
P49	4	27	0.68	0.648	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P50	2	2	0.25	0.27	DI
P51	6	0	0	0	ACP
P52	6	42	0.47	0.205	ACP
P53	6	46	0.52	0.288	DI
P54	8	4	0.03	0.001	ACP
P55	6	43	0.48	0.249	DI
P56	4	35	0.89	1.077	ACP
P57	8	37	0.24	0.041	ACP
P58	6	4	0.05	0.003	ACP
P59	10	11	0.05	0.002	ACP
P60	8	149	0.95	0.535	ACP
P61	6	77	0.88	0.648	ACP
P62	6	4	0.05	0.003	PVC
P63	12	309	0.88	0.333	DI
P64	6	4	0.05	0.003	ACP
P65	4	27	0.7	0.681	ACP
P66	12	157	0.44	0.095	DI
P67	6	4	0.05	0.003	ACP
P68	4	18	0.46	0.32	ACP
P69	4	9	0.23	0.085	ACP
P70	6	73	0.83	0.58	ACP
P71	4	9	0.23	0.085	ACP
P72	4	20	0.51	0.378	ACP
P73	4	22	0.56	0.452	ACP
P74	6	16	0.18	0.036	ACP
P75	6	13	0.15	0.025	ACP
P76	6	129	1.47	1.676	ACP
P77	6	37	0.42	0.169	ACP
P78	6	72	0.82	0.574	ACP
P79	4	11	0.28	0.125	ACP
P80	6	28	0.32	0.098	ACP
P81	6	96	1.08	0.96	ACP
P82	6	114	1.3	1.334	ACP
P83	10	45	0.18	0.019	ACP
P84	8	74	0.48	0.149	ACP
P85	4	27	0.7	0.679	ACP
P86	4	7	0.17	0.05	ACP
P87	8	133	0.85	0.436	ACP
P88	6	0	0	0	ACP
P89	6	67	0.76	0.498	ACP
P90	6	88	1	0.821	ACP
P91	4	17	0.44	0.289	ACP
P92	6	37	0.43	0.169	ACP
P93	8	27	0.17	0.031	ACP
P94	4	7	0.17	0.048	ACP
P95	4	14	0.35	0.186	ACP
P96	6	49	0.56	0.28	ACP
P97	6	4	0.05	0.003	ACP
P98	4	49	1.25	2.006	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P99	8	16	0.1	0.009	ACP
P100	6	87	0.98	0.799	ACP
P101	4	24	0.62	0.745	ACP
P102	4	4	0.11	0.024	ACP
P103	4	4	0.1	0.019	ACP
P104	6	16	0.18	0.04	DI
P105	4	9	0.24	0.096	ACP
P106	6	63	0.71	0.438	ACP
P107	6	3	0.03	0.001	ACP
P108	6	28	0.32	0.102	ACP
P109	12	65	0.19	0.014	PVC
P110	6	105	1.19	1.147	ACP
P111	6	10	0.11	0.014	ACP
P112	6	21	0.24	0.059	ACP
P113	6	24	0.28	0.076	ACP
P114	6	7	0.08	0.008	ACP
P115	6	4	0.05	0.003	ACP
P116	8	21	0.13	0.014	ACP
P117	2	4	0.46	0.692	ACP
P118	8	69	0.44	0.129	ACP
P119	6	13	0.15	0.025	ACP
P120	8	41	0.26	0.05	ACP
P121	2	4	0.46	0.693	ACP
P122	6	79	0.89	0.668	ACP
P123	4	18	0.45	0.305	ACP
P124	4	21	0.53	0.411	ACP
P125	6	64	0.73	0.456	ACP
P126	6	38	0.43	0.172	ACP
P127	6	152	1.73	2.271	ACP
P128	6	127	1.44	1.627	ACP
P129	8	100	0.64	0.258	ACP
P130	2	4	0.46	0.693	ACP
P131	2	4	0.46	0.693	ACP
P132	8	44	0.28	0.057	ACP
P133	8	176	1.12	0.731	ACP
P134	8	132	0.84	0.43	ACP
P135	6	126	1.43	1.61	ACP
P136	4	16	0.42	0.265	ACP
P137	6	35	0.39	0.147	ACP
P138	4	12	0.3	0.146	ACP
P139	6	17	0.19	0.04	ACP
P140	4	13	0.34	0.181	ACP
P141	6	100	1.14	1.049	ACP
P142	6	17	0.19	0.038	ACP
P143	6	14	0.16	0.031	DI
P144	4	15	0.38	0.222	ACP
P145	8	141	0.9	0.488	ACP
P146	8	9	0.06	0.003	ACP
P147	6	47	0.53	0.259	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P148	4	18	0.46	0.358	DI
P149	6	11	0.12	0.017	ACP
P150	8	34	0.22	0.034	ACP
P151	6	4	0.05	0.003	ACP
P152	6	29	0.33	0.105	ACP
P153	10	67	0.27	0.036	PVC
P154	10	62	0.25	0.031	PVC
P155	12	137	0.39	0.063	ACP
P156	4	13	0.34	0.181	ACP
P157	2	4	0.46	0.693	ACP
P158	8	85	0.55	0.192	ACP
P159	8	274	1.75	1.66	ACP
P160	8	321	2.05	2.581	DI
P161	8	30	0.19	0.028	ACP
P162	8	78	0.5	0.163	ACP
P163	8	69	0.44	0.129	ACP
P164	6	105	1.2	1.15	ACP
P165	6	71	0.8	0.551	ACP
P166	8	36	0.23	0.039	ACP
P167	2	4	0.46	0.693	ACP
P168	8	290	1.85	2.995	Steel
P169	4	4	0.1	0.028	ACP
P170	4	49	1.24	3.215	ACP
P171	6	189	2.14	4.611	ACP
P172	8	152	0.97	0.555	ACP
P173	8	90	0.58	0.212	ACP
P174	6	8	0.09	0.017	Steel
P175	2	4	0.46	0.693	ACP
P176	2	4	0.46	0.692	ACP
P177	2	4	0.46	0.693	ACP
P178	6	13	0.15	0.025	ACP
P179	8	84	0.54	0.187	ACP
P180	8	89	0.57	0.206	ACP
P181	4	23	0.58	0.489	ACP
P182	6	57	0.64	0.364	ACP
P183	6	41	0.47	0.204	ACP
P184	2	4	0.46	0.692	ACP
P185	8	4	0.03	0.001	ACP
P186	8	41	0.26	0.048	ACP
P187	4	4	0.11	0.024	ACP
P188	4	4	0.11	0.024	ACP
P189	8	72	0.46	0.14	ACP
P190	8	327	2.09	2.31	ACP
P191	8	266	1.7	1.577	ACP
P192	8	9	0.06	0.003	PVC
P193	12	4	0.01	0	PVC
P194	8	184	1.17	1.082	ACP
P195	6	4	0.05	0.003	ACP
P196	6	12	0.13	0.019	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P197	8	27	0.17	0.023	ACP
P198	8	40	0.25	0.047	ACP
P199	6	17	0.19	0.037	ACP
P200	6	28	0.32	0.1	ACP
P201	8	87	0.55	0.198	ACP
P202	8	78	0.5	0.163	ACP
P203	4	10	0.26	0.109	ACP
P204	4	8	0.19	0.063	ACP
P205	8	43	0.27	0.054	ACP
P206	8	53	0.34	0.078	ACP
P207	8	75	0.48	0.151	ACP
P208	8	149	0.95	0.539	ACP
P209	6	0	0	0	ACP
P210	6	38	0.43	0.175	ACP
P211	6	42	0.48	0.212	ACP
P212	6	19	0.21	0.046	ACP
P213	6	78	0.88	0.651	ACP
P214	6	71	0.81	0.558	ACP
P215	6	51	0.58	0.299	ACP
P216	8	156	1	0.588	ACP
P217	8	150	0.96	0.546	ACP
P218	8	179	1.14	0.755	ACP
P219	8	185	1.18	0.804	ACP
P220	6	77	0.87	0.637	ACP
P221	6	57	0.65	0.371	ACP
P222	6	59	0.66	0.387	ACP
P223	6	41	0.47	0.204	ACP
P224	6	33	0.38	0.134	ACP
P225	6	35	0.4	0.151	ACP
P226	6	46	0.52	0.249	ACP
P227	6	84	0.96	0.759	ACP
P228	6	43	0.48	0.215	ACP
P229	6	56	0.64	0.356	ACP
P230	6	58	0.66	0.382	ACP
P231	6	49	0.56	0.281	ACP
P232	3	4	0.2	0.096	ACP
P233	6	4	0.05	0.003	ACP
P234	6	11	0.12	0.016	ACP
P235	6	5	0.05	0.004	ACP
P236	6	8	0.09	0.01	ACP
P237	6	4	0.05	0.004	ACP
P238	6	10	0.11	0.013	ACP
P239	6	16	0.18	0.038	DI
P240	6	7	0.08	0.01	DI
P241	6	28	0.32	0.115	DI
P242	6	15	0.17	0.035	DI
P243	6	20	0.23	0.053	ACP
P244	6	14	0.16	0.027	ACP
P245	4	3	0.07	0.01	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P246	4	12	0.3	0.143	ACP
P247	8	9	0.06	0.003	ACP
P248	8	16	0.1	0.009	ACP
P249	8	17	0.11	0.01	ACP
P250	6	78	0.89	0.662	ACP
P251	6	41	0.47	0.203	ACP
P252	6	121	1.37	1.474	ACP
P253	6	137	1.55	1.869	ACP
P254	8	125	0.79	0.386	ACP
P255	8	80	0.51	0.17	ACP
P256	4	13	0.32	0.164	ACP
P257	2	10	0.98	2.867	ACP
P258	2	4	0.46	0.692	ACP
P259	6	54	0.62	0.389	DI
P260	6	79	0.9	0.68	ACP
P261	8	115	0.74	0.334	ACP
P262	8	53	0.34	0.08	ACP
P263	6	57	0.65	0.371	ACP
P264	6	4	0.05	0.003	ACP
P265	6	53	0.6	0.317	ACP
P266	6	44	0.49	0.224	ACP
P267	8	36	0.23	0.044	DI
P268	8	47	0.3	0.074	DI
P269	6	48	0.55	0.271	ACP
P270	6	47	0.54	0.261	ACP
P271	6	26	0.29	0.085	ACP
P272	6	26	0.29	0.085	ACP
P273	6	27	0.31	0.095	ACP
P274	6	114	1.3	1.338	ACP
P275	4	25	0.65	0.595	ACP
P276	4	4	0.11	0.024	ACP
P277	6	47	0.53	0.258	ACP
P278	6	70	0.8	0.472	PVC
P279	6	199	2.26	3.746	ACP
P280	6	12	0.14	0.034	Steel
P281	6	56	0.63	0.572	Steel
P282	6	11	0.12	0.018	ACP
P283	6	140	1.59	1.948	ACP
P284	6	73	0.83	0.583	ACP
P285	6	213	2.41	4.217	ACP
P286	6	76	0.86	0.846	ACP
P287	8	23	0.15	0.023	ACP
P288	8	76	0.48	0.21	ACP
P289	6	48	0.54	0.265	ACP
P290	6	53	0.6	0.317	ACP
P291	6	49	0.56	0.282	ACP
P292	6	75	0.85	0.612	ACP
P293	6	91	1.03	0.869	ACP
P294	6	96	1.09	1.309	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P295	6	31	0.36	0.167	ACP
P296	6	79	0.89	0.67	ACP
P297	6	105	1.19	1.137	ACP
P298	6	35	0.4	0.15	ACP
P299	4	6	0.16	0.043	ACP
P300	4	35	0.9	1.092	ACP
P301	4	26	0.67	0.637	ACP
P302	4	18	0.47	0.321	ACP
P303	4	12	0.31	0.149	ACP
P304	6	93	1.06	0.915	ACP
P305	6	89	1.01	0.836	ACP
P306	6	94	1.07	0.931	ACP
P307	6	88	1	0.821	ACP
P308	6	23	0.27	0.071	ACP
P309	6	74	0.84	0.598	ACP
P310	6	13	0.15	0.029	DI
P311	6	4	0.05	0.004	DI
P312	10	24	0.1	0.006	ACP
P313	12	13	0.04	0.001	ACP
P314	6	2	0.02	0.001	ACP
P315	6	4	0.05	0.003	ACP
P316	6	2	0.03	0.001	ACP
P317	6	22	0.24	0.061	ACP
P318	6	2	0.02	0.001	ACP
P319	6	13	0.14	0.023	ACP
P320	6	8	0.09	0.01	ACP
P321	6	9	0.1	0.012	ACP
P322	12	88	0.25	0.028	ACP
P323	12	85	0.24	0.026	ACP
P324	12	95	0.27	0.033	ACP
P325	6	13	0.15	0.025	ACP
P326	6	9	0.1	0.012	ACP
P327	6	4	0.05	0.003	ACP
P328	8	22	0.14	0.018	ACP
P329	8	22	0.14	0.018	ACP
P330	12	61	0.17	0.014	ACP
P331	12	104	0.3	0.038	ACP
P332	12	126	0.36	0.055	ACP
P333	4	2	0.06	0.009	DI
P334	6	26	0.29	0.085	ACP
P335	6	41	0.47	0.204	ACP
P336	6	13	0.15	0.024	ACP
P337	6	15	0.17	0.031	ACP
P338	8	43	0.27	0.054	ACP
P339	8	155	0.99	0.578	ACP
P340	6	87	0.99	0.804	ACP
P341	6	58	0.66	0.382	ACP
P342	4	19	0.48	0.396	DI
P343	4	17	0.44	0.334	DI

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P344	6	100	1.13	1.033	ACP
P345	6	30	0.34	0.111	ACP
P346	6	53	0.6	0.377	DI
P347	6	46	0.52	0.288	DI
P348	6	127	1.44	1.884	DI
P349	6	73	0.83	0.674	DI
P350	6	82	0.93	0.835	DI
P351	6	88	1	0.954	DI
P352	6	70	0.79	0.619	DI
P353	6	71	0.81	0.647	DI
P354	6	176	2	4.845	Steel
P355	6	24	0.27	0.116	Steel
P356	6	156	1.77	3.855	Steel
P357	6	90	1.03	1.085	ACP
P358	6	69	0.78	0.842	Steel
P359	6	80	0.9	1.11	Steel
P360	6	34	0.38	0.226	Steel
P361	6	231	2.62	7.988	Steel
P362	6	124	1.4	2.513	Steel
P363	8	182	1.16	1.062	ACP
P364	8	330	2.11	3.197	ACP
P365	6	52	0.59	0.308	ACP
P366	6	61	0.69	0.411	ACP
P367	6	12	0.14	0.029	ACP
P368	6	9	0.1	0.017	ACP
P369	6	54	0.61	0.332	ACP
P370	6	98	1.11	1.008	ACP
P371	6	56	0.63	0.351	ACP
P372	6	69	0.79	0.724	ACP
P373	6	59	0.67	0.647	Steel
P374	6	51	0.57	0.479	Steel
P375	8	194	1.24	1.191	ACP
P376	8	185	1.18	1.091	ACP
P377	6	11	0.12	0.018	ACP
P378	6	20	0.23	0.054	ACP
P379	6	9	0.1	0.012	ACP
P380	12	154	0.44	0.079	ACP
P381	12	86	0.25	0.027	ACP
P382	12	75	0.21	0.021	ACP
P383	6	60	0.68	0.407	ACP
P384	6	114	1.29	1.319	ACP
P385	6	107	1.22	1.189	ACP
P386	6	13	0.14	0.023	ACP
P387	4	13	0.34	0.18	ACP
P388	4	21	0.54	0.422	ACP
P389	6	108	1.23	1.203	ACP
P390	6	72	0.82	0.565	ACP
P391	12	161	0.46	0.1	DI
P392	6	79	0.9	0.924	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P393	6	87	0.98	0.801	ACP
P394	8	114	0.73	0.33	ACP
P395	8	106	0.67	0.284	ACP
P396	10	124	0.51	0.129	ACP
P397	8	4	0.03	0.001	ACP
P398	8	225	1.44	1.155	ACP
P399	8	221	1.41	1.113	ACP
P400	8	34	0.22	0.041	DI
P401	8	54	0.35	0.095	DI
P402	8	204	1.3	1.116	DI
P403	6	4	0.05	0.003	ACP
P404	6	13	0.15	0.024	ACP
P405	8	0	0	0	DI
P406	99	0	0	0	DI
P407	99	598	0.02	0	DI
P408	8	0	0	0	DI
P409	8	0	0	0	DI
P410	8	439	2.8	3.976	DI
P411	8	0	0	0	DI
P412	6	107	1.21	1.177	ACP
P413	6	102	1.16	1.088	ACP
P414	10	(N/A)	(N/A)	(N/A)	DI
P415	8	(N/A)	(N/A)	(N/A)	DI
P416	12	(N/A)	(N/A)	(N/A)	DI
P417	12	(N/A)	(N/A)	(N/A)	DI
P418	6	73	0.83	0.511	PVC
P419	6	76	0.87	0.552	PVC
P420	12	(N/A)	(N/A)	(N/A)	DI
P421	6	18	0.21	0.045	ACP
P422	6	15	0.17	0.032	ACP
P423	12	(N/A)	(N/A)	(N/A)	DI
P424	10	81	0.33	0.095	Steel
P425	10	88	0.36	0.11	Steel
P426	10	165	0.68	0.358	Steel
P427	10	27	0.11	0.007	PVC
P428	12	0	0	0	DI
P429	12	67	0.19	0.017	DI
P430	6	109	1.24	1.233	ACP
P431	8	146	0.93	0.708	ACP
P432	6	45	0.51	0.235	ACP
P433	12	667	1.89	1.388	DI
P434	12	445	1.26	0.656	DI
P435	10	217	0.89	0.365	DI
P436	10	213	0.87	0.351	DI
P437	6	80	0.91	0.608	PVC
P438	6	4	0.05	0.003	PVC
P439	6	16	0.18	0.036	ACP
P440	8	81	0.52	0.176	DI
P441	10	175	0.72	0.245	DI

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P442	12	(N/A)	(N/A)	(N/A)	DI
P443	6	38	0.44	0.177	ACP
P444	10	180	0.73	0.257	DI
P445	10	11	0.04	0.001	DI
P446	6	4	0.05	0.003	DI
P447	12	305	0.87	0.327	DI
P448	12	313	0.89	0.342	DI
P449	12	301	0.85	0.319	DI
P450	12	333	0.95	0.384	DI
P451	12	415	1.18	0.578	DI
P452	8	78	0.5	0.141	PVC
P453	8	64	0.41	0.099	PVC
P454	8	60	0.38	0.087	PVC
P455	8	33	0.21	0.029	PVC
P456	8	27	0.17	0.019	PVC
P457	8	4	0.03	0.001	PVC
P458	6	4	0.05	0.003	PVC
P459	8	89	0.57	0.209	DI
P460	10	38	0.16	0.015	DI
P461	10	41	0.17	0.017	DI
P462	10	36	0.15	0.013	DI
P463	10	27	0.11	0.008	DI
P464	6	4	0.05	0.003	DI
P465	8	123	0.79	0.379	ACP
P466	8	113	0.72	0.322	ACP
P467	4	4	0.11	0.024	ACP
P468	4	12	0.3	0.145	ACP
P469	10	6	0.02	0.001	DI
P470	2	4	0.37	0.323	DI
P471	6	4	0.05	0.003	DI
P472	4	69	1.77	3.823	DI
P473	2	6	0.66	1.384	DI
P474	6	30	0.34	0.112	ACP
P475	6	22	0.25	0.065	ACP
P476	4	4	0.11	0.024	DI
P477	8	288	1.84	2.109	DI
P478	10	145	0.59	0.173	ACP
P479	12	141	0.4	0.067	ACP
P480	4	4	0.11	0.024	ACP
P481	6	4	0.05	0.003	DI
P482	6	60	0.69	0.475	DI
P483	6	15	0.17	0.037	DI
P484	6	83	0.94	0.736	ACP
P485	6	51	0.58	0.297	DI
P486	10	20	0.08	0.004	DI
P487	10	184	0.75	0.269	DI
P488	10	209	0.85	0.338	DI
P489	8	439	2.8	3.976	DI
P490	8	435	2.77	3.901	DI

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P491	8	439	2.8	3.976	DI
P492	8	0	0	0	DI
P493	8	0	0	0	DI
P494	8	598	3.82	7.055	DI
P495	8	598	3.82	7.055	DI
P496	8	0	0	0	DI
P497	8	0	0	0	DI
P498	12	1087	3.08	2.957	ACP
P499	10	1379	5.63	11.171	DI
P500	6	32	0.37	0.13	ACP
P501	6	30	0.34	0.109	ACP
P502	6	39	0.45	0.184	ACP
P503	6	35	0.4	0.148	ACP
P504	6	18	0.2	0.043	ACP
P505	6	4	0.05	0.003	ACP
P506	10	50	0.21	0.024	ACP
P507	10	61	0.25	0.035	ACP
P508	12	16	0.04	0.001	ACP
P509	12	237	0.67	0.176	ACP
P510	6	3	0.03	0.001	ACP
P511	6	15	0.17	0.03	ACP
P512	10	188	0.77	0.279	ACP
P513	10	169	0.69	0.228	ACP
P514	6	33	0.37	0.115	PVC
P515	6	18	0.21	0.039	PVC
P516	8	45	0.28	0.05	PVC
P517	8	25	0.16	0.017	PVC
P518	8	63	0.4	0.109	ACP
P519	8	5	0.03	0.001	ACP
P520	12	63	0.18	0.015	DI
P521	8	4	0.03	0.001	PVC
P522	8	4	0.03	0.001	PVC
P523	6	3	0.04	0.002	ACP
P524	6	3	0.04	0.002	ACP
P525	4	0	0	0	DI
P526	8	18	0.11	0.012	DI
P527	8	18	0.11	0.013	DI
P528	6	4	0.05	0.004	DI
P529	6	4	0.05	0.004	DI
P530	6	0	0	0	DI
P531	6	95	1.08	1.288	ACP
P532	6	95	1.08	1.288	ACP
P533	6	4	0.05	0.005	ACP
P534	6	4	0.05	0.003	ACP
P535	4	0	0	0	ACP
P536	6	142	1.61	2.71	ACP
P537	6	142	1.61	2.711	ACP
P538	8	193	1.23	1.187	ACP
P539	4	0	0	0	DI

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P540	8	218	1.39	1.091	ACP
P541	8	218	1.39	1.091	ACP
P542	4	4	0.11	0.027	ACP
P543	4	4	0.11	0.032	ACP
P544	6	97	1.1	1.227	ACP
P545	6	97	1.1	1.227	ACP
P546	4	52	1.31	3.575	ACP
P547	6	0	0	0	DI
P548	10	28	0.12	0.009	ACP
P549	10	28	0.12	0.008	ACP
P550	10	51	0.21	0.029	DI
P551	10	51	0.21	0.029	DI
P552	6	29	0.33	0.105	ACP
P553	6	29	0.33	0.105	ACP
P554	6	0	0	0	DI
P555	6	34	0.38	0.163	DI
P556	6	34	0.38	0.163	DI
P557	6	0	0	0	DI
P558	6	84	0.95	0.748	ACP
P559	6	89	1.01	0.842	ACP
P560	2	7	0.72	1.6	ACP
P561	8	21	0.13	0.014	ACP
P562	8	21	0.13	0.014	ACP
P563	4	0	0	0	ACP
P564	6	0	0	0	DI
P565	4	0	0	0	DI
P566	8	0	0	0	DI
P567	4	0	0	0	DI
P568	8	320	2.04	2.566	ACP
P569	8	320	2.04	2.566	ACP
P570	6	0	0	0	DI
P571	8	277	1.77	2.308	ACP
P572	8	277	1.77	2.308	ACP
P573	6	0	0	0	DI
P574	6	5	0.05	0.004	ACP
P575	6	5	0.05	0.004	ACP
P576	6	0	0	0	DI
P577	10	48	0.19	0.022	ACP
P578	10	48	0.19	0.022	ACP
P579	6	0	0	0	DI
P580	6	18	0.2	0.043	ACP
P581	6	18	0.2	0.043	ACP
P582	6	0	0	0	DI
P583	6	22	0.25	0.065	ACP
P584	6	22	0.25	0.065	ACP
P585	6	0	0	0	DI
P586	8	0	0	0	DI
P587	6	0	0	0	DI
P588	6	39	0.44	0.184	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P589	6	39	0.44	0.184	ACP
P590	6	0	0	0	DI
P591	4	6	0.16	0.044	ACP
P592	4	6	0.16	0.044	ACP
P593	6	0	0	0	DI
P594	8	0	0	0	DI
P595	8	0	0	0	DI
P596	8	0	0	0	DI
P597	8	0	0	0	DI
P598	10	1379	5.63	11.171	DI
P599	8	0	0	0	DI
P600	10	58	0.24	0.027	PVC
P601	10	30	0.12	0.008	PVC
P602	8	35	0.23	0.037	ACP
P603	8	193	1.23	0.871	ACP
P604	8	120	0.77	0.36	ACP
P605	8	253	1.62	1.433	ACP
P606	8	141	0.9	0.485	ACP
P607	8	53	0.34	0.092	ACP
P608	6	69	0.79	0.531	ACP
P609	6	69	0.79	0.531	ACP
P610	6	62	0.71	0.433	ACP
P611	6	62	0.71	0.433	ACP
P612	6	3	0.04	0.002	ACP
P613	6	3	0.04	0.002	ACP
P614	6	0	0	0	DI
P615	4	52	1.31	2.199	DI
P616	8	69	0.44	0.112	PVC
P617	8	69	0.44	0.112	PVC
P618	6	0	0	0	DI
P619	8	73	0.47	0.126	PVC
P620	8	73	0.47	0.126	PVC
P621	6	0	0	0	DI
P622	12	302	0.86	0.321	DI
P623	12	302	0.86	0.321	DI
P624	8	117	0.75	0.401	DI
P625	8	117	0.75	0.401	DI
P626	8	138	0.88	0.469	ACP
P627	8	138	0.88	0.468	ACP
P628	6	36	0.41	0.156	ACP
P629	6	36	0.41	0.156	ACP
P630	6	72	0.81	0.564	ACP
P631	8	0	0	0	DI
P632	8	0	0	0	DI
P633	8	0	0	0	DI
P634	6	0	0	0	DI
P635	6	72	0.81	0.564	ACP
P636	6	72	0.81	0.564	ACP
P637	1	0	0	0	PVC

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J1	86	3	178	40	169	36
J2	62	3	178	50	169	46
J3	62	3	178	50	169	46
J4	90	3	178	38	169	34
J5	88	3	178	39	169	35
J6	62	3	178	50	169	46
J7	62	3	178	50	169	46
J8	68	3	178	48	176	47
J9	68	3	178	48	176	47
J10	74	3	178	45	169	41
J11	73	4	178	45	169	42
J12	71	3	178	46	175	45
J13	86	3	178	40	169	36
J14	86	3	178	40	169	36
J15	71	3	178	46	173	44
J16	71	3	178	46	174	44
J17	87	3	178	39	169	35
J18	87	3	178	39	169	35
J19	87	3	178	39	169	36
J20	87	3	178	39	169	36
J21	70	3	178	47	171	44
J22	70	3	178	47	171	44
J23	70	3	178	47	171	44
J24	70	3	178	47	171	44
J25	87	3	178	39	169	35
J26	70	3	178	47	169	43
J27	70	3	178	47	169	43
J28	60	3	178	51	169	47
J29	76	3	178	44	170	41
J30	76	3	178	44	170	41
J31	60	3	178	51	169	47
J32	70	3	178	47	171	44
J33	70	3	178	47	171	44
J34	70	3	178	47	172	44
J35	70	3	178	47	172	44
J36	70	3	178	47	171	44
J37	68	3	178	48	172	45
J38	68	3	178	48	172	45
J39	62	3	178	50	169	46
J40	62	3	178	50	169	46
J41	64	3	178	49	169	46
J42	87	3	178	39	169	35
J43	86	3	178	40	169	36
J44	90	3	178	38	169	34
J45	90	3	178	38	169	34
J46	76	3	178	44	170	41
J47	90	3	178	38	169	34
J48	68	3	178	48	171	44
J49	74	3	178	45	169	41
J50	74	3	178	45	169	41
J51	68	3	178	48	171	45
J52	76	3	178	44	169	40
J53	76	3	178	44	169	40
J54	86	3	178	40	169	36
J55	86	3	178	40	169	36

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J56	90	3	178	38	169	34
J57	90	3	178	38	169	34
J58	76	3	178	44	169	40
J59	76	3	178	44	169	40
J60	76	3	178	44	169	40
J61	85	3	178	40	169	36
J62	72	3	178	46	170	43
J63	74	3	178	45	170	42
J64	68	3	178	48	172	45
J65	68	3	178	48	172	45
J66	76	3	178	44	169	40
J67	76	3	178	44	169	40
J68	76	3	178	44	169	40
J69	76	3	178	44	169	40
J70	86	3	178	40	169	36
J71	76	3	178	44	169	40
J72	74	3	178	45	169	41
J73	74	3	178	45	169	41
J74	74	3	178	45	170	42
J75	74	3	178	45	170	42
J76	85	3	178	40	169	36
J77	85	3	178	40	169	36
J78	74	3	178	45	171	42
J79	74	3	178	45	170	42
J80	78	3	178	43	169	39
J81	78	3	178	43	169	39
J82	85	3	178	40	169	36
J83	82	3	178	41	169	38
J84	78	3	178	43	169	39
J85	78	3	178	43	169	39
J86	64	3	178	49	171	46
J87	64	3	178	49	171	46
J88	72	3	178	46	169	42
J89	74	3	178	45	175	44
J90	74	3	178	45	175	44
J91	72	3	178	46	170	42
J92	85	3	178	40	169	36
J93	82	3	178	41	169	38
J94	80	3	178	42	169	38
J95	80	3	178	42	169	38
J96	82	3	178	41	169	38
J97	78	3	178	43	169	40
J98	85	3	178	40	169	36
J99	85	3	178	40	169	36
J100	68	3	178	48	176	47
J101	70	3	178	47	170	43
J102	72	3	178	46	170	43
J103	78	3	178	43	169	39
J104	71	3	178	46	169	43
J105	70	3	178	47	176	46
J106	72	3	178	46	169	42
J107	72	3	178	46	169	42
J108	80	3	178	42	169	38
J109	90	3	178	38	169	34
J110	90	3	178	38	169	34

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J111	85	3	178	40	169	36
J112	64	3	178	49	171	46
J113	62	3	178	50	171	47
J114	68	3	178	47	169	44
J115	68	3	178	47	169	44
J116	80	3	178	42	169	38
J117	72	3	178	46	169	42
J118	73	3	178	45	169	42
J119	60	3	178	51	169	47
J120	62	3	178	50	169	46
J121	76	3	178	44	169	40
J122	76	3	178	44	169	40
J123	66	3	178	48	173	46
J124	72	3	179	46	171	43
J125	65	3	179	49	171	46
J126	70	3	178	47	171	44
J127	70	3	178	47	171	44
J128	78	3	178	43	169	39
J129	78	3	178	43	169	39
J130	80	3	178	42	169	38
J131	80	3	178	42	169	38
J132	80	3	178	42	169	38
J133	76	3	178	44	169	40
J134	76	3	178	44	169	40
J135	72	3	178	46	171	43
J136	62	3	178	50	169	47
J137	61	3	178	51	169	47
J138	76	3	178	44	169	40
J139	75	3	178	44	169	41
J140	62	3	178	50	169	46
J141	62	3	178	50	169	46
J142	76	3	178	44	169	40
J143	84	3	178	41	169	37
J144	82	3	178	41	169	38
J145	85	3	178	40	169	36
J146	85	3	178	40	169	36
J147	74	3	178	45	175	44
J148	72	3	178	46	171	43
J149	72	3	178	46	171	43
J150	64	3	178	49	171	46
J151	64	3	178	49	171	46
J152	75	3	178	44	169	41
J153	75	3	178	44	169	41
J154	90	3	178	38	169	34
J155	62	3	178	50	171	47
J156	74	3	178	45	169	41
J157	62	3	178	50	169	46
J158	74	3	178	45	175	44
J159	85	3	178	40	169	36
J160	65	3	178	49	169	45
J161	64	3	178	49	169	46
J162	60	3	178	51	169	47
J163	60	3	178	51	169	47
J164	70	3	178	47	171	44
J165	72	3	178	46	170	42

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J166	72	3	178	46	170	42
J167	70	3	178	47	169	43
J168	70	3	178	47	169	43
J169	66	3	178	48	172	46
J170	64	3	178	49	172	47
J171	86	3	178	40	169	36
J172	70	13	178	47	172	44
J173	76	3	178	44	169	40
J174	72	3	178	46	170	42
J175	72	3	178	46	170	42
J176	78	3	178	43	169	39
J177	90	3	178	38	169	34
J178	90	3	178	38	169	34
J179	75	3	178	44	169	41
J180	78	3	178	43	169	39
J181	78	3	178	43	169	39
J182	70	3	178	47	171	44
J183	72	3	178	46	170	42
J184	62	3	178	50	169	46
J185	62	3	178	50	169	46
J186	62	3	178	50	169	46
J187	62	3	178	50	169	46
J188	70	3	178	47	170	43
J189	70	3	178	47	170	43
J190	68	3	178	47	169	44
J191	68	3	178	47	169	44
J192	70	3	178	47	171	44
J193	70	3	178	47	177	46
J194	72	3	178	46	176	45
J195	72	3	178	46	176	45
J196	90	3	178	38	169	34
J197	70	3	178	47	169	43
J198	70	3	178	47	169	43
J199	62	3	178	50	169	46
J200	62	3	178	50	169	46
J201	62	3	178	50	169	46
J202	64	3	178	49	169	45
J203	72	3	178	46	176	45
J204	68	3	178	48	170	44
J205	72	3	178	46	171	43
J206	72	3	178	46	172	43
J207	62	3	178	50	169	46
J208	64	3	178	49	171	46
J209	62	3	178	50	171	47
J210	86	3	178	40	169	36
J211	74	3	178	45	169	41
J212	64	3	178	49	169	46
J213	86	3	178	40	169	36
J214	74	3	178	45	169	41
J215	68	3	178	48	171	45
J216	68	3	178	48	171	45
J217	74	3	178	45	170	41
J218	72	3	178	46	170	42
J219	72	3	178	46	169	42
J220	64	3	178	49	169	45

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J221	74	3	178	45	169	41
J222	74	3	178	45	169	41
J223	90	3	178	38	169	34
J224	86	3	178	40	169	36
J225	73	3	178	45	169	42
J226	73	3	178	45	169	42
J227	68	3	178	47	169	44
J228	68	3	178	48	173	46
J229	66	3	178	49	170	45
J230	62	3	178	50	170	47
J231	73	3	178	45	169	42
J232	86	3	178	40	169	36
J233	62	3	178	50	171	47
J234	86	3	178	40	169	36
J235	72	3	178	46	169	42
J236	74	3	178	45	169	41
J237	86	3	178	40	169	36
J238	86	3	178	40	169	36
J239	73	3	178	45	170	42
J240	73	3	178	45	171	43
J241	86	3	178	40	169	36
J242	68	3	178	48	171	45
J243	62	3	178	50	171	47
J244	86	3	178	40	169	36
J245	68	3	178	47	169	44
J246	72	3	178	46	169	42
J247	60	3	178	51	169	47
J248	60	3	178	51	169	47
J249	73	3	178	45	170	42
J250	74	3	178	45	169	41
J251	86	3	178	40	169	36
J252	86	3	178	40	169	36
J253	60	3	178	51	169	47
J254	60	3	178	51	169	47
J255	62	3	178	50	169	46
J256	74	3	178	45	175	44
J257	62	3	178	50	171	47
J258	62	3	178	50	171	47
J259	64	3	178	49	170	46
J260	90	3	178	38	169	34
J261	72	3	178	46	171	43
J262	64	3	178	49	171	46
J263	70	3	178	47	170	43
J264	86	3	178	40	169	36
J265	78	3	178	43	169	39
J266	86	3	178	40	169	36
J267	68	3	178	48	171	44
J268	72	3	178	46	169	42
J269	72	3	178	46	169	42
J270	72	3	178	46	169	42
J271	72	3	178	46	169	42
J272	68	3	178	47	169	44
J273	68	3	178	47	169	44
J274	84	3	178	41	169	37
J275	68	3	178	47	169	44

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J276	86	3	178	40	169	36
J277	86	3	178	40	169	36
J278	63	3	178	50	171	47
J279	64	3	178	49	171	46
J280	68	3	178	48	171	44
J281	68	3	178	48	170	44
J282	86	3	178	40	169	36
J283	78	3	178	43	169	39
J284	62	3	178	50	169	46
J285	60	3	178	51	169	47
J286	76	3	178	44	169	40
J287	76	3	178	44	169	40
J288	76	3	178	44	169	40
J289	72	3	178	46	171	43
J290	62	3	178	50	169	46
J291	60	3	178	51	169	47
J292	60	3	178	51	169	47
J293	76	3	178	44	169	40
J294	76	3	178	44	169	40
J295	70	3	178	47	169	43
J296	62	3	178	50	169	46
J297	90	3	178	38	169	34
J298	64	3	178	49	169	46
J299	68	3	178	48	176	47
J300	74	3	178	45	175	44
J301	70	3	178	47	169	43
J302	64	3	178	49	169	45
J303	64	3	178	49	175	48
J304	62	3	178	50	171	47
J305	62	3	178	50	171	47
J306	72	3	178	46	177	45
J307	86	3	178	40	169	36
J308	86	3	178	40	169	36
J309	60	3	178	51	171	48
J310	72	3	178	46	171	43
J311	68	3	178	48	171	44
J312	84	3	178	41	169	37
J313	68	3	178	48	172	45
J314	68	3	178	48	172	45
J315	74	3	178	45	174	43
J316	60	3	178	51	169	47
J317	82	3	178	41	169	38
J318	70	3	178	47	169	43
J319	70	3	178	47	169	43
J320	68	3	178	47	169	44
J321	66	3	178	48	169	45
J322	60	3	178	51	171	48
J323	70	3	178	47	169	43
J324	64	3	178	49	169	45
J325	70	3	178	47	169	43
J326	76	3	178	44	169	40
J327	74	3	178	45	169	41
J328	85	3	178	40	169	36
J329	66	3	178	48	169	45
J330	76	3	178	44	169	40

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J331	62	3	178	50	169	46
J332	60	3	178	51	171	48
J333	72	3	178	46	170	42
J334	64	3	178	49	169	46
J335	72	3	178	46	170	42
J336	74	3	178	45	169	41
J337	70	3	178	47	169	43
J338	90	3	178	38	169	34
J339	72	3	178	46	174	44
J340	74	3	178	45	175	44
J341	72	3	178	46	176	45
J342	66	3	178	48	173	46
J343	68	3	178	48	171	45
J344	68	3	178	48	171	45
J345	68	3	178	48	171	45
J346	68	3	178	48	175	46
J347	62	3	178	50	172	48
J348	62	3	178	50	172	48
J349	62	3	178	50	171	47
J350	62	3	178	50	171	47
J351	62	3	178	50	171	47
J352	72	3	178	46	171	43
J353	64	3	179	50	171	46
J354	60	3	178	51	169	47
J355	60	3	178	51	169	47
J356	60	3	178	51	169	47
J357	64	3	178	49	169	46
J358	64	3	178	49	169	46
J359	64	3	178	49	169	46
J360	64	3	178	49	169	46
J361	64	3	178	49	169	46
J362	64	3	178	49	169	46
J363	68	3	178	48	170	44
J364	76	3	178	44	169	40
J365	76	3	178	44	169	40
J366	86	3	178	40	169	36
J367	86	3	178	40	169	36
J368	74	3	178	45	169	41
J369	70	3	178	47	170	43
J370	86	3	178	40	169	36
J371	86	3	178	40	169	36
J372	76	3	178	44	169	40
J373	85	3	178	40	169	36
J374	62	3	178	50	171	47
J375	62	3	178	50	171	47
J376	72	3	178	46	177	46
J377	72	3	179	46	171	43
J378	62	3	178	50	169	46
J379	72	3	178	46	169	42
J380	73	3	178	45	169	42
J381	68	3	178	48	171	44
J382	70	3	178	47	170	43
J383	76	3	178	44	169	40
J384	74	3	178	45	169	41
J385	86	3	178	40	169	36

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J386	74	3	178	45	169	41
J387	90	3	178	38	169	34
J388	78	3	178	43	169	39
J389	72	3	178	46	177	45
J390	91	3	178	37	169	34
J391	80	3	178	42	169	39
J392	84	3	178	41	169	37
J393	85	3	178	40	169	36
J394	83	3	178	41	169	37
J395	80	3	178	42	169	39
J396	83	3	178	41	169	37
J397	86	3	178	40	169	36
J398	87	3	178	39	169	36
J399	87	3	178	39	169	36
J400	85	3	178	40	169	36
J401	86	3	178	40	169	36
J402	70	3	178	47	169	43
J403	76	3	178	44	169	40
J404	77	3	178	43	169	40
J405	76	3	178	44	169	40
J406	76	3	178	44	169	40
J407	76	3	178	44	169	40
J408	76	3	178	44	169	40
J409	76	21	178	44	169	40
J410	76	3	178	44	169	40
J411	76	3	178	44	169	40
J412	76	3	178	44	169	40
J413	78	3	178	43	169	39
J414	75	3	178	44	169	41
J415	75	3	178	44	169	41
J416	70	3	178	47	169	43
J417	64	3	178	49	169	45
J418	70	3	178	47	169	43
J419	66	3	178	48	169	45
J420	66	3	178	48	169	45
J421	83	3	178	41	169	37
J422	65	3	178	49	169	45
J423	64	3	178	49	169	46
J424	64	3	179	50	171	46
J425	71	3	178	46	171	43
J426	69	3	178	47	171	44
J427	87	3	178	39	169	36
J428	72	3	178	46	169	42
J429	90	2	178	38	169	34
J430	90	3	178	38	169	34
J431	63	9	178	50	171	47
J432	64	7	178	49	169	45
J433	77	156	178	44	169	40
J434	77	8	178	44	169	40
J435	74	13	178	45	169	41
J436	60	10	178	51	169	47
J437	62	19	178	50	169	46
J438	70	45	178	47	169	43
J439	72	43	178	46	177	45
J440	78	0	178	43	169	39

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (Maximum) (ft)	Pressure (Maximum) (psi)	Hydraulic Grade (Minimum) (ft)	Pressure (Minimum) (psi)
J441	74	0	178	45	175	44
J442	62	0	178	50	169	46
J443	85	0	178	40	169	36
J444	86	0	178	40	169	36
J445	86	0	178	40	169	36
J446	80	0	178	42	169	38
J447	73	0	178	45	169	42
J448	69	0	178	47	170	44
J449	73	0	178	46	170	42
J450	75	5	178	44	169	41
J451	75	0	178	44	169	41
J452	63	0	178	50	169	46
J453	76	0	178	44	169	40
J454	86	0	178	40	169	36
J455	76	0	178	44	169	40
J456	78	0	178	43	169	39
J457	72	0	178	46	169	42
J458	62	0	178	50	171	47
J459	67	0	178	48	169	45
J460	63	0	178	50	171	47
J461	60	0	178	51	169	47
J462	61	0	178	50	169	47
J463	60	0	178	51	178	51
J464	62	0	178	50	169	46
J465	86	0	178	40	169	36
J466	68	0	178	48	171	44
J467	78	0	178	43	169	39
J468	76	0	178	44	169	40
J469	81	0	178	42	169	38
J470	60	0	178	51	169	47
J471	76	0	178	44	169	40
J472	76	0	178	44	169	40
J473	76	0	178	44	169	40
J474	76	0	178	44	169	40
J475	70	0	178	47	169	43
J476	75	0	178	44	169	41
J477	73	0	178	46	169	42
J478	88	0	178	39	169	35
J479	68	0	178	48	171	45
J480	68	0	178	48	171	45
J481	68	0	178	48	171	45
J482	68	0	178	48	171	45
J483	68	0	178	48	172	45
J484	79	0	178	43	172	40

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P1	8	59	0.38	0.097	ACP
P2	2	4	0.46	0.693	ACP
P3	2	4	0.46	0.692	ACP
P4	4	29	0.75	0.773	ACP
P5	2	6	0.64	1.3	ACP
P6	2	4	0.46	0.693	ACP
P7	6	286	3.25	8.47	DI
P8	4	13	0.33	0.166	ACP
P9	2	4	0.46	0.692	ACP
P10	2	4	0.46	0.692	ACP
P11	2	4	0.46	0.693	ACP
P12	2	4	0.46	0.692	ACP
P13	4	19	0.48	0.344	ACP
P14	4	21	0.53	0.408	ACP
P15	2	4	0.46	0.693	ACP
P16	2	4	0.46	0.693	ACP
P17	2	4	0.46	0.692	ACP
P18	2	4	0.46	0.693	ACP
P19	8	68	0.44	0.11	PVC
P20	6	4	0.05	0.003	ACP
P21	4	4	0.11	0.024	ACP
P22	4	24	0.61	0.528	ACP
P23	4	9	0.23	0.085	ACP
P24	2	4	0.46	0.693	ACP
P25	6	4	0.05	0.003	ACP
P26	8	4	0.03	0.001	ACP
P27	2	4	0.46	0.693	ACP
P28	2	4	0.46	0.693	ACP
P29	4	4	0.11	0.024	ACP
P30	2	4	0.46	0.693	ACP
P31	4	31	0.8	0.884	ACP
P32	4	45	1.14	1.679	ACP
P33	2	4	0.46	0.692	ACP
P34	2	4	0.46	0.693	ACP
P35	2	4	0.46	0.693	ACP
P36	8	4	0.03	0.001	ACP
P37	4	18	0.45	0.299	ACP
P38	2	4	0.46	0.692	ACP
P39	6	4	0.05	0.003	ACP
P40	2	4	0.46	0.692	ACP
P41	6	0	0	0	ACP
P42	4	16	0.41	0.257	ACP
P43	8	148	0.95	0.725	ACP
P44	10	18	0.08	0.004	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P45	4	4	0.11	0.024	ACP
P46	4	26	0.66	0.621	ACP
P47	8	4	0.03	0.001	ACP
P48	6	4	0.05	0.003	ACP
P49	4	19	0.48	0.344	ACP
P50	2	1	0.1	0.053	DI
P51	6	0	0	0	ACP
P52	6	101	1.14	1.059	ACP
P53	6	62	0.7	0.493	DI
P54	8	4	0.03	0.001	ACP
P55	6	68	0.77	0.591	DI
P56	4	31	0.8	0.879	ACP
P57	8	283	1.81	1.763	ACP
P58	6	4	0.05	0.003	ACP
P59	10	11	0.04	0.001	ACP
P60	8	28	0.18	0.024	ACP
P61	6	125	1.42	1.575	ACP
P62	6	4	0.05	0.003	PVC
P63	12	118	0.34	0.056	DI
P64	6	4	0.05	0.003	ACP
P65	4	7	0.18	0.056	ACP
P66	12	59	0.17	0.016	DI
P67	6	4	0.05	0.003	ACP
P68	4	27	0.69	0.667	ACP
P69	4	9	0.23	0.085	ACP
P70	6	122	1.38	1.504	ACP
P71	4	9	0.23	0.085	ACP
P72	4	16	0.4	0.248	ACP
P73	4	5	0.14	0.033	ACP
P74	6	24	0.28	0.076	ACP
P75	6	13	0.15	0.025	ACP
P76	6	143	1.62	2.011	ACP
P77	6	49	0.55	0.275	ACP
P78	6	93	1.06	0.913	ACP
P79	4	48	1.23	1.949	ACP
P80	6	43	0.49	0.222	ACP
P81	6	46	0.52	0.248	ACP
P82	6	104	1.18	1.119	ACP
P83	10	25	0.1	0.007	ACP
P84	8	104	0.66	0.276	ACP
P85	4	11	0.27	0.119	ACP
P86	4	34	0.86	1.005	ACP
P87	8	161	1.03	0.619	ACP
P88	6	0	0	0	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P89	6	26	0.3	0.089	ACP
P90	6	78	0.88	0.652	ACP
P91	4	21	0.54	0.429	ACP
P92	6	19	0.21	0.047	ACP
P93	8	25	0.16	0.026	ACP
P94	4	11	0.29	0.131	ACP
P95	4	35	0.9	1.089	ACP
P96	6	57	0.65	0.37	ACP
P97	6	4	0.05	0.003	ACP
P98	4	29	0.73	0.746	ACP
P99	8	51	0.33	0.074	ACP
P100	6	25	0.28	0.08	ACP
P101	4	8	0.22	0.105	ACP
P102	4	4	0.11	0.024	ACP
P103	4	11	0.29	0.134	ACP
P104	6	32	0.37	0.148	DI
P105	4	4	0.09	0.017	ACP
P106	6	97	1.1	0.988	ACP
P107	6	5	0.06	0.004	ACP
P108	6	36	0.41	0.158	ACP
P109	12	136	0.39	0.055	PVC
P110	6	43	0.49	0.222	ACP
P111	6	62	0.7	0.43	ACP
P112	6	147	1.67	2.13	ACP
P113	6	150	1.7	2.213	ACP
P114	6	78	0.89	0.664	ACP
P115	6	4	0.05	0.003	ACP
P116	8	173	1.1	0.706	ACP
P117	2	4	0.46	0.692	ACP
P118	8	360	2.3	2.748	ACP
P119	6	65	0.73	0.464	ACP
P120	8	427	2.72	3.776	ACP
P121	2	4	0.46	0.693	ACP
P122	6	87	0.99	0.804	ACP
P123	4	22	0.56	0.45	ACP
P124	4	19	0.48	0.34	ACP
P125	6	62	0.7	0.429	ACP
P126	6	196	2.22	3.628	ACP
P127	6	493	5.6	20.025	ACP
P128	6	294	3.34	7.683	ACP
P129	8	228	1.46	1.184	ACP
P130	2	4	0.46	0.693	ACP
P131	2	4	0.46	0.693	ACP
P132	8	136	0.87	0.451	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P133	8	92	0.58	0.218	ACP
P134	8	145	0.92	0.51	ACP
P135	6	141	1.6	1.964	ACP
P136	4	15	0.37	0.212	ACP
P137	6	59	0.67	0.395	ACP
P138	4	14	0.36	0.197	ACP
P139	6	42	0.48	0.209	ACP
P140	4	13	0.34	0.181	ACP
P141	6	47	0.53	0.256	ACP
P142	6	18	0.2	0.043	ACP
P143	6	17	0.19	0.043	DI
P144	4	16	0.42	0.266	ACP
P145	8	117	0.75	0.345	ACP
P146	8	9	0.06	0.003	ACP
P147	6	71	0.81	0.553	ACP
P148	4	18	0.46	0.358	DI
P149	6	26	0.29	0.083	ACP
P150	8	21	0.13	0.014	ACP
P151	6	4	0.05	0.003	ACP
P152	6	34	0.39	0.145	ACP
P153	10	57	0.23	0.027	PVC
P154	10	52	0.21	0.023	PVC
P155	12	189	0.54	0.116	ACP
P156	4	13	0.34	0.181	ACP
P157	2	4	0.46	0.693	ACP
P158	8	116	0.74	0.339	ACP
P159	8	135	0.86	0.446	ACP
P160	8	254	1.62	1.674	DI
P161	8	46	0.29	0.061	ACP
P162	8	45	0.29	0.058	ACP
P163	8	68	0.43	0.125	ACP
P164	6	39	0.44	0.183	ACP
P165	6	41	0.46	0.196	ACP
P166	8	34	0.22	0.034	ACP
P167	2	4	0.46	0.693	ACP
P168	8	86	0.55	0.314	Steel
P169	4	3	0.07	0.015	ACP
P170	4	40	1.01	2.19	ACP
P171	6	143	1.62	2.742	ACP
P172	8	25	0.16	0.02	ACP
P173	8	70	0.45	0.132	ACP
P174	6	23	0.26	0.11	Steel
P175	2	4	0.46	0.693	ACP
P176	2	4	0.46	0.692	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P177	2	4	0.46	0.693	ACP
P178	6	13	0.15	0.025	ACP
P179	8	43	0.27	0.053	ACP
P180	8	46	0.29	0.061	ACP
P181	4	8	0.19	0.063	ACP
P182	6	17	0.19	0.037	ACP
P183	6	71	0.81	0.555	ACP
P184	2	4	0.46	0.693	ACP
P185	8	4	0.03	0.001	ACP
P186	8	134	0.86	0.444	ACP
P187	4	4	0.11	0.023	ACP
P188	4	4	0.11	0.024	ACP
P189	8	364	2.32	2.812	ACP
P190	8	339	2.17	2.469	ACP
P191	8	349	2.23	2.601	ACP
P192	8	9	0.06	0.003	PVC
P193	12	4	0.01	0	PVC
P194	8	79	0.51	0.229	ACP
P195	6	4	0.05	0.003	ACP
P196	6	48	0.54	0.267	ACP
P197	8	181	1.16	0.775	ACP
P198	8	248	1.58	1.38	ACP
P199	6	214	2.43	4.261	ACP
P200	6	289	3.28	7.45	ACP
P201	8	238	1.52	1.275	ACP
P202	8	288	1.84	1.824	ACP
P203	4	60	1.54	2.93	ACP
P204	4	81	2.08	5.143	ACP
P205	8	252	1.61	1.426	ACP
P206	8	291	1.85	1.852	ACP
P207	8	712	4.54	9.725	ACP
P208	8	496	3.17	4.989	ACP
P209	6	0	0	0	ACP
P210	6	97	1.1	0.982	ACP
P211	6	193	2.19	3.523	ACP
P212	6	19	0.21	0.046	ACP
P213	6	138	1.56	1.881	ACP
P214	6	144	1.63	2.041	ACP
P215	6	122	1.39	1.513	ACP
P216	8	170	1.08	0.685	ACP
P217	8	176	1.12	0.732	ACP
P218	8	89	0.57	0.205	ACP
P219	8	83	0.53	0.184	ACP
P220	6	30	0.34	0.112	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P221	6	42	0.48	0.209	ACP
P222	6	62	0.7	0.426	ACP
P223	6	132	1.5	1.756	ACP
P224	6	35	0.39	0.146	ACP
P225	6	65	0.74	0.469	ACP
P226	6	69	0.78	0.525	ACP
P227	6	125	1.42	1.58	ACP
P228	6	59	0.67	0.395	ACP
P229	6	69	0.78	0.518	ACP
P230	6	94	1.07	0.931	ACP
P231	6	88	1	0.821	ACP
P232	3	4	0.2	0.096	ACP
P233	6	4	0.05	0.003	ACP
P234	6	24	0.27	0.073	ACP
P235	6	18	0.2	0.042	ACP
P236	6	15	0.16	0.029	ACP
P237	6	4	0.05	0.004	ACP
P238	6	38	0.43	0.173	ACP
P239	6	32	0.36	0.145	DI
P240	6	21	0.24	0.068	DI
P241	6	37	0.42	0.188	DI
P242	6	27	0.31	0.11	DI
P243	6	28	0.32	0.101	ACP
P244	6	27	0.3	0.089	ACP
P245	4	4	0.11	0.023	ACP
P246	4	11	0.29	0.134	ACP
P247	8	62	0.4	0.107	ACP
P248	8	49	0.31	0.068	ACP
P249	8	11	0.07	0.004	ACP
P250	6	84	0.95	0.754	ACP
P251	6	45	0.51	0.234	ACP
P252	6	97	1.1	0.979	ACP
P253	6	116	1.31	1.37	ACP
P254	8	139	0.89	0.475	ACP
P255	8	95	0.61	0.233	ACP
P256	4	17	0.42	0.271	ACP
P257	2	14	1.38	5.411	ACP
P258	2	4	0.46	0.692	ACP
P259	6	67	0.76	0.574	DI
P260	6	147	1.67	2.13	ACP
P261	8	176	1.12	0.731	ACP
P262	8	70	0.45	0.133	ACP
P263	6	61	0.7	0.423	ACP
P264	6	4	0.05	0.004	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P265	6	39	0.45	0.185	ACP
P266	6	33	0.38	0.135	ACP
P267	8	89	0.57	0.239	DI
P268	8	116	0.74	0.391	DI
P269	6	55	0.63	0.348	ACP
P270	6	7	0.08	0.008	ACP
P271	6	106	1.2	1.153	ACP
P272	6	44	0.5	0.232	ACP
P273	6	97	1.1	0.989	ACP
P274	6	36	0.41	0.16	ACP
P275	4	23	0.59	0.496	ACP
P276	4	4	0.11	0.024	ACP
P277	6	50	0.56	0.284	ACP
P278	6	55	0.63	0.302	PVC
P279	6	221	2.51	4.529	ACP
P280	6	30	0.34	0.179	Steel
P281	6	20	0.22	0.082	Steel
P282	6	11	0.12	0.017	ACP
P283	6	126	1.43	1.597	ACP
P284	6	68	0.77	0.506	ACP
P285	6	188	2.14	3.365	ACP
P286	6	59	0.67	0.54	ACP
P287	8	15	0.1	0.011	ACP
P288	8	39	0.25	0.062	ACP
P289	6	14	0.16	0.028	ACP
P290	6	27	0.31	0.094	ACP
P291	6	21	0.24	0.06	ACP
P292	6	21	0.24	0.058	ACP
P293	6	26	0.3	0.088	ACP
P294	6	27	0.3	0.125	ACP
P295	6	16	0.19	0.05	ACP
P296	6	25	0.28	0.08	ACP
P297	6	24	0.28	0.076	ACP
P298	6	22	0.25	0.065	ACP
P299	4	4	0.11	0.023	ACP
P300	4	15	0.37	0.212	ACP
P301	4	8	0.21	0.077	ACP
P302	4	6	0.16	0.043	ACP
P303	4	13	0.34	0.181	ACP
P304	6	29	0.33	0.104	ACP
P305	6	26	0.29	0.084	ACP
P306	6	38	0.43	0.175	ACP
P307	6	44	0.5	0.23	ACP
P308	6	39	0.44	0.182	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P309	6	13	0.14	0.023	ACP
P310	6	13	0.15	0.029	DI
P311	6	4	0.05	0.004	DI
P312	10	23	0.09	0.006	ACP
P313	12	58	0.17	0.013	ACP
P314	6	2	0.02	0.001	ACP
P315	6	4	0.05	0.003	ACP
P316	6	3	0.03	0.001	ACP
P317	6	24	0.28	0.076	ACP
P318	6	1	0.01	0	ACP
P319	6	13	0.15	0.025	ACP
P320	6	9	0.1	0.012	ACP
P321	6	9	0.1	0.012	ACP
P322	12	200	0.57	0.128	ACP
P323	12	197	0.56	0.125	ACP
P324	12	202	0.57	0.131	ACP
P325	6	13	0.15	0.025	ACP
P326	6	9	0.1	0.012	ACP
P327	6	4	0.05	0.003	ACP
P328	8	59	0.38	0.112	ACP
P329	8	65	0.42	0.135	ACP
P330	12	182	0.52	0.108	ACP
P331	12	208	0.59	0.138	ACP
P332	12	223	0.63	0.158	ACP
P333	4	7	0.18	0.064	DI
P334	6	43	0.49	0.219	ACP
P335	6	25	0.29	0.082	ACP
P336	6	33	0.38	0.137	ACP
P337	6	48	0.54	0.264	ACP
P338	8	66	0.42	0.119	ACP
P339	8	275	1.75	1.667	ACP
P340	6	62	0.7	0.429	ACP
P341	6	40	0.45	0.19	ACP
P342	4	4	0.11	0.027	DI
P343	4	5	0.13	0.036	DI
P344	6	32	0.37	0.129	ACP
P345	6	33	0.37	0.131	ACP
P346	6	12	0.14	0.025	DI
P347	6	15	0.17	0.037	DI
P348	6	111	1.26	1.464	DI
P349	6	48	0.54	0.305	DI
P350	6	18	0.21	0.051	DI
P351	6	40	0.46	0.223	DI
P352	6	68	0.77	0.594	DI

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P353	6	50	0.57	0.334	DI
P354	6	71	0.81	0.907	Steel
P355	6	47	0.53	0.414	Steel
P356	6	37	0.41	0.263	Steel
P357	6	36	0.4	0.193	ACP
P358	6	17	0.19	0.064	Steel
P359	6	95	1.08	1.551	Steel
P360	6	63	0.72	0.731	Steel
P361	6	46	0.52	0.399	Steel
P362	6	26	0.29	0.139	Steel
P363	8	75	0.48	0.205	ACP
P364	8	114	0.73	0.449	ACP
P365	6	18	0.2	0.042	ACP
P366	6	16	0.18	0.035	ACP
P367	6	6	0.06	0.007	ACP
P368	6	10	0.11	0.02	ACP
P369	6	32	0.36	0.124	ACP
P370	6	34	0.38	0.139	ACP
P371	6	14	0.15	0.026	ACP
P372	6	20	0.23	0.072	ACP
P373	6	20	0.23	0.09	Steel
P374	6	14	0.16	0.046	Steel
P375	8	57	0.36	0.123	ACP
P376	8	63	0.4	0.148	ACP
P377	6	5	0.06	0.004	ACP
P378	6	10	0.11	0.013	ACP
P379	6	9	0.1	0.012	ACP
P380	12	150	0.42	0.075	ACP
P381	12	163	0.46	0.088	ACP
P382	12	187	0.53	0.114	ACP
P383	6	31	0.35	0.118	ACP
P384	6	17	0.19	0.038	ACP
P385	6	23	0.26	0.068	ACP
P386	6	35	0.4	0.15	ACP
P387	4	15	0.39	0.227	ACP
P388	4	7	0.17	0.05	ACP
P389	6	25	0.28	0.079	ACP
P390	6	40	0.46	0.195	ACP
P391	12	62	0.18	0.017	DI
P392	6	58	0.66	0.524	ACP
P393	6	52	0.59	0.313	ACP
P394	8	119	0.76	0.353	ACP
P395	8	113	0.72	0.32	ACP
P396	10	155	0.63	0.194	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P397	8	4	0.03	0.001	ACP
P398	8	264	1.69	1.552	ACP
P399	8	261	1.67	1.519	ACP
P400	8	92	0.59	0.255	DI
P401	8	34	0.22	0.041	DI
P402	8	166	1.06	0.762	DI
P403	6	5	0.06	0.005	ACP
P404	6	27	0.31	0.094	ACP
P405	8	0	0	0	DI
P406	99	0	0	0	DI
P407	99	628	0.03	0	DI
P408	8	0	0	0	DI
P409	8	709	4.53	9.664	DI
P410	8	0	0	0	DI
P411	8	1080	6.89	21.066	DI
P412	6	32	0.37	0.13	ACP
P413	6	29	0.33	0.108	ACP
P414	10	(N/A)	(N/A)	(N/A)	DI
P415	8	(N/A)	(N/A)	(N/A)	DI
P416	12	(N/A)	(N/A)	(N/A)	DI
P417	12	(N/A)	(N/A)	(N/A)	DI
P418	6	52	0.59	0.271	PVC
P419	6	49	0.56	0.242	PVC
P420	12	(N/A)	(N/A)	(N/A)	DI
P421	6	12	0.13	0.02	ACP
P422	6	16	0.18	0.036	ACP
P423	12	(N/A)	(N/A)	(N/A)	DI
P424	10	167	0.68	0.363	Steel
P425	10	169	0.69	0.371	Steel
P426	10	340	1.39	1.358	Steel
P427	10	71	0.29	0.04	PVC
P428	12	0	0	0	DI
P429	12	67	0.19	0.017	DI
P430	6	33	0.37	0.132	ACP
P431	8	76	0.49	0.212	ACP
P432	6	30	0.34	0.11	ACP
P433	12	88	0.25	0.033	DI
P434	12	119	0.34	0.057	DI
P435	10	34	0.14	0.012	DI
P436	10	37	0.15	0.014	DI
P437	6	46	0.52	0.215	PVC
P438	6	4	0.05	0.003	PVC
P439	6	23	0.26	0.066	ACP
P440	8	27	0.17	0.022	DI

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P441	10	63	0.26	0.037	DI
P442	12	(N/A)	(N/A)	(N/A)	DI
P443	6	52	0.59	0.307	ACP
P444	10	60	0.25	0.034	DI
P445	10	8	0.03	0.001	DI
P446	6	4	0.05	0.003	DI
P447	12	62	0.18	0.017	DI
P448	12	115	0.33	0.054	DI
P449	12	78	0.22	0.026	DI
P450	12	82	0.23	0.029	DI
P451	12	70	0.2	0.021	DI
P452	8	22	0.14	0.014	PVC
P453	8	9	0.06	0.003	PVC
P454	8	5	0.03	0.001	PVC
P455	8	30	0.19	0.025	PVC
P456	8	39	0.25	0.039	PVC
P457	8	4	0.03	0.001	PVC
P458	6	4	0.05	0.003	PVC
P459	8	40	0.25	0.046	DI
P460	10	31	0.13	0.01	DI
P461	10	28	0.12	0.008	DI
P462	10	38	0.15	0.014	DI
P463	10	29	0.12	0.009	DI
P464	6	4	0.05	0.003	DI
P465	8	101	0.65	0.263	ACP
P466	8	94	0.6	0.229	ACP
P467	4	4	0.11	0.024	ACP
P468	4	8	0.21	0.074	ACP
P469	10	10	0.04	0.001	DI
P470	2	2	0.21	0.17	DI
P471	6	4	0.05	0.003	DI
P472	4	22	0.57	0.462	DI
P473	2	4	0.42	0.597	DI
P474	6	10	0.12	0.015	ACP
P475	6	16	0.19	0.037	ACP
P476	4	4	0.11	0.024	DI
P477	8	24	0.15	0.021	DI
P478	10	196	0.8	0.3	ACP
P479	12	192	0.55	0.12	ACP
P480	4	4	0.11	0.024	ACP
P481	6	4	0.05	0.003	DI
P482	6	61	0.69	0.48	DI
P483	6	56	0.63	0.412	DI
P484	6	49	0.55	0.277	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P485	6	21	0.24	0.059	DI
P486	10	17	0.07	0.003	DI
P487	10	57	0.23	0.031	DI
P488	10	41	0.17	0.016	DI
P489	8	0	0	0	DI
P490	8	4	0.03	0.001	DI
P491	8	0	0	0	DI
P492	8	0	0	0	DI
P493	8	0	0	0	DI
P494	8	628	4.01	7.724	DI
P495	8	628	4.01	7.724	DI
P496	8	709	4.53	9.663	DI
P497	8	709	4.53	9.664	DI
P498	12	21	0.06	0.002	ACP
P499	10	0	0	0	DI
P500	6	13	0.14	0.023	ACP
P501	6	11	0.12	0.016	ACP
P502	6	18	0.2	0.042	ACP
P503	6	15	0.17	0.03	ACP
P504	6	18	0.2	0.043	ACP
P505	6	4	0.05	0.003	ACP
P506	10	126	0.51	0.132	ACP
P507	10	133	0.54	0.147	ACP
P508	12	76	0.21	0.021	ACP
P509	12	302	0.86	0.276	ACP
P510	6	5	0.05	0.004	ACP
P511	6	16	0.18	0.034	ACP
P512	10	345	1.41	0.859	ACP
P513	10	365	1.49	0.951	ACP
P514	6	51	0.58	0.262	PVC
P515	6	41	0.47	0.174	PVC
P516	8	35	0.22	0.032	PVC
P517	8	50	0.32	0.062	PVC
P518	8	46	0.3	0.062	ACP
P519	8	34	0.22	0.035	ACP
P520	12	63	0.18	0.015	DI
P521	8	3	0.02	0	PVC
P522	8	3	0.02	0	PVC
P523	6	54	0.61	0.335	ACP
P524	6	54	0.61	0.335	ACP
P525	4	0	0	0	DI
P526	8	169	1.08	0.787	DI
P527	8	169	1.08	0.787	DI
P528	6	4	0.05	0.004	DI

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P529	6	4	0.05	0.004	DI
P530	6	0	0	0	DI
P531	6	26	0.3	0.12	ACP
P532	6	26	0.3	0.121	ACP
P533	6	4	0.05	0.005	ACP
P534	6	4	0.05	0.003	ACP
P535	4	0	0	0	ACP
P536	6	38	0.43	0.237	ACP
P537	6	38	0.43	0.237	ACP
P538	8	97	0.62	0.331	ACP
P539	4	0	0	0	DI
P540	8	153	0.97	0.562	ACP
P541	8	153	0.97	0.562	ACP
P542	4	4	0.11	0.027	ACP
P543	4	4	0.11	0.032	ACP
P544	6	29	0.33	0.135	ACP
P545	6	29	0.33	0.135	ACP
P546	4	34	0.88	1.683	ACP
P547	6	0	0	0	DI
P548	10	27	0.11	0.008	ACP
P549	10	27	0.11	0.008	ACP
P550	10	19	0.08	0.005	DI
P551	10	19	0.08	0.005	DI
P552	6	47	0.54	0.262	ACP
P553	6	47	0.54	0.263	ACP
P554	6	0	0	0	DI
P555	6	44	0.5	0.265	DI
P556	6	44	0.5	0.265	DI
P557	6	0	0	0	DI
P558	6	57	0.65	0.37	ACP
P559	6	52	0.59	0.313	ACP
P560	2	7	0.72	1.599	ACP
P561	8	76	0.48	0.154	ACP
P562	8	76	0.48	0.154	ACP
P563	4	0	0	0	ACP
P564	6	0	0	0	DI
P565	4	0	0	0	DI
P566	8	0	0	0	DI
P567	4	0	0	0	DI
P568	8	132	0.84	0.501	ACP
P569	8	132	0.84	0.501	ACP
P570	6	0	0	0	DI
P571	8	72	0.46	0.193	ACP
P572	8	72	0.46	0.193	ACP

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P573	6	0	0	0	DI
P574	6	13	0.14	0.023	ACP
P575	6	13	0.14	0.024	ACP
P576	6	0	0	0	DI
P577	10	22	0.09	0.005	ACP
P578	10	22	0.09	0.006	ACP
P579	6	0	0	0	DI
P580	6	18	0.2	0.043	ACP
P581	6	18	0.2	0.043	ACP
P582	6	0	0	0	DI
P583	6	26	0.3	0.087	ACP
P584	6	26	0.3	0.087	ACP
P585	6	0	0	0	DI
P586	8	1080	6.89	21.066	DI
P587	6	0	0	0	DI
P588	6	30	0.34	0.113	ACP
P589	6	30	0.34	0.113	ACP
P590	6	0	0	0	DI
P591	4	30	0.78	0.831	ACP
P592	4	30	0.78	0.831	ACP
P593	6	0	0	0	DI
P594	8	0	0	0	DI
P595	8	0	0	0	DI
P596	8	0	0	0	DI
P597	8	0	0	0	DI
P598	10	0	0	0	DI
P599	8	1080	6.89	21.066	DI
P600	10	48	0.2	0.019	PVC
P601	10	74	0.3	0.044	PVC
P602	8	56	0.36	0.088	ACP
P603	8	97	0.62	0.243	ACP
P604	8	179	1.14	0.755	ACP
P605	8	340	2.17	2.475	ACP
P606	8	51	0.33	0.074	ACP
P607	8	29	0.19	0.03	ACP
P608	6	118	1.33	1.406	ACP
P609	6	118	1.33	1.406	ACP
P610	6	60	0.69	0.411	ACP
P611	6	60	0.69	0.411	ACP
P612	6	2	0.03	0.001	ACP
P613	6	2	0.03	0.001	ACP
P614	6	0	0	0	DI
P615	4	34	0.88	1.035	DI
P616	8	13	0.09	0.005	PVC

Label	Diam. (in)	Flow (Max.) (gpm)	Vel. (Max.) (fps)	Headloss Gradient (ft/1000ft)	Material
P617	8	13	0.09	0.005	PVC
P618	6	0	0	0	DI
P619	8	18	0.11	0.009	PVC
P620	8	18	0.11	0.009	PVC
P621	6	0	0	0	DI
P622	12	65	0.19	0.019	DI
P623	12	65	0.19	0.019	DI
P624	8	30	0.19	0.031	DI
P625	8	30	0.19	0.031	DI
P626	8	93	0.59	0.225	ACP
P627	8	93	0.59	0.225	ACP
P628	6	13	0.14	0.023	ACP
P629	6	13	0.14	0.023	ACP
P630	6	134	1.52	1.801	ACP
P631	8	0	0	0	DI
P632	8	0	0	0	DI
P633	8	0	0	0	DI
P634	6	0	0	0	DI
P635	6	134	1.52	1.801	ACP
P636	6	134	1.52	1.801	ACP
P637	1	0	0	0	PVC

Label	Fire Flow (Needed) (gpm)	Fire Flow (Available) (gpm)	Pressure (Resid. @ Total Flow Needed) (psi)	Vel. of Max. Pipe (fps)	Satisfies Fire Flow Constraints?
H-11P	1500	1229	38	13	FALSE
H-13P	1500	1135	44	13	FALSE
H-13Q	1500	1026	-3	12	FALSE
H-14P	1500	1457	33	13	FALSE
H-16P	1500	1483	46	13	FALSE
H-17P	1500	818	19	13	FALSE
H-17Q	1500	1418	35	13	FALSE
H-1Q	1500	1143	34	13	FALSE
H-2P	1500	1498	35	13	FALSE
H-9Q	1500	826	17	13	FALSE
DUTCH BRO HYDRANT	1500	1750	44	13	TRUE
H-10P	1500	3052	36	11	TRUE
H-10Q	1500	2930	36	8	TRUE
H-11Q	1500	3248	38	12	TRUE
H-12P	1500	3023	36	8	TRUE
H-12Q	1500	2889	35	8	TRUE
H-14Q	1500	1762	39	13	TRUE
H-15P	1500	3500	51	11	TRUE
H-15Q	1500	1947	44	13	TRUE
H-16Q	1500	1782	38	13	TRUE
H-1P	1500	3351	43	8	TRUE
H-2Q	1500	3127	42	11	TRUE
H-4P	1500	2474	38	13	TRUE
H-4Q	1500	1866	29	13	TRUE
H-5P	1500	2039	27	12	TRUE
H-5Q	1500	1857	27	11	TRUE
H-6P	1500	2108	29	12	TRUE
H-6Q	1500	1800	26	12	TRUE
H-7P	1500	3221	37	13	TRUE
H-7Q	1500	3047	35	10	TRUE
H-8P	1500	1693	36	13	TRUE
H-8Q	1500	2117	32	12	TRUE
H-9P	1500	2337	43	13	TRUE

Label	Fire Flow (Needed) (gpm)	Fire Flow (Available) (gpm)	Pressure (Resid. @ Total Flow Needed) (psi)	Vel. of Max. Pipe (fps)	Satisfies Fire Flow Constraints?
H-11P	1500	1227	38	13	FALSE
H-13P	1500	1135	44	13	FALSE
H-13Q	1500	1026	-3	12	FALSE
H-14P	1500	1456	30	13	FALSE
H-16P	1500	1479	37	13	FALSE
H-17P	1500	817	17	13	FALSE
H-17Q	1500	1415	34	13	FALSE
H-1Q	1500	1143	26	13	FALSE
H-2P	1500	1498	26	13	FALSE
H-9Q	1500	826	17	13	FALSE
DUTCH BRO HYDRANT	1500	1753	36	13	TRUE
H-10P	1500	2117	32	8	TRUE
H-10Q	1500	2122	32	8	TRUE
H-11Q	1500	3248	38	12	TRUE
H-12P	1500	2265	35	9	TRUE
H-12Q	1500	2889	35	8	TRUE
H-14Q	1500	1771	36	13	TRUE
H-15P	1500	3043	49	12	TRUE
H-15Q	1500	1928	36	13	TRUE
H-16Q	1500	1781	29	13	TRUE
H-1P	1500	2534	42	9	TRUE
H-2Q	1500	2413	41	9	TRUE
H-4P	1500	2474	38	13	TRUE
H-4Q	1500	1691	27	12	TRUE
H-5P	1500	2039	27	12	TRUE
H-5Q	1500	1600	23	9	TRUE
H-6P	1500	1713	25	10	TRUE
H-6Q	1500	1565	22	11	TRUE
H-7P	1500	2403	36	10	TRUE
H-7Q	1500	2200	33	8	TRUE
H-8P	1500	1698	32	13	TRUE
H-8Q	1500	1753	28	10	TRUE
H-9P	1500	2472	38	9	TRUE

Notes	Fire Flow (Needed) (gpm)	Fire Flow (Available) (gpm)	Pressure (Resid. @ Total Flow Needed) (psi)	Vel. of Max Pipe (fps)	Satisfies Fire Flow Constraints?
DUTCH BRO HYDRANT	1500	1746	39.3	12.99	TRUE
H-10P	1500	3165	38.1	11.38	TRUE
H-10Q	1500	3191	38.3	8.41	TRUE
H-11P	3500	4085	29.2	9.52	TRUE
H-11Q	1500	3674	45.5	13	TRUE
H-12P	1500	3476	49.4	9.67	TRUE
H-12Q	1500	3257	48	8.63	TRUE
H-13P	1500	2026	48.4	13	TRUE
H-13Q	1500	2026	35.3	13	TRUE
H-14P	1500	2048	42.4	13	TRUE
H-14Q	1500	1779	40.8	12.99	TRUE
H-15P	1500	4000	51.1	6.04	TRUE
H-15Q	1500	1977	38.9	13.01	TRUE
H-16P	1500	2389	49.4	12.99	TRUE
H-16Q	1500	1693	39.4	13	TRUE
H-17P	1500	2215	45.9	13.01	TRUE
H-17Q	1500	2338	44.1	13	TRUE
H-1P	1500	4000	52.4	10.49	TRUE
H-1Q	1500	2034	47.7	13	TRUE
H-2P	1500	2469	42.4	12.68	TRUE
H-2Q	1500	3598	52.6	13	TRUE
H-4P	1500	2459	38	13.01	TRUE
H-4Q	1500	1865	29.5	13	TRUE
H-5P	1500	1900	28.3	11.66	TRUE
H-5Q	1500	1882	28.4	11.05	TRUE
H-6P	1500	2075	31.4	12.27	TRUE
H-6Q	1500	1794	27.6	12.2	TRUE
H-7P	1500	3129	44.9	13	TRUE
H-7Q	1500	3482	39.5	11.14	TRUE
H-8P	1500	1703	37.2	13	TRUE
H-8Q	1500	2064	33.1	12.01	TRUE
H-9P	1500	3482	43.6	13	TRUE
H-9Q	1500	2328	42	13	TRUE

ATTACHMENT B
CIP Cost Estimates

Attachment B: CIP Cost Estimates

ENGINEER'S ESTIMATE OF PROBABLE CONSTRUCTION COSTS				HydroScience Engineers			
Del Paso Manor Water District Water Master Plan Update 475-001		Pipe Replacement Projects 2-10		BY: ARP LCK	SHEET:		
					DATE: 5/18/2021		
ITEM DESCRIPTION: (INCLUDE SPECIFICATION REFERENCE IF POSSIBLE)				QUANTITY		MATERIAL AND LABOR	
				NUMBER	UNIT	UNIT COST	TOTAL
General							
	Mobilization/Demobilization			1	LS	\$20,000	\$20,000
	Bonds and Insurance			1	LS	\$10,000	\$10,000
	Start up and Testing			1	LS	\$7,000	\$7,000
System Upgrades by Location							
2	Replace ex 6" dia AC pipe w/ 8" PVC			74	LF	\$130	\$9,620
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			180		\$9	\$1,620
3	Replace ex 6" dia AC pipe w/ 8" PVC			739	LF	\$130	\$96,070
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			1,770	SF	\$9	\$15,930
4	Replace ex 6" dia DI pipe w/ 8" PVC			209	LF	\$130	\$27,170
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			500	SF	\$9	\$4,500
5	Replace ex 6" dia AC pipe w/ 8" PVC			194	LF	\$130	\$25,220
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			470	SF	\$9	\$4,230
6	Replace ex 6" dia AC pipe w/ 8" PVC			117	LF	\$130	\$15,210
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			280	SF	\$9	\$2,520
7	Replace ex 6" dia DI pipe w/ 8" PVC			114	LF	\$130	\$14,820
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			270	SF	\$9	\$2,430
8	Replace ex 4" dia AC pipe w/ 8" PVC			126	LF	\$130	\$16,380
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			300	SF	\$9	\$2,700
9	Replace ex 6" dia AC pipe w/ 8" PVC			186	LF	\$130	\$24,180
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			450	SF	\$9	\$4,050
10	Replace ex 4" dia DI pipe w/ 8" PVC			149	LF	\$130	\$19,370
	Tie-in			1	LS	\$5,000	\$5,000
	Pavement replacement			360	SF	\$9	\$3,240
SUBTOTAL							\$371,000
<i>Engineering</i>				10%			\$40,000
<i>Environmental, Permits</i>				5%			\$20,000
<i>Contractor Overhead and Profit</i>				15%			\$60,000
<i>Estimating Contingency</i>				25%			\$90,000
TOTAL PROBABLE CONSTRUCTION COST							\$581,000

ENGINEER'S ESTIMATE OF PROBABLE CONSTRUCTION COSTS				HydroScience Engineers		
Del Paso Manor Water District Water Master Plan Update 475-001		Fire Hydrant Upgrade at AT&T		BY: ARP LCK	SHEET: DATE: 5/18/2021	
ITEM DESCRIPTION: (INCLUDE SPECIFICATION REFERENCE IF POSSIBLE)			QUANTITY		MATERIAL AND LABOR	
			NUMBER	UNIT	UNIT COST	TOTAL
Fire Hydrant Upgrade at AT&T						
1	Install new Fire Hydrant with lateral and valves	1	EA	\$5,000	\$5,000	
	Tie-in	1	LS	\$5,000	\$5,000	
	Pavement replacement	20	SF	\$9	\$180	
SUBTOTAL						\$10,200
<i>Engineering</i>		10%				\$1,000
<i>Contractor Overhead and Profit</i>		15%				\$2,000
<i>Environmental, Permits</i>		5%				\$500
<i>Estimating Contingency</i>		25%				\$2,600
TOTAL PROBABLE CONSTRUCTION COST						\$16,300

ENGINEER'S ESTIMATE OF PROBABLE CONSTRUCTION COSTS			HydroScience Engineers	
Del Paso Manor Water District Water Master Plan Update 475-001	Install 8" PRV Station at Intertie to SSWD	BY: ARP LCK	SHEET:	
			DATE: 5/18/2021	
ITEM DESCRIPTION: (INCLUDE SPECIFICATION REFERENCE IF POSSIBLE)	QUANTITY		MATERIAL AND LABOR	
	NUMBER	UNIT	UNIT COST	TOTAL
PRV Station				
8" Pressure Reducing Valve station, precast vault, tie-ins	3	LS	\$70,000	\$210,000
SUBTOTAL				\$210,000
<i>Engineering</i>		10%		\$20,000
<i>Contractor Overhead and Profit</i>		15%		\$32,000
<i>Environmental, Permits</i>		5%		\$10,000
<i>Estimating Contingency</i>		25%		\$50,000
TOTAL PROBABLE CONSTRUCTION COST				\$322,000


ENGINEER'S ESTIMATE OF PROBABLE CONSTRUCTION COSTS				HydroScience Engineers	
Del Paso Manor Water District Water Master Plan Update 475-001		New Well Development and Equipping Construction		BY: ARP LCK	SHEET:
					DATE: 5/18/2021
ITEM DESCRIPTION: (INCLUDE SPECIFICATION REFERENCE IF POSSIBLE)		QUANTITY		MATERIAL AND LABOR	
		NUMBER	UNIT	UNIT COST	TOTAL
General					
	Mobilization/Demobilization	1	LS	\$90,000	\$90,000
	Bonds and Insurance	1	LS	\$70,000	\$70,000
	Start up and Testing	1	LS	\$37,000	\$37,000
				Subtotal	\$197,000
Well Development					
	Drill pilot hole and borehole	1	LS	\$100,000	\$100,000
	Furnish casing, screen and seal	1	LS	\$80,000	\$80,000
	Gravel pack, testing and misc	1	LS	\$90,000	\$90,000
				Subtotal	\$270,000
Well Site, Housing, and Equipping					
	Site Demolition, Clearing, Grubbing and Grading	1	LS	\$90,000	\$90,000
	Site Fill	1	LS	\$70,000	\$70,000
	Fencing	1	LS	\$40,000	\$40,000
	Pump and Above-ground Piping (<i>capacity ~ 1100gpm</i>)	1	LS	\$140,000	\$140,000
	Below-ground piping and Tie-ins	1	LS	\$85,000	\$85,000
	Well house slab and structural	1	LS	\$250,000	\$250,000
	Paint, sealing, HVAC, Plumbing	1	LS	\$140,000	\$140,000
	Standby Generator	1	LS	\$225,000	\$225,000
	Electrical wiring, lighting, panels	1	LS	\$250,000	\$250,000
	MCC, Control panels and PLC	1	LS	\$200,000	\$200,000
	Instrumentation and Programming	1	LS	\$70,000	\$70,000
				Subtotal	\$1,560,000
SUBTOTAL					\$2,027,000
	<i>Engineering</i>	10%			\$200,000
	<i>Environmental, Permits</i>	5%			\$100,000
	<i>Contractor Overhead and Profit</i>	15%			\$300,000
	<i>Estimating Contingency</i>	25%			\$510,000
TOTAL PROBABLE CONSTRUCTION COST					\$3,137,000
Excludes the cost of land acquisition.					

Kennedy/Jenks Consultants

10850 Gold Center Drive, Suite 350
Rancho Cordova, California 95670
916-858-2700
FAX: 916-858-2754

Del Paso Manor Water District Master Plan

24 July 2009

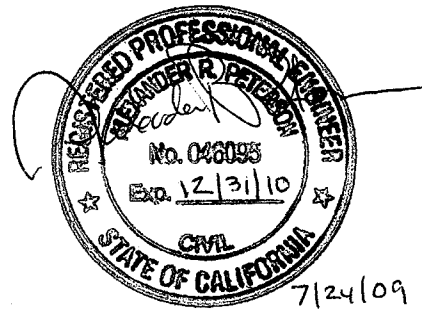

Prepared for

Del Paso Manor Water District
4268 Lusk Drive
Sacramento, California 95864

K/J Project No. 0870017*00

Table of Contents

List of Tables..... *iii*

List of Figures..... *iv*

List of Appendices..... *iv*

Section 1: Executive Summary..... 1

 1.1 Introduction and Purpose of Master Plan..... 1

 1.2 Master Planning Process and Documents Prepared 1

 1.3 Executive Summary 2

 1.3.1 Water Demands and Planning Criteria..... 2

 1.3.2 Water Supply Planning..... 3

 1.3.3 Conjunctive Use Planning 3

 1.3.4 Facilities Replacement Planning 3

 1.3.5 Organizational Structure and Management Planning 3

 1.3.6 Meter Retrofit Planning 4

 1.3.7 Planned System Maintenance 4

 1.3.7.1 Summary Estimated Cost and Phasing 4

Section 2: Introduction 5

 2.1 Purpose of the Water Master Plan 5

 2.2 Background 5

 2.3 Scope of Work..... 6

 2.4 Acknowledgements 6

Section 3: Water Demands and Planning Criteria 11

 3.1 Introduction 11

 3.2 Population and Growth..... 11

 3.3 Water Use 13

 3.3.1 Historical Annual Water Use 13

 3.3.2 Water Use and Customer Service Type..... 14

 3.3.2.1 Customer Service Type 15

 3.3.2.2 Residential 16

 3.3.2.3 Non-residential, Commercial and Institutional/Parks 17

 3.3.3 Water Meters..... 18

 3.4 Water Demand Criteria..... 19

 3.4.1 Demand Projections..... 19

 3.4.2 Fire Protection, Jurisdiction and Estimated Fire Flow Criteria 19

 3.4.3 Unaccounted-for Water 20

 3.4.4 Peaking Factors 20

 3.5 Water Conservation..... 21

 3.6 Reliability and Redundancy..... 22

Table of Contents (cont'd)

	3.7	Water System Standards and Design Criteria.....	23
Section 4:		Water Supply Planning	25
	4.1	Introduction	25
	4.2	Groundwater Supply	25
	4.3	Surface Water Supply	26
	4.3.1	Interties with Other Districts	26
	4.3.1.1	Mutual Aid Agreements.....	26
	4.3.1.2	Surface Water Supply Agreements.....	26
	4.4	Findings and Recommendations.....	26
Section 5:		Conjunctive Use	29
	5.1	Introduction	29
	5.2	Findings Summary	29
	5.3	Recommendations Summary.....	31
	5.4	Direction Based on Board Review.....	33
Section 6:		Facilities Replacement Planning	34
	6.1	Introduction	34
	6.2	Production Capacity Considerations	34
	6.3	Existing Well Ages and Condition	34
	6.3.1	Well No. 1.....	35
	6.3.2	Well No. 2.....	36
	6.3.3	Well No. 3.....	37
	6.3.4	Well No. 4.....	37
	6.3.5	Well No. 5.....	37
	6.3.6	Well No. 6.....	38
	6.3.7	Well No. 7.....	39
	6.3.8	Well No. 8.....	39
	6.3.9	Groundwater Summary and Recommendations	40
	6.3.9.1	Data Availability	40
	6.3.9.2	Summary	40
	6.3.9.3	Recommendations	40
	6.4	Groundwater Well Replacement Program.....	42
	6.4.1	Replacement Groundwater Supply	42
	6.5	Pipeline Replacement Planning	42
	6.6	Corporation Yard and Office Building.....	43
Section 7:		Facilities Management Planning.....	46
	7.1	Introduction	46
	7.2	District Organizational Structure.....	46
	7.2.1	Management and Administration Activities	48
	7.2.2	Water Production and Testing.....	48
	7.2.3	System Maintenance.....	50

Table of Contents (cont'd)

	7.2.4 Conservation Outreach	50
7.3	Future Water District Organizational Structure and Management Plan	51
Section 8:	Meter Retrofit Planning	55
	8.1 Introduction and Background	55
	8.2 Water Metering Commitments.....	56
	8.3 Current Meter Retrofit Status	58
	8.4 Meter Installation Options.....	58
	8.5 Findings and Recommendations.....	59
Section 9:	Planned System Maintenance.....	60
	9.1 Introduction	60
	9.2 Planning and Phasing Recommendations	60
	9.2.1 Summary of PSM.....	61
	9.2.2 PSM Phase 1: 2010-2014	64
	9.2.3 PSM Phase 2: 2014-2018	66
	9.2.4 PSM Phase 3: 2018-2022	68
	9.2.5 PSM Phase 4: 2022-2026.....	70
	9.2.6 PSM Phase 5: 2026-2030	72
	9.3 Cost Estimate.....	74

List of Tables

Table 1:	Peak Demands and Factors	2
Table 2:	Cost Summary for Planned System Maintenance 2010-2030 (Meter Installation by 2025).....	4
Table 3:	Population and Housing Estimates and Tabulated Density.....	11
Table 4:	Population and Housing Units Density	12
Table 5:	Historical Water Use 1998 - 2007.....	13
Table 6:	Residential Water Use 2004 - 2007.....	15
Table 7:	Residential Water Use 2004 - 2007.....	16
Table 8:	Peak Demands and Factors	21
Table 9:	Water Distribution System Design Criteria	24
Table 10:	Well Production Capacity Summary	25
Table 11:	Water Supply Availability	27
Table 12:	Well Age and Current Production Capacity Summary.....	35
Table 13:	Water Meter Accounts Summary.....	58
Table 14:	Commercial Flat Rate Accounts	58
Table 15:	Typical Construction Projects Preparation	61
Table 16:	Planned System Maintenance Project Description.....	62
Table 17:	Planned System Maintenance Summary of Cost by Phase	63

Table of Contents (cont'd)

List of Figures

Figure 1:	District Vicinity Map	7
Figure 2:	District Location Map	8
Figure 3:	Adjacent Water Districts	9
Figure 4:	District Service Area Boundary.....	10
Figure 5:	Existing Well Sites	28
Figure 6:	Future Well Sites	44
Figure 7:	Typical New Well Site Layout	45
Figure 8:	District Current Organizational Chart.....	47
Figure 9:	Proposed District Organizational Chart – Approach 1	53
Figure 10:	Proposed District Organizational Chart – Approach 2	54
Figure 11:	Water System PSM 2010-2014	65
Figure 12:	Water System PSM 2014-2018	67
Figure 13:	Water System PSM 2018-2022	69
Figure 14:	Water System PSM 2022-2026	71
Figure 15:	Water System PSM 2026-2030	73

List of Appendices

- A Draft Conjunctive Use Plan
- B Water Conservation and Meter Retrofit Plan – Technical Memorandum
- C Organizational Structure and Management Plan – Technical Memorandum

Section 1: Executive Summary

1.1 Introduction and Purpose of Master Plan

The Del Paso Manor Water District (District) has long been committed to providing a safe and reliable water supply, while at the same time maintaining low water rates. This Water System Master Plan is the first District master plan and documents planning strategies developed to address aging infrastructure and changing water supply pressures. This Master Plan has been prepared as a working document capturing engineering evaluations and recommendations while also allowing for adaptation as conditions and policy changes.

This Water System Master Plan documents the Del Paso Manor Water District policy regarding policy, vision and direction for the District and does not commit the rate-payers to a specific discretionary action to implement the policy goals. Evaluation of funding and rate impacts, California Environmental Quality Act (CEQA) review, and possibly construction implementation will flow from the vision of this Master Plan and reflect the next steps in the process of renewing the infrastructure of the District.

1.2 Master Planning Process and Documents Prepared

The District is located in the Arden area of unincorporated Sacramento County serving approximately 1.3 square miles, 1,800 residential, commercial, and institutional customers with an estimated average water usage of 1,680 acre feet per year over the last 10 years. The District is fully built-out and there is no growth area available.

The District's water system is comprised of buried water mains, eight (8) groundwater supply wells, and individual service connections, and has generally been in continuous service for over 50 years. There is an increasing infrastructure liability as the aging pipelines and wells reach the end of their useful life over the next 5 to 30 years. The District's elected Board of Directors, recognizing that the aging system and water supply reliability impact water service reliability, commissioned this Water System Master Plan.

The Master Plan focuses on a 25-year horizon with specific recommendations developed for the 5-, 10-, and 25-year milestones. This Master Plan was prepared building on a series of technical memoranda documenting the detailed evaluations for review and discussion with the District management and Board. The evaluation, findings and recommendations of the Technical Memoranda (TMs) are presented in this Master Plan and the TMs provided as appendices under separate cover.

The Master Plan includes a detailed Planned System Maintenance schedule for replacement of facilities similar to what has traditionally been titled a Capital Improvement Plan. Given that the District is fully developed, there are no true capital improvements needed for the current use. There are, however, significant liabilities facing the District in maintaining high quality water supply and level of service and the liabilities are addressed with the PSM plan.

1.3 Executive Summary

This Executive Summary provide a brief overview of the evaluation undertaken, key findings and recommendations. Additional discussion and date are provided in the body of this Master Plan and in the Technical Memoranda provided as appendices under separate cover.

1.3.1 Water Demands and Planning Criteria

The existing water use in the District was evaluated with the following findings:

- ❑ The District has a mixture of residential (94.3% of services), multi-housing (0.6% of services), commercial (3.7% of services) and institutional, irrigation and fire protection (1.3% of services) customers.
- ❑ The water demand is disproportionately skewed towards the non-residential water customers with 44% of the annual water being used by non-residential accounts.
- ❑ The District records indicate a 24% reduction in system water use over the period 2004 to 2007. The estimated per capita water use in 2004 was 227 gallons per capita per day (gpcd) and in 2007 was estimated at 173 gpcd.
- ❑ The District average 10-year water use is estimated to be below similar communities in the Sacramento area and was assumed to increase to match similar communities.

The water demands in the District are shown in Table 1 and are dominated by a small number of non-residential customers with a regional benefit. Conservation will be encouraged with these large water users as part of managing the Districts resources. The District has large landscape lots and water use reductions will require changes in customer landscape practices.

Table 1: Peak Demands and Factors

Demand Period	Water Demand		Peaking Factor	Basis for Calculation
Average Day	1.50 MGD	1,042 gpm	1.0	District Records (1998 – 2007)
Maximum Month Daily Average	2.93 MGD	2,035 gpm	1.95	Maximum monthly demand from the last 10 years of supply operation divided by number of days where maximum monthly demand occurred
Maximum Day Demand	4.40 MGD	3,056 gpm	2.93	Max Month Daily Average Demand times 1.5 peaking factor
Peak Hour Demand	6.60 MGD	4,580 gpm	4.40	Estimated Max Day Demand times 1.5 peaking factor divided by 24 hours

1.3.2 Water Supply Planning

The District is 100% groundwater and the groundwater basin is not in overdraft. The District maintains eight existing wells with an installed capacity capable of meeting maximum day demand (with single largest well off line), peak hour demand and a maximum day demand with a residential fire flow. The existing system supply is insufficient to meet a maximum day demand and the single largest fire flow of 3,500 gallons per minute without low pressure conditions in the system. The initial phase planned system improvements include a new well to address this shortfall.

The District has an agreement with the City of Sacramento to make available sufficient surface water to meet the District water supply needs. The District does not have facilities or approvals to use this water at this time. Obtaining approvals for surface water use will trigger installation of water meters within the District.

1.3.3 Conjunctive Use Planning

Conjunctive use is the balancing of surface water and groundwater to maximize the benefits of both. Two options for conjunctive use were evaluated. One option is the use of City of Sacramento surface water supplies either directly or wheeled through Sacramento Suburban Water District and the second option is the use of surface water diverted at the Carmichael Water District Bajamont Water Treatment Plant. This second option provides for a beneficial water supply plan for both the Carmichael Water District (CWD) and Del Paso Manor Water District with a joint project option to pump groundwater back to CWD in the event they have lost surface water supply due to drought or groundwater supply due to contamination.

The recommendation is to continue to investigate the joint CWD water supply project while maintaining the City surface water supply agreement.

1.3.4 Facilities Replacement Planning

The facilities replacement plan is presented in detail and provided for five new wells and a complete reconstruction of all pipelines. The planned replacement was evaluated using a hydraulic model and confirmed system pipe and supply capacity to fully support existing water use and fire flow criteria.

1.3.5 Organizational Structure and Management Planning

The District currently employs four full-time and one part-time employee to operate the system. The District maintains agreements with neighboring agencies for assistance in the event of an emergency and maintains annual contracts with water and water well contractors for on-call response as needed.

The proposed planned system maintenance, addition of metering, additional conservation requirements and increased distribution and treatment operator coverage will require additional staffing in the future. Two approaches to addressing possible future staffing needs are provided.

1.3.6 Meter Retrofit Planning

The District is a small water agency and does not currently fall under recent legislation regarding mandatory water metering. The District has agreed through the Water Forum process to begin metering at such time a discretionary surface water supply decision is required.

This Master Plan recommends proceeding with installation of new services, meter boxes and meter idlers concurrent with the pipeline

1.3.7 Planned System Maintenance

The planned system maintenance (PSM) schedule is presented in detail with summary cost estimate tables, project descriptions and project time table. The work is presented in four year periods with the initial effort including a new well and system electrical improvements. The work includes wells, pipes, meters, and the CWD conjunctive use project and provides for full replacement of the system with conjunctive use and meters by the end of the planning period.

The existing distribution system is primarily in the backyards of the residential area and this Master Plan recommends relocating the system to the public right of way as part of replacing the aging pipe network.

1.3.7.1 Summary Estimated Cost and Phasing

The detailed breakdown and development of cost estimates for the projects is provided in the body of this Master Plan. The summary of the estimated cost and planned system maintenance phasing is provided in Table 2.

Table 2: Cost Summary for Planned System Maintenance 2010-2030
(Meter Installation by 2025)

PSM Phase	Scheduled	Baseline	Optional	Total
1	2010-2014	\$4,393,400	\$0	\$4,393,400
2	2014-2018	\$4,928,200	\$1,147,000	\$6,075,200
3	2018-2022	\$2,438,400	\$2,184,800	\$4,624,200
4	2022-2026	\$6,910,100	\$5,628,300	\$12,538,400
5	2026-2030	\$1,744,300	\$617,400	\$2,361,700
Estimated Cost				\$29,992,900
Total Cost Rounded to:				\$29,993,000

Section 2: Introduction

Del Paso Manor neighborhood is a well maintained quiet post World War II residential and commercial development in the unincorporated Arden/Arcade area of Sacramento County whose water system has served it well since first delivering water in the late 1940's.

2.1 Purpose of the Water Master Plan

The Del Paso Manor Water District (District) has long been committed to providing a safe and reliable water supply, while at the same time maintaining low water rates. This Water System Master Plan is the first District master plan and documents planning strategies developed to address aging infrastructure and changing water supply pressures. This Master Plan has been prepared as a working document capturing engineering evaluations and recommendations while also allowing for adaptation as conditions and policy changes.

This Water System Master Plan documents the Del Paso Manor Water District policy regarding policy, vision and direction for the District and does not commit the rate-payers to a specific discretionary action to implement the policy goals. Evaluation of funding and rate impacts, California Environmental Quality Act (CEQA) review, and possibly construction implementation will flow from the vision of this Master Plan and reflect the next steps in the process of renewing the infrastructure of the District.

2.2 Background

The District is located in the Arden area of unincorporated Sacramento County, northeast of the City of Sacramento, as shown in the vicinity and location maps provided in Figures 1 and 2. The District service area is approximately 1.3 square miles and the District provides drinking water to approximately 1,800 residential, commercial, and institutional customers. The District is bounded on all sides by Sacramento Suburban Water District (SSWD), a large water purveyor in the Sacramento region that was formed in 2002 by the merger of the former Arden and Northridge Water Districts. Figure 3 provides a map of the region and the District's location relative to neighboring water purveyors.

The District is fully built-out and is facing an increasing infrastructure liability as the aging pipelines and wells reach the end of their useful life over the next 5 to 30 years. The District's water system is comprised of buried water mains, eight (8) groundwater supply wells, and individual service connections, and has generally been in continuous service for over 50 years. Figure 4 provides the location of each of the existing District wells, and approximate locations and diameters of existing buried water distribution pipelines. The District's elected Board of Directors, recognizing that the aging system and water supply reliability impact water service reliability, commissioned this Water System Master Plan.

Kennedy/Jenks Consultants (Kennedy/Jenks) specializes in water system master planning, infrastructure planning, water resources planning, as well as design and practical application of engineered solutions for safe and reliable systems and has prepared this Master Plan. The Master Plan will focus on a 25-year horizon with specific recommendations developed for the 5-, 10-, and 25-year milestones. The Plans will consider infrastructure replacement beyond the

25-year period for pipelines and groundwater wells, as appropriate, and provide general recommendations for the longer-term issues.

2.3 Scope of Work

This Master Plan was prepared building on a series of technical memoranda documenting the evaluation of conjunctive use water supply strategies and facilities replacement planning. In addition, facility management review for future District staffing needs and metering installation planning were developed through meetings with the staff.

The Master Plan includes a detailed Planned System Maintenance (PSM) schedule for replacement of facilities similar to what has traditionally been titled a Capital Improvement Plan. Given that the District is fully developed, there are no capital improvements associated with growth or development and instead the investment of capital is to maintain the system as needed for the current use. The significant liabilities facing the District in maintaining high quality water supply and level of service and the liabilities are addressed with the PSM plan.

2.4 Acknowledgements

The team and Kennedy/Jenks wishes to acknowledge the efforts and input of the following Del Paso Manor Staff and Elected Board for their participation in the work, consideration of the issues and leadership and charting the future for the District.

Del Paso Manor Water District – Board of Directors

Richard Allen, President
John Downing, Vice President
Michael Clohossey, Director
Philip Ripplinger, Director
Roy Wilson, Director

Del Paso Manor Water District – Administration and Staff

Debra Sedwick, General Manager
Richard Bolton, Field Manager
Lori Hensley, Office Assistant
Ken Ingle, Operation and Maintenance Technician

In addition, we would like to acknowledge the efforts of the Kennedy/Jenks team as follows:


Sean Maguire, P.E., Project Engineer
Sherly Rosilela, EIT, Staff Technical Support
Alex Peterson, P.E., Project Manager

N:\2008\0870017.00_Del_Paso_Manor_WD_MP\1-Sheets\Master_Plan_Figures\Fig-01.dwg 4/2/2009 10:57 AM DAVID KIM



**DEL PASO MANOR
WATER DISTRICT
LOCATION**

**WATER MASTER
PLAN VICINITY**




Kennedy/Jenks Consultants
**DEL PASO MANOR WATER DISTRICT
 SACRAMENTO, CALIFORNIA
 MASTER PLAN**

DISTRICT VICINITY MAP

K/J 0870017.00
APRIL 2009

FIGURE 1

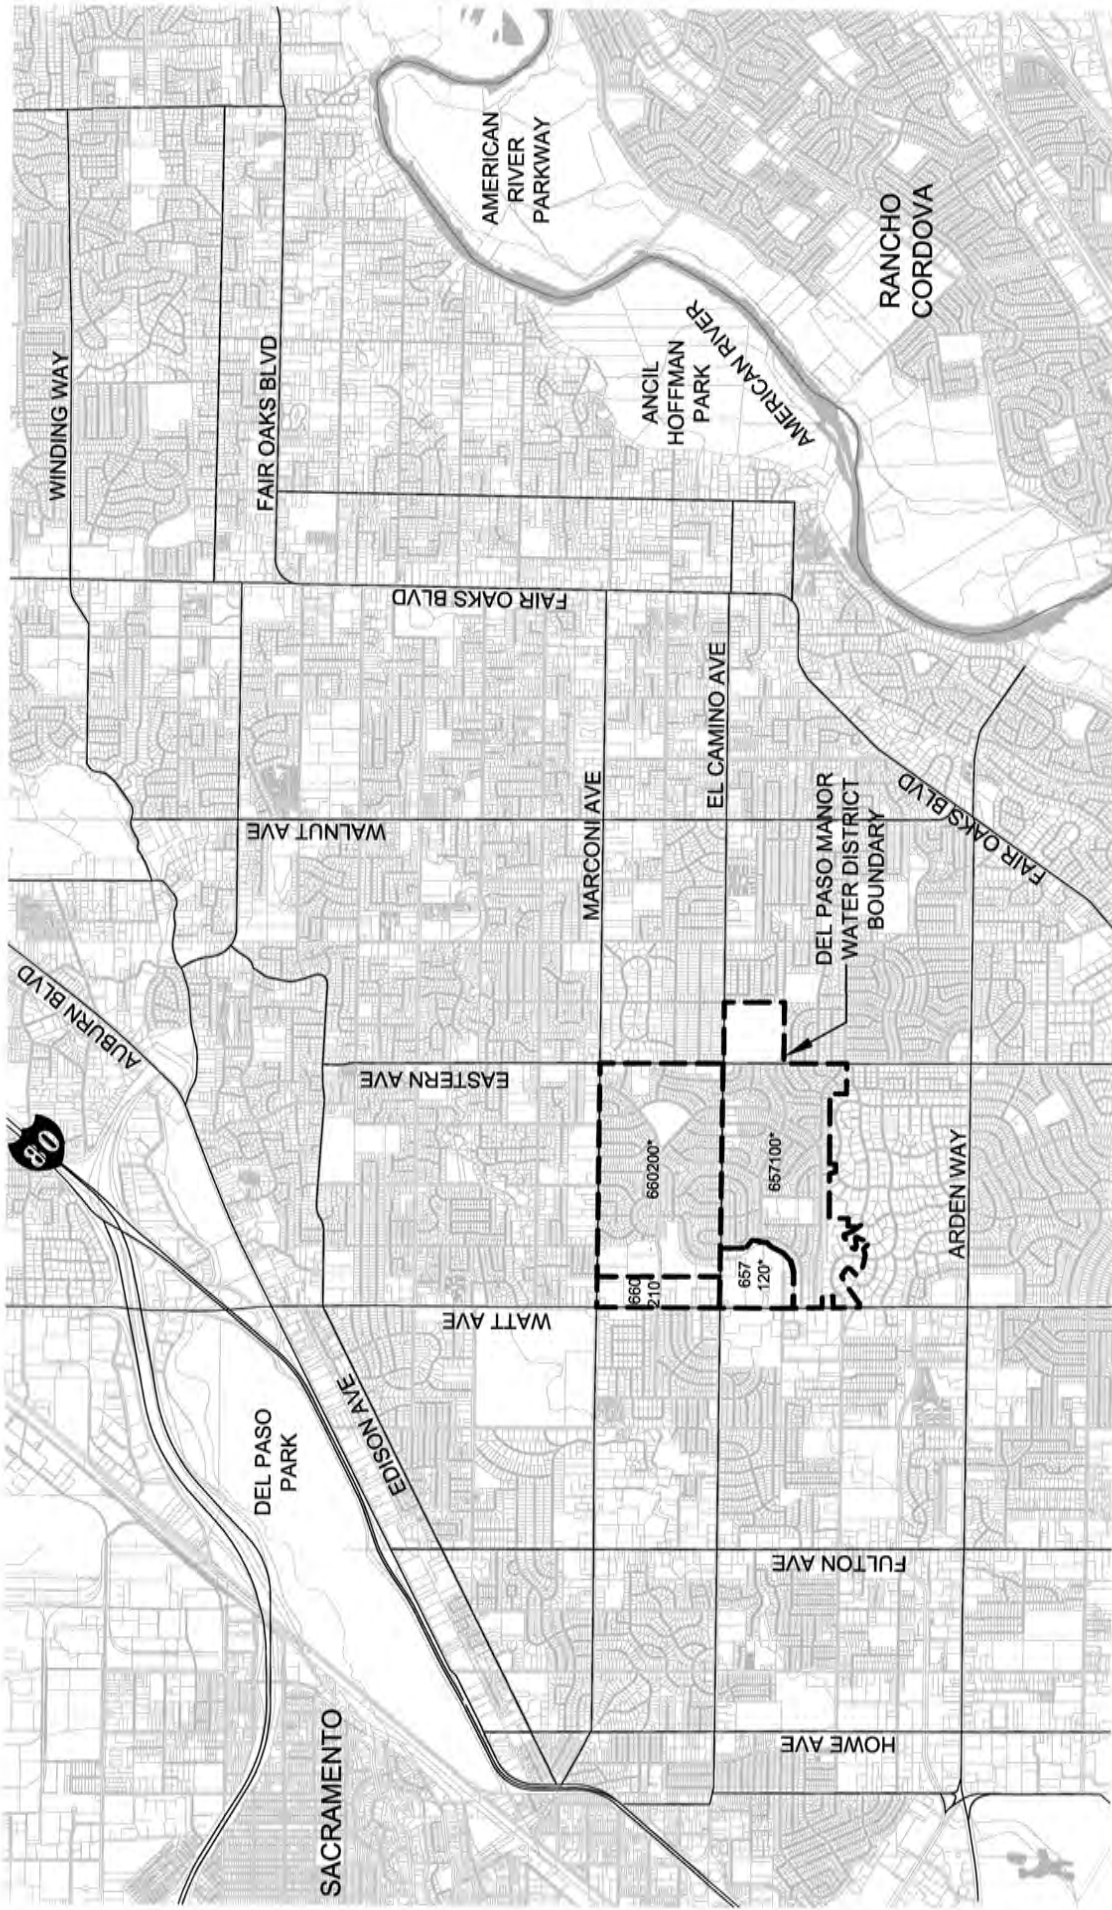

*NOTE: SACRAMENTO AREA COUNCIL OF GOVERNMENT MINOR ZONES BOUNDARIES SHOWN WERE USED FOR POPULATION AND GROWTH PROJECTION.




NOT TO SCALE

Kennedy/Jenks Consultants
 DEL PASO MANOR WATER DISTRICT
 SACRAMENTO, CALIFORNIA
 MASTER PLAN

DISTRICT LOCATION MAP

KJ 0870017.00
 APRIL 2009

FIGURE 2

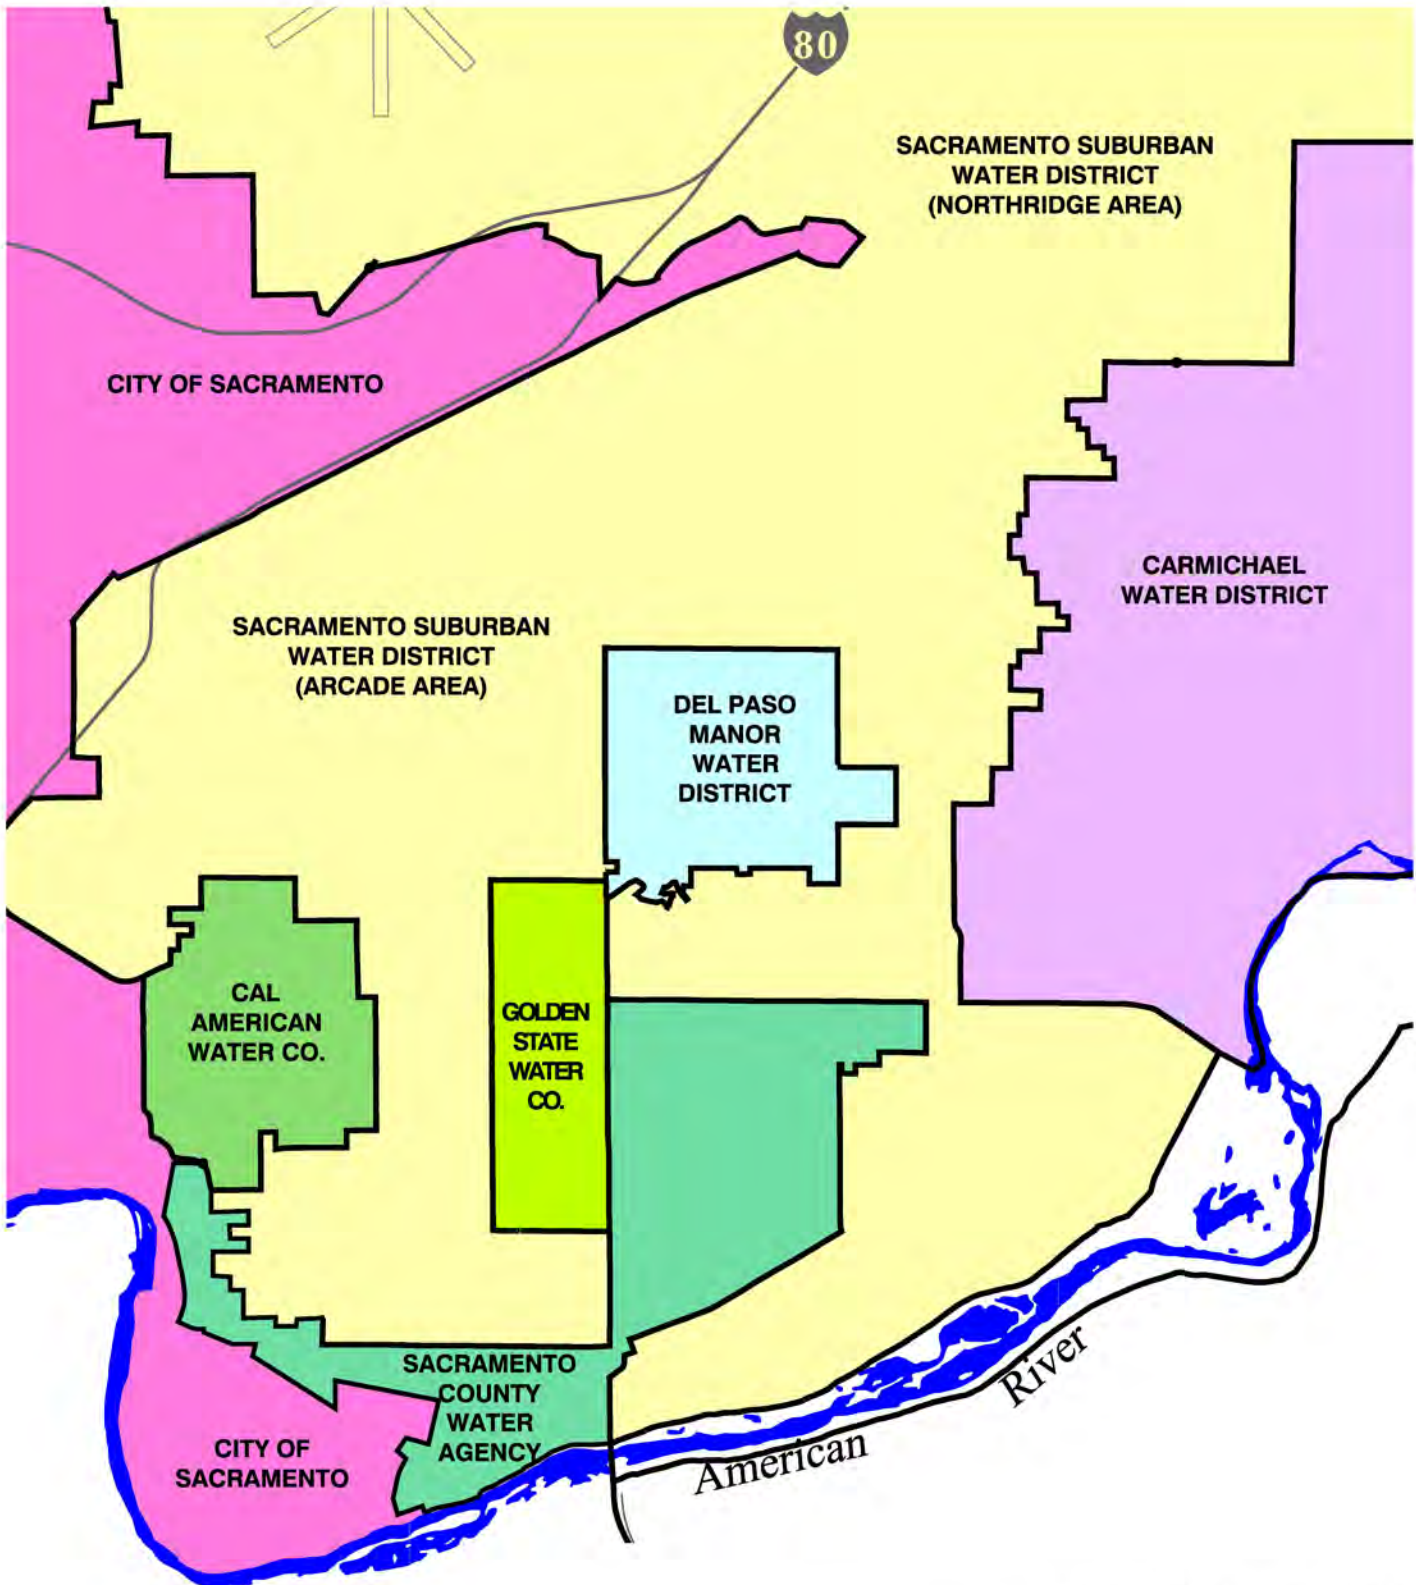

NOT TO SCALE



Kennedy/Jenks Consultants

DEL PASO MANOR WATER DISTRICT
SACRAMENTO, CALIFORNIA
MASTER PLAN

ADJACENT WATER DISTRICTS

K/J 0870017.00
APRIL 2009

FIGURE 3

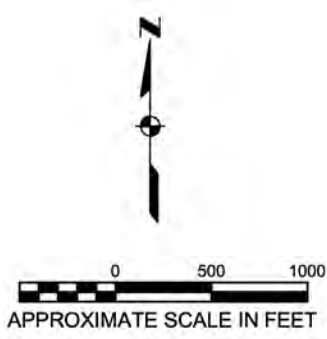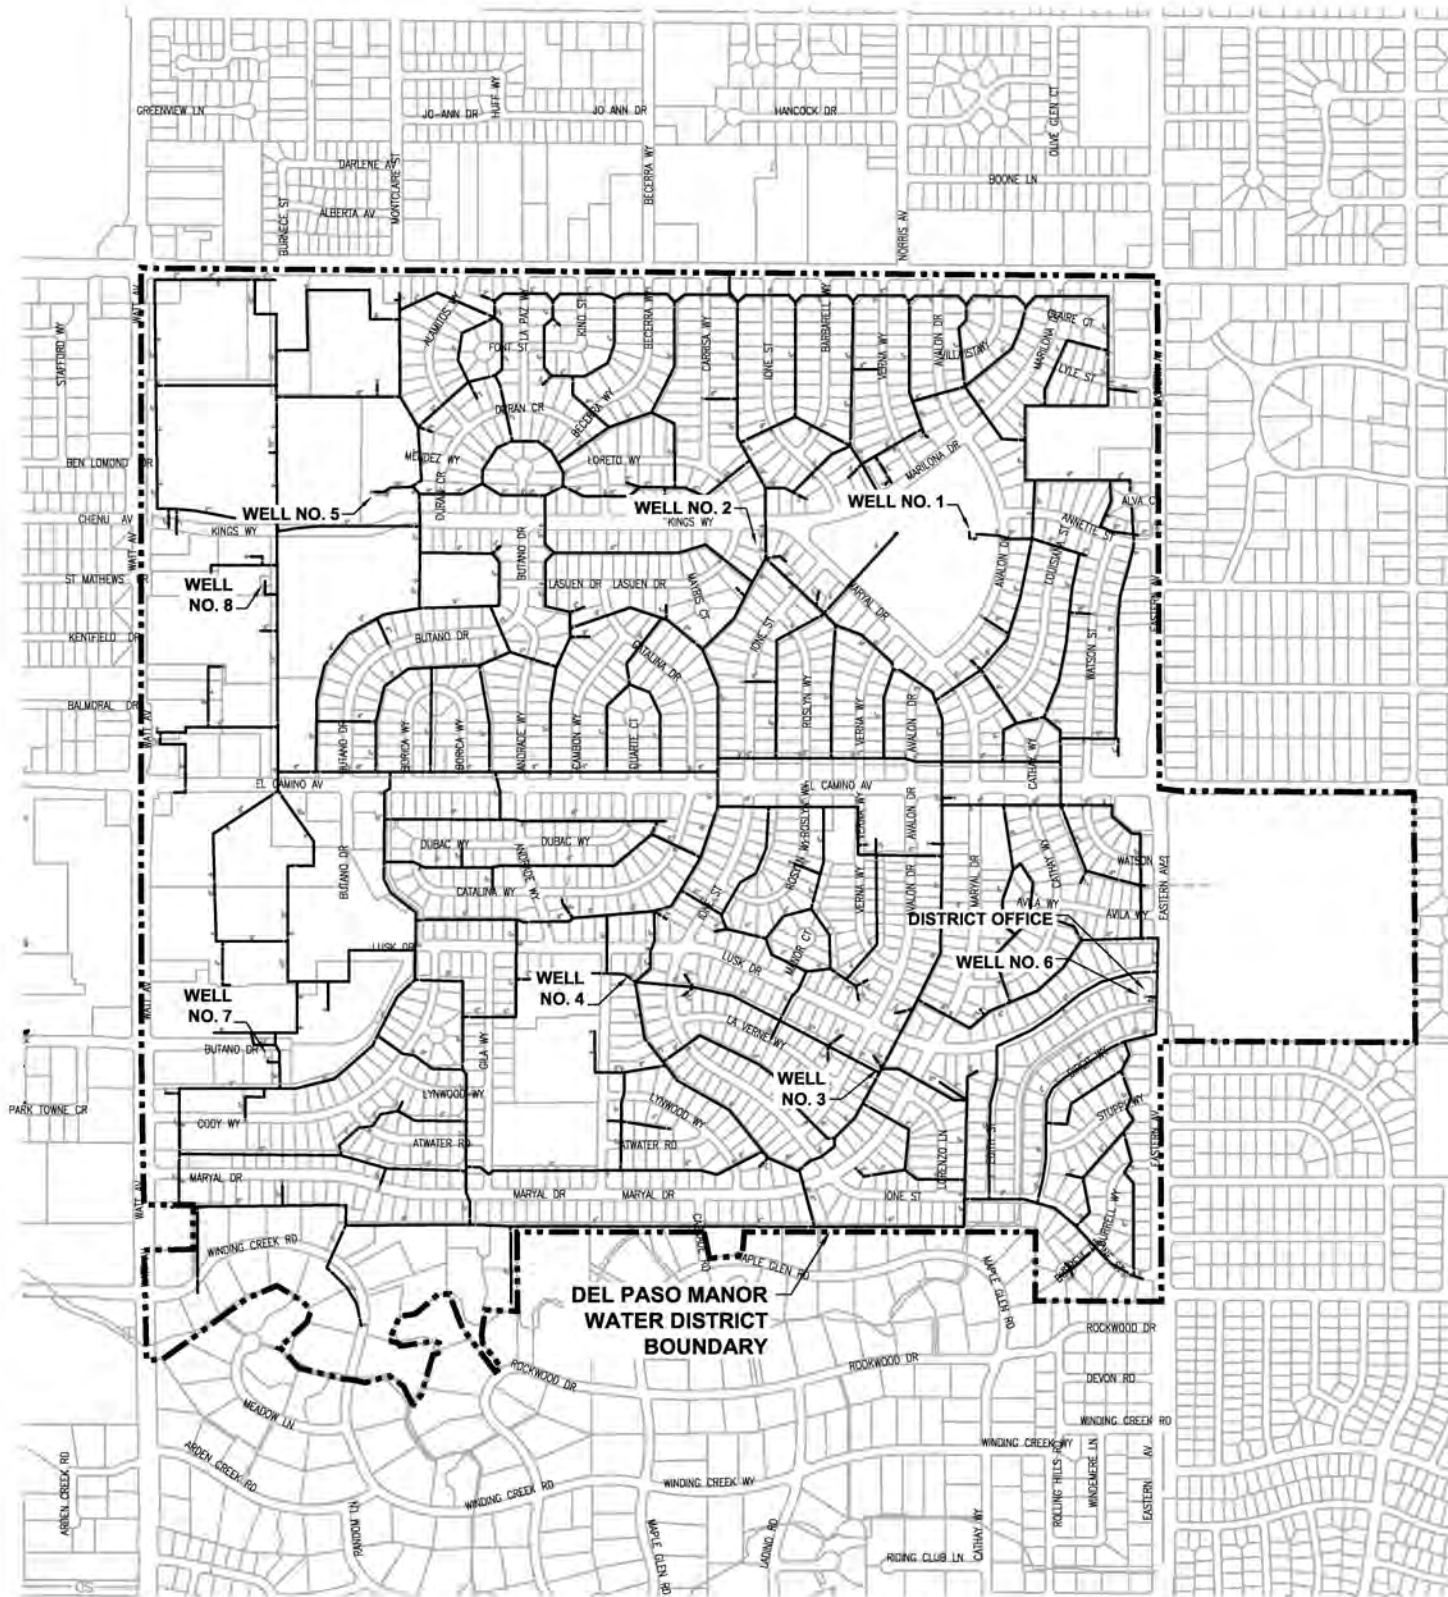

Kennedy/Jenks Consultants

**DEL PASO MANOR WATER DISTRICT
SACRAMENTO, CALIFORNIA
MASTER PLAN**

**DISTRICT SERVICE
AREA BOUNDARY**

K/J 0870017.00
APRIL 2009

FIGURE 4

Section 3: Water Demands and Planning Criteria

The District customers have benefited from low cost and abundant water supply supporting park like suburban landscapes and continuous commercial water consumption practices that are trending to be inconsistent with state conservation policies, presenting challenges for the District in maintaining the high level of service, low cost and consistent regulatory policy compliance.

3.1 Introduction

This section presents the District historical water demands and planning criteria that will be used for planning of water supply and distribution system improvements.

3.2 Population and Growth

In order to estimate the population and residential units within the District service area was obtained from two data sources: The Sacramento Area Council of Governments (SACOG) Regional Data Center and the US Census Bureau. With the District already at its build out capacity, the population is expected to remain steady for the next 25 years. The following population estimate data was used to prepare per capita water use estimates.

The District boundaries concur with four (4) minor zone boundaries 657100, 657120, 660200, and 660210 in the SACOG Regional Analysis District 9 Arden Arcade. The SACOG minor zones are shown in Figure 2. The SACOG data from 1995 – 2001 shows a general zero growth across the minor zone boundaries, which confirms that the District service area has been fully developed and reached build out. Table 3 shows estimated population and housing units for minor zones within District Boundaries and tabulated estimate of population per housing unit. The estimated 2.2 persons per household using the SACOG data is low for similar land use and density in Sacramento County and we assumed would trend upward during the planning period of the Master Plan.

Table 3: Population and Housing Estimates and Tabulated Density ^(a)

Minor Zone	Estimated Population	Housing Units
660200	2,421	1,188
660210	49	20
657100	2,520	1,043
657120	0	0
Total	4,990	2,251
Estimated Population/Housing Unit ^(b)		2.22

(a) Based on SACOG. Population and Housing for Sacramento County, by Minor Zone: 2002

(b) Rounded to nearest 0.01 unit

The data in Table 4 shows the population and housing unit density for the geographic area as prepared by the US Census Bureau national census data 2000. Population and housing unit density projections for several Census Data Places (CDP) in Sacramento County were reviewed to develop an average for similar land use and development density.

The CDPs shown in the table below were selected based on their similar socio-economic and geographical characteristics with the District.

Table 4: Population and Housing Units Density

Geographic Area	Housing Units Per Square Mile	Population Per Square Mile	Population Per Household
Arden Arcade CDP	5084.9	2373.3	2.14
Carmichael CDP	4622.2	1987	2.33
Citrus Heights City	5929.3	2432.3	2.44
Fair Oaks CDP	2832.7	1159.2	2.44
Foothill Farms CDP	7528.2	2950.6	2.55
Florin CDP	4896.1	1700.8	2.88
Gold River CDP	3011.1	1229.1	2.45
La Riviera CDP	5649.1	2467.9	2.29
Orangevale CDP	2663.5	1007.2	2.64
Rio Linda CDP	1911.2	656.7	2.91
Del Paso Manor WD estimated Population/Household			2.51

(a) Based on US Census Bureau GCTPH1. Population, Housing Units, Area, and Density: 2000

Nine out of the ten (10) similar census data areas indicated higher population per household than Del Paso Manor. The District, although fully built out, could experience an increasing trend with water use due to increasing population per household. The future District persons per dwelling projection assumes the residential neighborhoods will tend to see a transition from older single and two person residential profile to three to four person per household families. For this reason the composite value of 2.51 persons per household is used for future water projections and reflects a potential increase of 13 percent.

Existing water use values have been reviewed based on the estimated 2.22 persons per household discussed above.

3.3 Water Use

This section presents historical water use and the development projected District water demands based on existing water use patterns.

3.3.1 Historical Annual Water Use

The annual historical District water demands and average gallons per capita day (gpcd) usage for 1998 - 2007 are provided in Table 5 based on groundwater supply well production records. Since the District does not have water meters installed at each connection to provide a full account of actual water demand, water supply data as provided in Section 3.2.1 is assumed to be equal to water demand. Typically there is a loss factor resulting from leaking pipes or illicit connections that causes actual customer demand to be lower than the supplied flow. Since the District is at a build out condition, the average day demand used for calculating Maximum Day and Peak Hour demand is 1.50 MGD.

Table 5: Historical Water Use 1998 - 2007

Year	Annual Water Use		
	Acre-Feet	Million gallons per day (MGD)	Average Day Demand (gpm)
1998	1,545	1.38	958
1999	1,794	1.60	1,111
2000	1,801	1.61	1,118
2001	1,793	1.60	1,111
2002	1,693	1.51	1,049
2003	1,476	1.32	917
2004	1,747	1.56	1,083
2005	1,657	1.48	1,028
2006	1,654	1.48	1,028
2007	1,638	1.46	1,014
Average	1,680	1.50	

Based on the historic water use the Average Day Demand is estimated to be 1.50 MGD (1,042 gpm) with an annual total water use of approximately 1,680 acre-feet.

3.3.2 Water Use and Customer Service Type

Water use calculations are reported several different ways depending on the intended use of the estimates. For example, in a land use planning document a generalized water duty by land use type might be used to estimate long range water demands associated with a county General Plan update. In this example you could expect to see a water duty for residential, multifamily residential, commercial, industrial, park, etc. Water districts however do not govern over land use and commonly assess water demands based on the existing community development profile lumping together the residential and all the services, business, professional, recreational, industrial and public water use as a composite of the water needed to support a given population. The future projects are then based on estimates of population growth with the assumption that the corresponding services, employment and recreation needed to support the standard of living associated with growth will result in similar water use. Sacramento County for example used a blanket 3 acre feet per acre water use estimate regardless of land use for many years in estimating long term water needs.

Water use and water conservation are becoming much more closely reviewed as limited water resources and escalating storage, treatment and conveyance costs push for greater management of our water resources.

The District annual water use is estimated at 1,680 acre-feet and the population is approximately 4,990 persons. Dividing total water used by total population served produces a water use number of 300 gallons per capita per day (gpcd) as an average day water use. This however ignores the impact of high water use types that include for the District two regional resources, County Club Plaza Mall and the AT&T western US telephone switching center. Backing out all the non-single family and duplex water use results in a lower per capita water use of 208 gpcd for purely the residential customer.

The United States Geologic Survey (USGS) *Circular 1268 Estimated Use of Water in the United States in 2000* compiled statewide water use values for public water supplies. USGS defined the Public Supply as follows.

Public supply refers to water withdrawn by public and private water suppliers that furnish water to at least 25 people or have a minimum of 15 connections. Public-supply water may be delivered to users for domestic, commercial, industrial, or thermoelectric-power purposes. Some public-supply water may be delivered to other public suppliers or used in the processes of water and wastewater treatment. Public-supply water is used for such public services (public uses) as pools, parks, and public buildings; or be unaccounted for (losses) because of system leaks or such non-metered services as firefighting or the flushing of water lines.

The USGS 2000 water use numbers provide the basis for our calculating an estimated California statewide average, weighted by population, of 203 gpcd for the public water supply.

Table 6 provides a summary of selected counties and calculated per capita water use using the USGS Circular 1268 data.

The District composite water use number of 300 gpcd appears high when compared to the statewide average of 203 gpcd and the county by county number shows above. However, the relative contribution of water use from the regional mall and western US call center equipment cooling towers must be taken into account in considering realistic conservation opportunities and goals.

Table 6: Residential Water Use 2004 - 2007

County Name	Water Use – Public Supplied (gpcd)	Percent of Total Water Used in California
Sacramento County	261	5%
Placer County	267	1%
Yolo County	299	1%
San Francisco County	109	1%
San Diego County	185	7%
San Bernardino County	273	6%
Orange County	190	8%
Los Angeles County	185	26%
Riverside County	294	7%

The following sections present a further review of District water use by customer type.

3.3.2.1 Customer Service Type

Water use varies by customer type, class and practice. The District’s largest customers include AT&T, schools and parks and reflect <1% (14 services) of the service connections consume approximately 44 percent (730 acre feet per year). The summary below breaks out water use based on District meter data by customer type. Residential single family and duplex service type is metered and the values are estimated.

The District has approximately 1,796 total water service connections reflecting all classes of service. The District service profile breakdown is as follows:

- ❑ 1,611 connections (94.4%) Residential Use
- ❑ 92 (0.6%) Multi-Housing Use (81 flat rate and 11 metered)
- ❑ 69 (3.7%) Commercial Use
- ❑ 24 (1.3%) combinations of institutional, irrigation, and fire protection

The estimated water use per connection type is presented in the following sections.

3.3.2.2 Residential


The population served within the District is estimated at 4,990 occupying 2,251 housing units. The total number of housing units includes apartments, duplex and single family accounts. The total metered water use was used as the starting point for developing the estimates below by backing out non-residential water use and apartment water use figures.

The non-metered water use was adjusted for a 10% unaccounted for water loss prior to assigning the remaining unmetered production for single family and duplex unit water consumption. The estimated single family and duplex unit water use is presented in Table 7 below.

Table 7: Residential Water Use 2004 - 2007

Description	2004	2005	2006	2007
Residential Water Use (gpd)	891,860.4	787,791.6	772,455.3	677,732.8
Number of Residential Accounts: SFR	1,611	1,611	1,611	1,611
Number of Residential Accounts: Duplex	81	81	81	81
Total Number of Households	1,773	1,773	1,773	1,773
Residential Water Use (gallons/household)	503.0	444.3	435.7	382.3
Average Population (persons/household)	2.21	2.21	2.21	2.21
Residential Water Use (gpcd)	227	201	197	173

The estimated water use in gallons per capita per day (gpcd) value is often used to compare water use of different agencies. The District records indicate a declining per capita water use over the period from 2004 to 2007 of almost 24% (54 gpcd). The review of the monthly data presented below shows a marked decline in summer water use for 2007 that is uncharacteristic of the typical demand pattern for the District and we have disregarded the 2007 water use numbers in estimating the average per capita water demand.

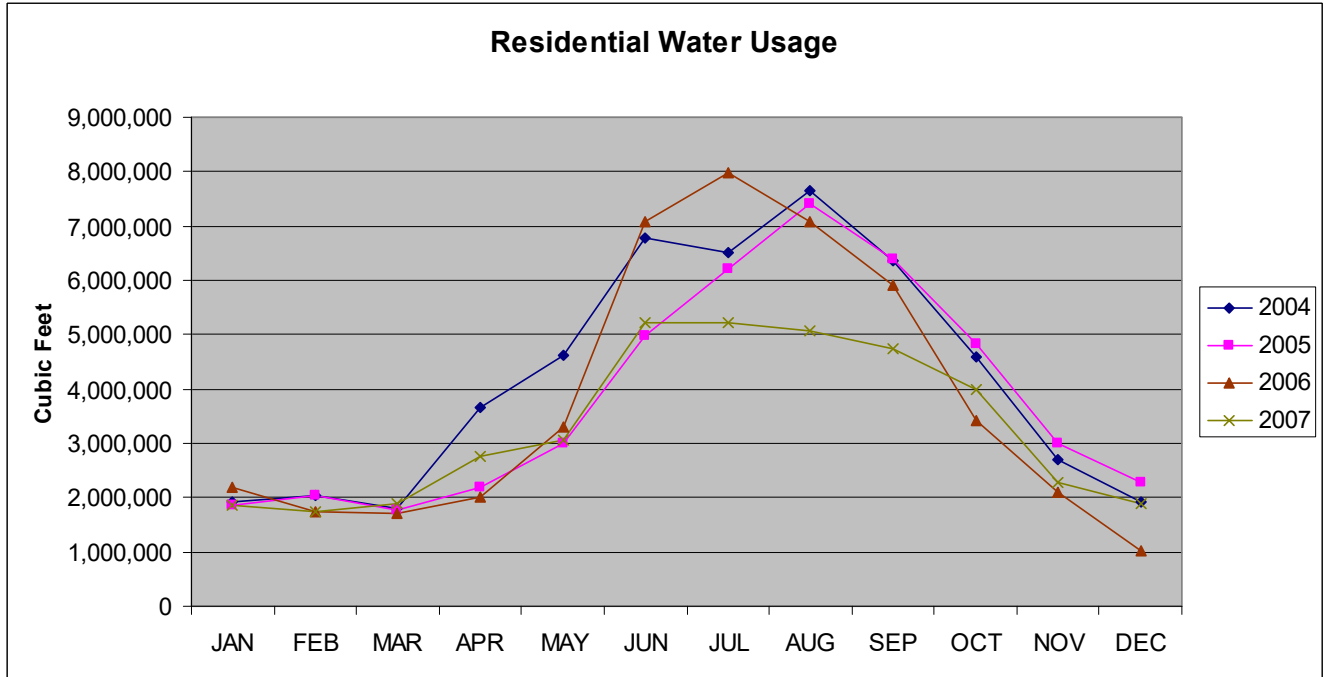


The estimated average per capita water demand is 208 gallons per capita per day based on estimated water use for the period 2004 through 2006.

3.3.2.3 Non-residential, Commercial and Institutional/Parks

The commercial water use is predominantly serving cooling tower equipment operated by AT&T for cooling of their telephone service centers. The summer maximum month water use for AT&T complex is approximately a 460 gpm contribution to Maximum Day Demand. The winter demand goes as low as 12 gpm in January- February when evaporative cooling demands are down. For the purposes of estimating water demand for this master plan we have assumed an average annual water use of 300 acre feet per year and a Maximum Day Demand of 460 gpm.


The chart below presents an overview of the non-residential water distribution within the District for 2007.

Historically institutional and park water use come from three schools and one park. The County of Sacramento added two metered accounts starting in 2006 for the Watt Ave Beautification project median landscape irrigation. District water use records indicate 88 acre-feet per year and an increase starting in 2006 of approximately 12 acre-feet per year for the County project. The estimated total for this class is 100 acre-feet per year. This equates to approximately 62 gpm average day demand.

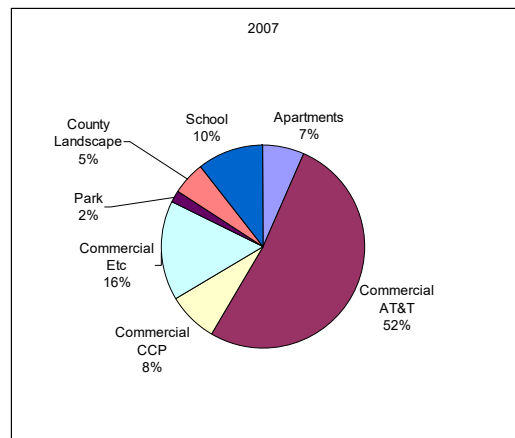

The estimated maximum day water demand from non-residential demands is 522 gallons per minute (460 gpm AT&T plus 62 gpm institutional and park demand.) The total estimated maximum day demand is estimated at 3,056 gpm. The non-residential demand reflects approximately 17 percent of the instantaneous water demand during a maximum day use condition.

The annual water use from non-residential demands is approximately 44% of the total water used in the District. The annual water use, measured in cubic feet per month in the graph below, shows how water use increases from March through December and produces a high total annual water. This seasonal water use corresponds to the increased equipment load needed for the AT&T cooling towers.

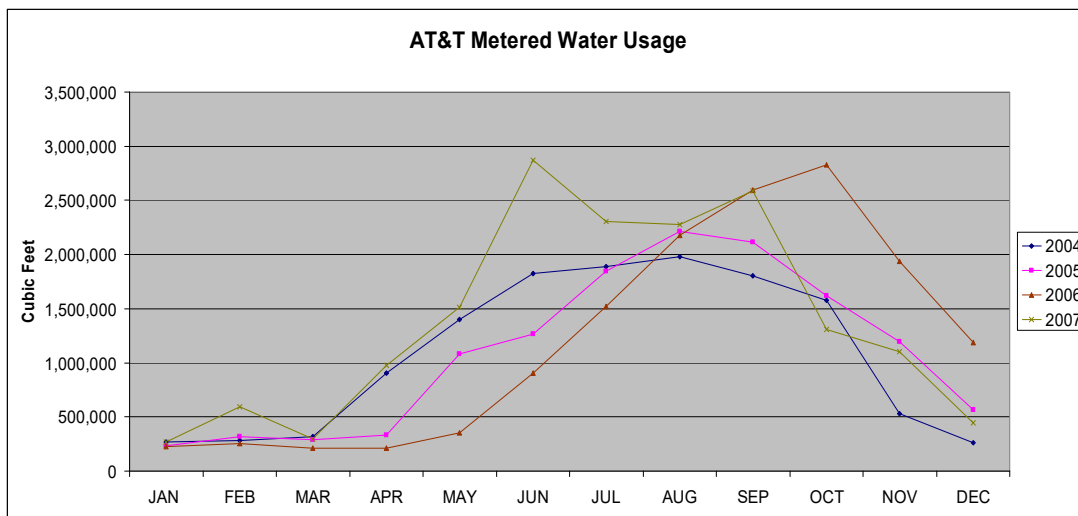

3.3.3 Water Meters

The District has meters installed at approximately 90% of its commercial accounts, one park, and three schools. Private residences are not currently metered and it is the Goal of the District to install meters at each District service connection by 2030, or sooner depending on the District’s potential future agreements with surface water providers.

The Water Forum agreement includes requirements for the District when discretionary approval is required for new or expanded surface water supplies. In this case, the District would be required to annually retrofit 3.3%-5% of the total number of unmetered residential connections and read and bill in accordance with the Water Forum Conservation Element.

The existing District water lines are located along the back lot lines and are generally inaccessible without entry into the individual residential yards. The existing back lot pipelines are fifty plus years old and the PSM recommendations include replacement of these pipeline with new pipelines in the front right of way by the meter deadline of 2030. It is therefore recommended that the installation of meters in the backyards be avoided and that meter setters be installed with the pipeline replacement projects. Upon completion of the pipeline replacement projects the entire District can be converted to a metered district with the installation of all meters at once. The installation will coincide with the start of conversion to a commodity based water rate.

3.4 Water Demand Criteria

The following provides an evaluation and determination of water use data for determination of water supply needs. The demand criteria is based on historic water use within the District and with similar water agencies in Sacramento County.

3.4.1 Demand Projections

Water demands fluctuate throughout the year and day with changes in weather, landscape irrigation practices, and other activities. For this reason, water demands under varying conditions are calculated to provide the basis for the District's water supply and distribution system capacity.

The key water demand periods used for planning purposes are as follows:

- **Average Day Demand:** The average of total water consumption over a year. For the District, the Average Day Demand over the past ten years is 1.5 MGD.
- **Maximum Day Demand:** The highest daily demand in a one year period. This demand period typically occurs during hot summer weather.
- **Peak Hour Demand:** The average water use during the highest hour of use in the year. Peak hour demand may or may not occur on the same day of Maximum Day Demand.

The peak factors used in this Master Plan are developed further in Section 3.4.4.

3.4.2 Fire Protection, Jurisdiction and Estimated Fire Flow Criteria

This section of the Master Plan addresses the existing District water system flow capacity and provides a source capacity targets for planning future water system Planned System Maintenance projects.

The existing District water system is used by the Sacramento Metropolitan Fire Department (SMFD) for water supply during testing and when responding to a structure fire within the District. The District requirements for water supply are defined in Title 22 of the California Code of Regulations (CCR) Chapter 16 California Water Works Standards. Title 22 does not require a public water system to provide fire flow as a minimum condition of service. Fire protection requirements for building permit approvals is in the jurisdiction of the SMFD and the not the District.

The SMFD conducts periodic fire hydrant testing in the District including high demand locations such as Country Club Plaza. The SMFD has not advised the District of any deficiencies with the existing system providing a level of service consistent with SMFD expectations. Title 22, although not requiring a minimum supply for fire flow, does stipulate a minimum operating pressure of 20 pounds per square inch, including under a fire flow condition.

Review of existing SMFD records by the District identified a 3,500 gpm fire demand for the 3540 Kings Way AT&T Building and was the maximum value discovered during the review. Kennedy/Jenks review of the residential demand resulted in a range from 1,500 gpm for the

bulk of the District's neighborhoods and 2,750 gpm for the larger residential homes in the Winding Creek area of the District. Based on this research, 3,500 gpm has been used as the maximum fire flow demand that can be expected and this have been included in the minimum source capacity calculations of this Master Plan. The planned system replacement will result in a water supply and system capable of meeting or exceeding the fire flow criteria presented above.

3.4.3 Unaccounted-for Water

Unaccounted-for water is the difference between water production and the metered demand. A portion of this water may be from system leaks. Underground leaks could be located in lines, service lines, residential meter boxes, valves, and they are usually associated with excessive pressures, ground settlement, improper installation, or improper materials. According to American Water Works (AWWA) Water Audit and Leak Detection Guidebook, water losses other than leakage can generally be attributed to hydrant flushing of pipelines for O&M purposes, fire hydrant flows for fire fighting, construction practices, illegal connections, malfunctioning distribution system controls, reservoir seepage and leakage, and theft.

In a Municipal Leak Detection Program Loss Reduction document prepared for the state of California Department of Water Resources, Office of Water Conservation, it is estimated that the average unaccounted-for water in the State of California is 9.5 percent.

Currently, water usage is accounted for by metering the District's largest water users: commercial, multi-family residential, and park/landscaping accounts. Once the residential water use is metered as discussed in earlier section of this document, the District will be able to more accurately track the losses throughout the system.

For purposes of the Water Master Plan, unaccounted-for water usage has not been included in the average day water demands and per capita water usage.

3.4.4 Peaking Factors

The water system peaking factors were calculated based on the District's average historical water use from 1998 – 2007 using the provisions provided in the current edition of the Title 22 California Code of Regulations Chapter 16 California Waterworks Standards §64554 (Waterworks Standards). The Waterworks Standards prescribes methods to be used for calculating peaking factors when daily or monthly data is available. The calculated water demands are shown in Table 8. With the District reaching its build out capacity, it is anticipated that the District water demands will undergo little or no change.

Table 8: Peak Demands and Factors

Demand Period	Water Demand		Peaking Factor	Basis for Calculation
Average Day	1.50 MGD	1,042 gpm	1.0	District Records (1998 – 2007)
Maximum Month Daily Average	2.93 MGD	2,035 gpm	1.95	Maximum monthly demand from the last 10 years of supply operation divided by number of days where maximum monthly demand occurred
Maximum Day Demand	4.40 MGD	3,056 gpm	2.93	Max Month Daily Average Demand times 1.5 peaking factor
Peak Hour Demand	6.60 MGD	4,580 gpm	4.40	Estimated Max Day Demand times 1.5 peaking factor divided by 24 hours

3.5 Water Conservation

Water conservation requirements continue to change in California. Water use restrictions for dry years have been in place for water suppliers relying on surface water. The District relies solely on groundwater for supply and is not subject to surface water conservation requirements. The District Conservation regulation document provides for guidelines as follows:

- ❑ When outside watering is required, residents or businesses with odd address numbers may water only on Tuesdays, Thursdays, or Saturdays. Even numbers may water only on Wednesdays, Fridays, or Sundays. Watering on Mondays is prohibited.
- ❑ Open hoses are not permitted. Automatic shut-off nozzles are required.
- ❑ Car washing may be done only with a bucket. Rinsing may be done with a hose equipped with a shut-off nozzle.
- ❑ Washing down of sidewalks, driveways, parking lot, or other paved surfaces is prohibited.
- ❑ All swimming pools, ponds, fountains and evaporative coolers shall be equipped with recirculating pumps.

The existing policy provides for the District Board implementing, by resolution, some or all of the above conservation requirements.

Enforcement includes oral warning for the first offense, written violation notice for the second offense and citation for the third offense. Citation penalties may include a fine, a requirement for meter installation, and/or termination of water services as determined by the General Manager.

Future baseline non-conservation water use goals may approach or exceed twenty percent (20%) in the coming years as the State of California continues to take a harder look at water use sustainability, climate change and pursues an active role in local water use patterns. The District

can expect to be exempt from some requirements due to the size of the District but can expect increasing pressure to reduce water use over time. Water conservation should continue to be a key element of managing the District supply.

3.6 Reliability and Redundancy

Water system reliability and redundancy are generally defined by the California Code of Regulations, Title 22 Water System Standards to include the following:

- ❑ The system must have sufficient supply capacity to meet the Maximum Day Demand (MDD).
- ❑ A Community water systems using only groundwater shall have a minimum of two approved sources before being granted an initial permit and the system shall be capable of meeting MDD with the highest-capacity source off line.

The District currently operates 8 wells with a pumping capacity of 4,275 gpm with the largest well offline. The MDD is approximately 3,056 gpm. The District meets the minimum required water source capacity as identified above. The existing well condition and capacity is discussed further in Section 4.

The peak hour demand (PHD) exceeds the MDD and water systems can meet this daily peak usage through additional supply pumping capacity or through storage. In addition, emergency and fire protection water supplies can be provided using additional supply pumping capacity of storage. The District relies on additional supply through well capacity to meet peak hour demand. Use of peaking wells avoids the need for surface tanks and booster pumping capacity within the District. The PHD is estimated at 4,580 gpm and with the installed pumping capacity of 5,375 gpm the District meets the PHD.

Fire protection water demand ranges from a low based on typical residential criteria of 1,500 gpm to the higher commercial and multifamily fire flow of 3,500 gpm. The District supply may not be sufficient to provide fire protection supply in excess of 2,500 gpm.

Hydropneumatic tanks are designed to maintain system pressure and do not provide significant storage. A 5,000 gallon District hydropneumatic tank volume provides approximately 1,650 gallons net storage when full and there are 5 tanks for a net maximum stored volume of less than 10,000 gallons. Although five (5) wells are equipped with hydropneumatic tanks this onsite volume of water is minimal and is not considered storage. A typical minimum storage volume a similar district would be calculated as follows:

- ❑ 880,000 Gallons Peak Equalization based on 20% of the Maximum Day Demand, and
- ❑ 960,000 Gallons Fire Protection Supply based on 4,000 gpm for 4 hours, and
- ❑ 1,100,000 Gallons Emergency Supply for reliability.

The estimated minimum storage for a similar district without well capacity to exceed the MDD would be 3 million gallons.

An additional element of redundancy that improves reliability is access to alternative power supply of mechanical engine drivers to continue operating the wells during a power outage. The District maintains two backup systems as follows:

- Natural Gas Engine Drive Well Nos. 6 and 8, and
- Portable electrical generator capable of starting Well No. 2 or 4.

Based on the backup systems the District has approximately 2,700 gpm and should be able to maintain system water pressure in the event of an extended regional power outage. Additional redundancy exists in the electrical grid due to the three substation circuits serving the District. Historical power outages rarely extend to more than two (2) substations servicing the District at any given time.

3.7 Water System Standards and Design Criteria

The water system design criteria presented in this section are recommended to maintain a high level of service and to ensure adequate flow and pressure characteristics throughout the distribution system. Ongoing efforts to manage system hydraulics will help to minimize operation and maintenance activities and costs. The minimum recommended design standards for the water distribution system include the following:

- Design all piping, valves and appurtenances for a minimum pressure of 150 pounds per square inch (psi). This will allow for the system to accommodate normal operating pressures and transient surges.
- Design or select water system materials and components to meet or exceed American Water Works Association (AWWA) standards.
- Loop the distribution system to the greatest extent practical to avoid dead end pipes. Where dead ends are unavoidable, such as on some dead end streets, a minimum water main line size of 6 inches be used to reduce system residence time in the dead end line.
- The minimum distribution system pipe loop diameter should be 8-inch to help ensure that minimum fire flows to hydrants are achievable.
- Design water mains so that the velocities under average day, maximum day, and peak hour conditions are less than 3 fps, 5 fps and 7 fps, respectively. This will reduce damage to pipe linings and valves and minimize excessive head loss. Ultimately, this will help preserve the life of the pipeline and will contribute to lower maintenance costs.
- Design pipes for a target velocity under a fire flow of 10 foot per second and a maximum velocity under maximum day plus fire flow of 13 foot per second.
- Size all mains to limit head loss to three feet per 1,000 feet of length under average day conditions per AWWA recommendations. This is based on an analysis of optimum pipe sizes for lowest total cost of pipeline and pumping costs.

Table 9 summarizes additional distribution system design criteria. The pressure values presented are consistent with existing operating conditions. Friction coefficient values decline with pipe age and it is reasonable to assume that the existing system is operating at between 110 to 120 “C” value for the asbestos pipe and perhaps 90 to 110 “C” value for the steel lines. Steel lines tend to accumulate deposits and the combination of reduced inside diameter from accumulations and increased roughness results in the lower “C” value estimate.

Table 9: Water Distribution System Design Criteria

Item	Criteria
Hazen-Williams “C” factor (Friction Coefficient)	130 for all new pipes
Average water system pressure	50 psi
Minimum water system pressure under peak hour water demand conditions	40 psi
Minimum water system pressure under maximum day water demand conditions	40 psi
Minimum water system pressure under maximum day plus fire water demand conditions	20 psi
Maximum water system pressure	80 psi

Section 4: Water Supply Planning

4.1 Introduction

This section provides documentation of the water supply availability in the District, and provides recommendations for new supply.

4.2 Groundwater Supply

The District currently maintains eight (8) wells to meet all of the District water demands. The District has been pumping on average 1,680 acre-feet per year using Wells 1 and 8 as lead producers. Wells 2, 3 and 4 provide peaking demand and Wells 6 and 7 are the last wells to come on line to meet system demand.

The District is a member of the Sacramento Groundwater Authority (SGA) and Regional Water Authority (RWA) and active participant in regional and groundwater basin planning efforts. The aquifer utilized as the pumping resource by the District is identified by SGA/RWA as not being in overdraft and there are no indications that continued pumping by the District at approximately 1,680 acre-feet per year is unsustainable.

The locations of the District wells are shown in Figure 5. Table 10 below provides a summary of the estimated capacity of the District's wells based on the original installed pump design operating point and current operating observations from District staff.

Table 10: Well Production Capacity Summary

Well No.	Pumping Capacity
1	500 gpm
2	460 gpm
3	580 gpm
4	500 gpm
5 ^(a)	460 gpm
6	1,100 gpm
7	675 gpm
8	1,100 gpm
Total Capacity	5,375 gpm
Total Capacity with Redundancy ^(b)	4,275 gpm

(a) Well No. 5 is the last well to come on line.

(b) Redundancy is total system capacity with largest District well (1,100 gpm) offline.

4.3 Surface Water Supply

The District and the City of Sacramento (City) executed an agreement in 1968 establishing conditions for transfer of up to 6.8 cubic feet per second, or 2,460 acre-feet annually of the City's surface water supply to the District through the Area D water service area. This maximum delivery flow is 3,048 gpm and is equivalent to the District MDD of 3,056 gpm. The City has planned for supplying Area D with surface water through their Fairbairn Water Treatment Plant and 54-inch diameter Howe Avenue transmission main.

The District completed a Conjunctive Use Plan evaluating alternatives for developing a surface water supply and participating in groundwater wheeling with neighboring districts in September 2008. The initial findings of the evaluation are the basis for preliminary implementation cost estimates presented in Section 5 of this report.

4.3.1 Interties with Other Districts

The District is active in the water supplier community participating in the Regional Water Authority, Sacramento Groundwater Authority and Water Forum and successor activities. The District has two (2) existing interties and multiple locations for potential interties with Sacramento Suburban Water District (SSWD) and has participated in planning additional connections associated with new pipeline installations by SSWD.

4.3.1.1 Mutual Aid Agreements

The District maintains Mutual Aid Agreements with SSWD and the Carmichael Water District to provide technical and emergency support as part of providing redundancy in District resources to address unforeseen events.

4.3.1.2 Surface Water Supply Agreements

The District and the City of Sacramento executed an agreement over 40 years ago allocating City surface water supply for District use in the future. The specifics of this agreement are discussed in greater detail in the Conjunctive Use Plan.

4.4 Findings and Recommendations

The District is capable of meeting system demands for all normal operating conditions. Although the District relies solely on groundwater, indications are that the groundwater basin is not in overdraft and the continued water use at the historic extractions is a sustainable operating practice.



Table 11 provides a summary of the water supply availability with associated demand conditions. The water system demand criteria is discussed further in Section 3.4 and Table 8.

Table 11: Water Supply Availability

Demand Condition	Demand (gpm)	Water Availability (gpm)	Surplus or <Deficit> (gpm)
Average Day	1,042	5,375	4,333
Maximum Day ^(a)	3,056	4,275	1,219
Maximum Day Plus Fire ^(b)	6,556	5,375	<1,181>
Peak Hour	4,580	5,375	<795>

(a) Maximum Day supply assumes the single largest well offline as shown in Table 10.

(b) Maximum Day plus Fire flow demand are based on a maximum fire flow demand of 3,500 gallons per minute for a minimum for four hours.

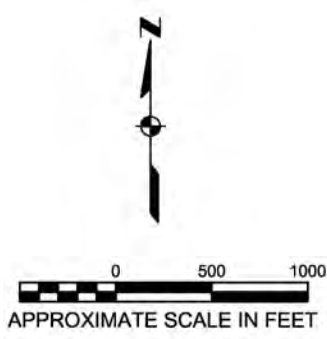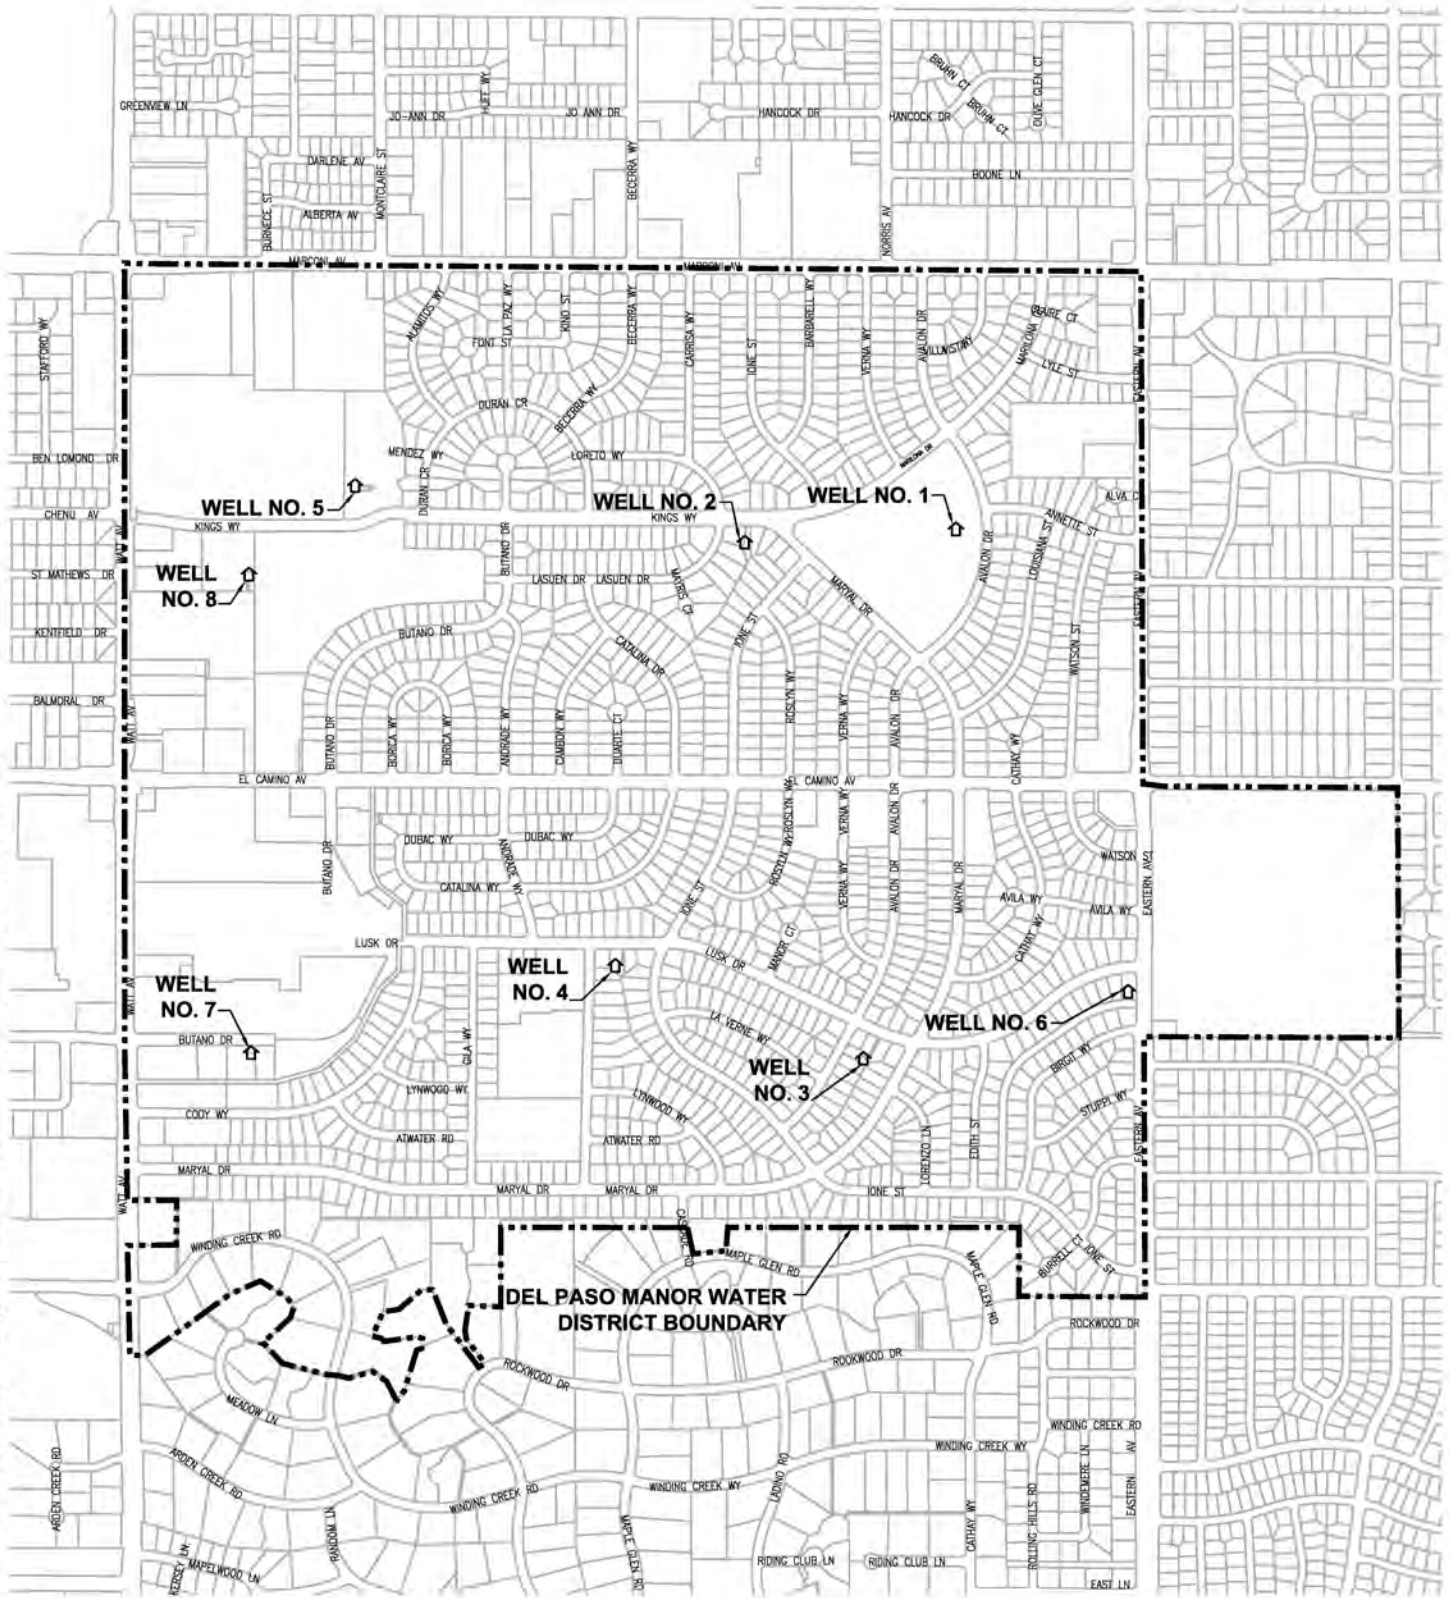

Kennedy/Jenks Consultants
 DEL PASO MANOR WATER DISTRICT
 SACRAMENTO, CALIFORNIA
 MASTER PLAN
 EXISTING WELL SITES
 K/J 0870017.00
 APRIL 2009
FIGURE 5

Section 5: Conjunctive Use

5.1 Introduction

Kennedy/Jenks has provided the District with a Conjunctive Use Plan to present recommendations for implementing a conjunctive use program, whereby the District will continue to utilize its groundwater resources and supplement with imported surface water, either through existing or new contract mechanisms to help accomplish the following objectives:

- Enhance water supply reliability and redundancy for District customers by maintaining both groundwater and surface water source supplies.
- Participate in regional management efforts to ensure the continued sustainability of the groundwater basin.

The Conjunctive Use Plan includes a discussion of the many factors that impact local and regional groundwater resources, and consideration of their potential implications on the District. The discussion includes a summary of efforts to manage historical declining groundwater elevations and migrating groundwater contamination plumes, and partnering agreements that have moved the Sacramento region towards implementation of a managed conjunctive use effort to ensure a sustainable water supply.

After the groundwater resources setting, a focused review of the District's conjunctive use considerations is provided including the following:

- Survey of potential surface water/groundwater use ratios and justification for each case.
- Comparison of several potential surface water supply alternatives to import surface water from neighboring water purveyors (including the City of Sacramento, Sacramento Suburban Water District, and Carmichael Water District).
- Alternatives for infrastructure improvements that would be required to import surface water into the District, depending on the surface water supply alternative that is selected.

5.2 Findings Summary

The following presents a list of findings presented in the Conjunctive Use Plan:

District Water Supply

1. The District desires to provide a safe and reliable drinking water supply to its customers.
2. The District's average annual water demand is approximately 1,680 acre-feet/year.
3. The District's existing source capacity is dependant on 8 groundwater wells ranging in age from 30 years to in excess of 60 years old.

Groundwater Resources

1. The sustainable yield of the aquifer, as estimated by the Water Forum is 131,000 acre-feet per year. Historical groundwater pumping in the north Sacramento groundwater basin has ranged between 80,000 to 100,000 acre-feet per year.
2. Recent conjunctive use efforts (by SSWD to import PCWA surface water and CWD's Bajamont WTP) has decreased groundwater pumping and appears to have contributed to the stabilization of regional groundwater elevations.
3. Groundwater quality is threatened by both regional groundwater contaminant plumes to the west and east of the District as well as localized historical and ongoing potential contaminating activities (PCAs).
4. The District has participated in regional efforts, including the Sacramento Groundwater Authority and Water Forums to establish measures to ensure reliable water supplies region-wide. For this reason, the District would like to participate in conjunctive use efforts and import surface water to balance groundwater pumping.
5. The District has committed to implementing Water Forum Best Management Practices for water conservation.

Conjunctive Use Planning

1. The District does not have an established conjunctive use numerical goal.
2. In 2004, SGA staff proposed a conjunctive use allocation. The proposal was not successful in getting adopted, however it identified a possible conjunctive use goal of 300 acre-feet/year for the District.
3. Surface water may be more readily available in the winter, non-peak water demand months. Approximate average District water demand during the period between October and April is 640 acre-feet per year.
4. There are several possible groundwater banking opportunities if the District imports surface water. Opportunities include in-lieu groundwater recharge as well as aquifer storage and recovery.

Surface Water Alternatives

1. The District has access to surface water through a 1968 agreement with the City of Sacramento for up to 2,460 acre-feet per year of the City's Area "D" water.
2. There are several alternatives available to the District for importing Area "D" water into the District. Options include diverting and treating the water at the City of Sacramento and conveying the water through the City through SSWD to the District or diverting and treating the Area "D" water at Carmichael Water District and transferring the water directly from CWD to the District.

3. SSWD's north service area surface water from PCWA does not include the District in its Place of Use.
4. See Tables in Section 4 for additional detailed findings on surface water alternatives.

Interconnections

1. There are currently two recommended interconnection options for the District: construct an intertie with SSWD or CWD.
2. SSWD has built pipelines through and adjacent to the District, and as a result, an intertie would require only a metering station and short pipeline to connect to the District's distribution system.
3. An intertie with CWD would require an approximately 3,000 linear foot pipeline, metering station and pump station.
4. A permanent interconnection to SSWD would require the District to install fluoridation on its groundwater supply. A permanent interconnection with CWD would not require fluoridation.

5.3 Recommendations Summary

Following is a list of the recommendations that have been provided in the Conjunctive Use plan:

Section 2: Conjunctive Use Setting

1. The District should continue to participate in the Water Forum Successor Effort and support the agreement among the member agencies, and work cooperatively in solving the remaining water resources challenges being addressed in the Water Forum. It is also recommended that the District review and confirm it is implementing its BMP commitments, and develop a plan to complete any outstanding elements.
2. The District should continue its active role in the SGA and support the implementation of the regional management of the groundwater resources to achieve the goals defined in the Water Forum Agreement.
3. The District become more active in its role in the RWA and support the implementation of the regional management of the water resources to achieve District objectives the goals defined in the Water Forum Agreement.
4. The District should monitor and participate in the upcoming and subsequent future efforts to update the Integrated Regional Water Management Plan, and seek funding opportunities for conjunctive use and water management improvements.
5. The District should continue to participate in efforts to collectively manage and protect the North Area Groundwater basin from an overdraft condition.

6. The District should have a contingency surface water supply resource in place, and maintain mutual aid agreements with neighboring purveyors to offset lost groundwater supply resulting from contamination and other emergency conditions.
7. The District should be diligent about monitoring regional contaminant plume remediation, and work collaboratively with neighboring agencies to help ensure that the necessary measures are implemented to contain and remediate the plumes to the extent feasible. One possible avenue could be participation in the SGA's groundwater contamination task force.
8. Continue to monitor potential localized contaminating activities and implement wellhead protection measures as warranted.

Section 3: Conjunctive Use Goals

1. Establish an interim conjunctive use baseline goal of 300 acre-feet/year. Confirm goal would be in accordance with Water Forum Agreement groundwater management commitments pending future determination of conjunctive use objectives by the Water Forum Successor Effort or SGA Water Accounting Framework.
2. Any new surface water interties with neighboring water districts and infrastructure improvements should be sized to accommodate at minimum a 50/50 conjunctive use split.
3. Evaluate potential rate impacts for varying levels and sources of surface water through preparation of a rate study.
4. The District should continue to implement Water Forum Agreement demand conservation measures as warranted. Investigate means for measurable demand reduction as a component of the District's conjunctive use efforts.
5. It is recommended the District continue to explore participation in a groundwater banking program, either through the SGA efforts or a partnership with a neighboring agency.
6. Evaluate participation in local or regional groundwater banking partnerships. Monitor progress of SGA's Water Accounting Framework and proposals for a model groundwater banking program.

Section 4: Surface Water Supply Alternatives

1. The District should continue to explore opportunities to develop agreements with either the City of Sacramento and SSWD (for transmission) or CWD to import Area "D" surface water. Considerations should include the reliability of the water supply sources, required institutional arrangements and regulatory approvals, and evaluation of the annual costs of the water transfer and any capital improvement requirements.

Section 5: Surface Water Supply Infrastructure Improvements

1. For a surface water supply intertie with SSWD, provide a minimum 12-inch connection at the existing intertie stubout of SSWD's existing 24-inch pipeline near Maryal Drive and Gila Way.
2. For a surface water supply intertie with CWD, provide a 12-inch interconnection near the intersection of Eastern Avenue and Lusk Drive.
3. Interconnection locations should be finalized once the surface water alternative is selected. It is recommended that a new intertie should be constructed to connect to a new 12-inch distribution system "backbone" located within the District. Specific intertie location recommendations will be refined after completion of the draft Facilities Replacement Plan.

5.4 Direction Based on Board Review

The District Board review of the summaries above resulted in the direction to prioritize the process as follows:

- Begin Negotiations with Carmichael Water District for implementation of using surplus winter surface water treatment plant capacity at the Bajamont membrane plant. This would include resolution of the beneficial use of the 600 gpm remediated groundwater discharge to the American River at the Bajamont site as an offsetting flow allowing consideration for diversion of City of Sacramento water at the Carmichael Water District point of diversion using the existing river infiltration facilities.
- Begin Negotiations with the City of Sacramento to obtain support for the approach and to proceed with obtaining the regulatory water supply and diversion approvals needed to allow diversion of City surface water supplies at the Carmichael Water District point of diversion.
- Explore additional well construction potential within the District as a secondary water supply for Carmichael Water District to use in periods of low river flow and in the event the GenCorp/Aerojet groundwater contamination plume impacts existing Carmichael groundwater production.

The effort to bring the use of surface water to the District using this approach will be a multi-year process. The estimated costs of these alternatives are discussed in the Conjunctive Use Technical Memorandum and are opinions as to the order of magnitude of cost. Additional detail, discussions and planning are recommended as part of refining the costs as the negotiations and process moves forward.

Section 6: Facilities Replacement Planning

6.1 Introduction

All facilities wear out and need to be replaced over time. The useful period of service for equipment varies with the process, maintenance, and service conditions. For example, a submersible well pump will typically not last as long as an aboveground vertical turbine well pump. Small equipment wears out faster than larger equipment, fixed assets such as wells and tanks last longer than equipment with moving parts such as pumps.

This evaluation includes consideration of the current overall age and condition of the District's groundwater facilities, pipes, and tanks. This section provides a summary of the existing state (capacity and condition) of the District's groundwater supply production capacity and recommendations for supplementing and replacement of the supply sources. Pipeline assets are reviewed and recommendations to replace provided.

6.2 Production Capacity Considerations

The District currently relies on eight existing groundwater wells to meet water demands. In a condition with the highest capacity production well offline, it appears that the District is able to meet Maximum Day demand as required by the California Waterworks Standards, but would not be able to meet Maximum Day plus Fire demand, and would marginally not be able to meet Peak Hour demands. Because Maximum Day plus Fire is the highest demand period criteria, it is the controlling factor.

6.3 Existing Well Ages and Condition

All of the existing wells exceed a typical well useful life expectancy of 30 to 50 years. While the useful life expectancy is not a steadfast time period, it does serve as a general indicator for when one may expect to begin to see signs of wear and failure of the well. Typical signs may include pumping sand, diminished water production, casing or screen collapse, and pump and motor failure. Specific well replacement recommendations, detailed well site investigations, and other considerations are provided in the separate Draft Facilities Replacement Plan document.

Table 12: Well Age and Current Production Capacity Summary

Well No.	Year Built	Age in Years	Projected Useful Life	Remaining Useful Life	Notes
1	1946	62	30	<32>	Recent inspection and in fair condition
2	1948	60	30	<30>	No recent inspection
3	1949	59	30	<29>	No recent inspection
4	1951	57	30	<27>	No recent inspection
5	1953	55	30	<25>	Recent inspection – poor condition and now out of service
6	1956	52	30	<22>	No recent inspection
7	1956	52	30	<22>	No recent inspection
8	1977	31	30	1	Recent inspection and in good condition

The following is an assessment of Well Nos. 1 – 8. The well assessment is based on evaluation of the District’s record of pump test reports for Well Nos. 1 – 8. The oldest and newest available data for standing water level, drawdown, discharge head, and efficiency were reviewed and tabulated to capture the change in groundwater level, well’s performance by specific capacity, and impact to well motor over time.

The well pump motor horsepower required estimates presented below are based on observed well drawdown data and reflect the impact of declining groundwater tables over the last 50 years since the majority of the well pumps were installed. These estimates are for predicting stress on the electrical elements of the motor and possible impacts to reliability of equipment under increased operating loads. The estimated motor load assumes a low 70% motor/pump efficiency value associated with the older motors.

6.3.1 Well No. 1

Well No. 1, built in 1946, has a 12-inch diameter casing constructed to a total depth 500 feet. The well was initially pump tested at 1,200 gpm with a 62 feet drawdown during pumping. Well No. 1 is equipped to provide 500 gpm and is the second lead system supply well following lead well, Well No. 8.

- Recorded Static Water Level – The 1946 static water level was not recorded but first water identified at 55 feet. The driller reported 1,200 gpm at 62 feet of drawdown demonstrating a high specific capacity. Pump test report data from 1956 shows a recorded static water level of 64.60 ft and data from 2000 recorded a static water level is 118 ft below the pump discharge level. This indicates a 53.4 foot decline in the water table at this well site.

- ❑ Recorded Specific Capacity - Pump test report dated 1956 shows a recorded specific capacity of 68.10 gallons per minute per foot of drawdown (gpm/ft). Pump testing in 2000 documented a specific capacity of 42.30 gpm/ft.
- ❑ Change in Specific Capacity - Between 1956 and 2000 data, specific capacity decreased by 37.9%. Data shows a generally consistent declining trend.
- ❑ Impact to Motor/Pump - According to pump test data recorded in 1956, total HP required to pump at 500 gpm well capacity is 37.73 HP. In 2000, the total HP increased to 50.93 HP. Assuming that Well No. 1 pump has a built in service factor of 5% to a service capacity of 52.5 HP, the Well No. 1 pump exceeds the name plate horsepower but does not exceed the service capacity as of 2000.
- ❑ This well has been equipped with a variable frequency drive (VFD) for reduced flow at start up to reduce drawing sand through the wall slots. The VFD allows the well pump to match demands in the vicinity by speed up and slowing down based on system demand. This has resulted in a consistent system pressure in the northeast District area.

This well was serviced in 2007 with the casing hole bailed to total depth and video inspected. The video review showed considerable cascading metal scale and a mottled surface characteristic of generally uniform corrosion across the surface of the casing. The well casing perforations were consistent with a mills knife with visible enlargement of the slots. Increased sand production has been observed, consistent with the slot enlargement.

6.3.2 Well No. 2

Well No. 2 was constructed in 1948 with maximum pumping capacity of 460 gpm.

- ❑ Recorded Static Water Level – Well measurements in 1959 recorded a static water level of 59.80 ft below the pump discharge level. Data in 2000 documented a water table decreased by 64.70 ft and the recorded static water level was 124.50 ft below the pump discharge level. This indicates a 59.8 foot decline in the water table at this site.
- ❑ Recorded Specific Capacity - Pump test report data from 1959 documents a specific capacity of 62.70 gpm/ft while data from 2000 shows a decrease to 33.30 gpm/ft.
- ❑ Change in Specific Capacity - Between 1959 and 2000 data, specific capacity decreased by 46.9%. Data shows a generally consistent declining trend.
- ❑ Impact to Motor/Pump - According to pump test data recorded in 1959, total HP required to pump at 460 gpm well capacity is 36.07 HP. In 2000, the total HP increased to 51.64 HP. Assuming that Well No. 2 pump has a built in service factor of 5% to a service capacity of 52.5 HP, the Well No. 2 pump exceeds the name plate horsepower capacity but does not exceed the service capacity as of 2000.

6.3.3 Well No. 3

Well No. 3 was constructed in 1949 with maximum pumping capacity of 580 gpm.

- ❑ Recorded Static Water Level – Well measurements in 1956 recorded a static water level of 50.40 ft below the pump discharge level. In 2000, the water table decreased by 64.60 ft and the recorded static water level was 115 ft below the pump discharge level.
- ❑ Recorded Specific Capacity - Pump test report dated 1956 shows a recorded specific capacity of 41.50 gpm/ft. In 2000 the specific capacity had decreased to 29.70 gpm/ft.
- ❑ Change in Specific Capacity - Between 1956 and 2000 data, specific capacity decreased by 28.4%. Data shows a generally consistent declining trend.
- ❑ Impact to Motor/Pump - According to pump test data recorded in 1956, total HP required to pump at 580 gpm well capacity is 40.62 HP. In 2000, the total HP increased to 56.45 HP. Assuming that Well No. 3 pump has a built in service factor of 5% to a service capacity of 52.5 HP, the Well No. 3 pump exceeds both of the name plate horsepower and the service factor as of 2000.

6.3.4 Well No. 4

Well No. 4 was constructed in 1951 with maximum pumping capacity of 500 gpm.

- ❑ Recorded Static Water Level – Measurements in 1956 shows a recorded static water level of 57.70 ft below the pump discharge level. In pump test report dated 1999, the water table decreased by 62.30 ft and the recorded static water level is 120 ft below the pump discharge level.
- ❑ Recorded Specific Capacity - Pump test report dated 1956 shows a recorded specific capacity of 64.70 gpm/ft. In pump test report dated 1999, the specific capacity increased to 85.70 gpm/ft.
- ❑ Change in Specific Capacity - Between 1956 and 1999 data, specific capacity increased by 32.5%. Data shows a generally increasing trend.
- ❑ Impact to Motor/Pump - According to pump test data recorded in 1956, total HP required to pump at 500 gpm well capacity is 38.90 HP. In 2000, the total HP increased to 54.84 HP. Assuming that Well No. 4 pump has a built in service factor of 5% to a service capacity of 52.5 HP, the Well No. 4 pump exceeds the name plate horsepower and service factor as of 1999.

6.3.5 Well No. 5

Well No. 5 was constructed in 1953 with maximum pumping capacity of 460 gpm.

- ❑ Recorded Static Water Level – Measurements in 1961 shows a recorded static water level of 67.60 ft below the pump discharge level. In pump test report dated 1999, the

water table decreased by 47.70 ft and the recorded static water level is 115.30 ft below the pump discharge level.

- ❑ Recorded Specific Capacity – A pump test report dated 1961 shows a recorded specific capacity of 67.60 gpm/ft. In pump test report dated 1999, the specific capacity increased to 115.30 gpm/ft.
- ❑ Change in Specific Capacity - Between 1956 and 1999 data, specific capacity increased by 70.6%. Data shows a generally consistent increasing trend.
- ❑ Impact to Motor/Pump - According to pump test data recorded in 1961, total HP required to pump at 460 gpm well capacity is 34.83 HP. In 1999, the total HP increased to 38.64 HP. Assuming that Well No. 5 pump has a built in service factor of 5% to a service capacity of 52.5 HP, the Well No. 5 pump is within the name plate horsepower as of 1999.

This well was serviced in 2009 with the casing hole video inspected. The video review showed considerable cascading metal scale and a mottled surface characteristic of generally uniform corrosion across the surface of the casing. The casing corrosion appears to have completely deteriorated the casing wall in several areas and the well contractor servicing the well advised that casing collapse was a possibility during cleaning. The well casing perforations were consistent with a mills knife with visible enlargement of the slots. Increased sand production has been observed, consistent with the slot enlargement and holes in the casing.

This well pump and electrical panel also require upgrading to place it back into reliable service and the District weighed the cost of completing the service, estimated at \$60,000 to \$80,000, with the risk and return. It is recommended that the District invest in a replacement well for Well No. 5 and not proceed with rehabilitation of the existing well.

6.3.6 Well No. 6

Well No. 6 was constructed in 1956 with maximum pumping capacity of 1100 gpm.

- ❑ Recorded Static Water Level – Measurements in 1961 shows a recorded static water level of 55.60 ft below the pump discharge level. In pump test report dated 1976, the water table decreased by 21.50 ft and the recorded static water level is 77.10 ft below the pump discharge level. More recent pumping water levels were not available.
- ❑ Recorded Specific Capacity – Pump test report dated 1961 shows a recorded specific capacity of 67.80 gpm/ft. In pump test report dated 1976, the specific capacity increased to 91.20 gpm/ft. No more recent test data was available.
- ❑ Change in Specific Capacity – Between 1961 and 1976 data, specific capacity increased by 34.5%. Data shows a generally consistent increasing trend contrary to regional trends and typical well performance profiles over time.
- ❑ Impact to Motor/Pump – This well is driven by a gas engine drive and no determination as to the drive ability to meet full capacity was made.

6.3.7 Well No. 7

Well No. 7 was constructed in 1956 with maximum pumping capacity of 675 gpm.

- ❑ Recorded Static Water Level – Measurements in 1961 shows a recorded static water level of 50.50 ft below the pump discharge level. In a 1997 pump test report the water table decreased by 42.50 ft and the recorded static water level is 93 ft below the pump discharge level.
- ❑ Recorded Specific Capacity – Pump test report dated 1961 shows a recorded specific capacity of 98.70 gpm/ft. In pump test report dated 1997, the specific capacity increased to 115.90 gpm/ft.
- ❑ Change in Specific Capacity – Between 1961 and 1976 data, specific capacity increased by 17.4%. Data shows a generally consistent increasing trend contrary to regional trends and typical well performance profiles over time.
- ❑ Impact to Motor/Pump – According to pump test data recorded in 1961, total HP required to pump at 675 gpm well capacity is 49.02 HP. In 1997, the total HP increased to 56.04 HP. Assuming that Well No. 7 pump has a built in service factor of 5% to a service capacity of 52.5 HP, the Well No. 7 pump exceeds the name plate horsepower and service capacities as of 1997.

6.3.8 Well No. 8

Well No. 8 was constructed in 1977 with maximum pumping capacity of 1100 gpm. Well No. 8 is the District's lead well and was recently upgraded to include a new VFD and electrical switchgear. The existing motor was not replaced and may be at risk from heat buildup under the VFD operating conditions. An enclosure and evaporative cooler has been added around the motor to address the heat buildup at this site.

- ❑ Recorded Static Water Level – Measurements in 1980 documented a recorded static water level of 86.75 ft below the pump discharge level. In a pump test report dated 2000, the water table decreased by 27.05 ft and the recorded static water level is 113.80 ft below the pump discharge level.
- ❑ Recorded Specific Capacity – Pump test report dated 1980 shows a recorded specific capacity of 39 gpm/ft. In pump test report dated 2000, the specific capacity decreased to 24.20 gpm/ft.
- ❑ Change in Specific Capacity – Between 1980 and 2000 data, specific capacity decreased by 37.9%. Data shows a generally consistent declining trend.
- ❑ Impact to Motor/Pump – According to pump test data recorded in 1980, total HP required to pump at 1100 gpm well capacity is 101 HP exceeding the pump rated capacity of 100 HP but within the motor service factor allowance for operation at up to 5% over the rated horsepower. Additional pump test data in 1998 indicated the motor drawing 115 HP and exceeding the motor service factor. The District has been operating an additional well to maintain Well No. 8 within acceptable operating ranges but a replacement with a larger motor may be required should the existing

motor fail. If the electrical service is upgraded this site should be considered for a 125 HP motor.

6.3.9 Groundwater Summary and Recommendations

6.3.9.1 Data Availability

Changes in specific capacity are not uniformly comparable for all eight wells due to sporadic data availability. Well Nos. 1, 2, 3, 4, 7, and 8 has data available from within the first 5 years of the well construction to District's latest available test data in 2000. Pump test data for Well No. 5 is unavailable for its first 5 years of operation.

6.3.9.2 Summary

Static water level decreased as observed on all well sites; however, changes in specific capacity for each well varies in trend. Well Nos. 1, 2, 3, and 8 exhibit more than 25% percent decrease in specific capacity, with Well No. 2 exhibits the highest decrease at 47%. Well Nos. 4, 5, 6, and 7 exhibits more than 15% increase in specific capacity, with Well No. 5 exhibits the highest increase at 70%.

Decreased static water level contributes to the total pumping head required for each well. Out of the eight (8) well motors, the following were observed:

- Well motors for Well Nos. 1 – 7 were adequately sized to accommodate the well maximum pumping capacity as exhibited in each of the 7 wells' earliest available pump test report.
 - Well Nos. 5 and 6 motors remained adequate to accommodate each well's maximum pumping capacity.
 - Well Nos. 1 and 2 motors exceeded the rated motor capacity at maximum pumping, although it is still below the service capacity.
 - Well Nos. 3, 4, and 7 motors were no longer adequate to handle each well's maximum pumping capacity.

Well No. 8 was the latest well built within the District and remained as the District's lead well to date. According to its earliest documented pump test report, required power to support maximum pumping is greater than the rated capacity of the well motor but is within the service factor. The latest pump test report shows Well No. 8 motor currently operating at a maximum pumping load on the motor that is exceeding both rated and service capacities.

6.3.9.3 Recommendations

The following recommendations are provided for operations/maintenance of the wells.

1. The District has not performed a pump test report in the last eight (8) years. Considering the ages of the well facilities, a current pump test report should be performed for all eight (8) wells to correctly capture the current well conditions. SMUD no longer provides this service and the District will need to hire a contractor to conduct this testing. The testing

should document static water level, pumping water level, flow volume, power draw and include a calculation of efficiency and well yield specific capacity in gallons per minute per foot of drawdown.

2. Well motor load at Well No. 8 exceeding the service factor could result in excessive motor heating and failure during peak usage periods. Calibrating the system wells to increase system pressure during peak periods will result in Well No. 8 operating within the normal power draw operating range.
 - ❑ Continue running an extra well to meet District’s daily water demand to keep Well No. 8 operating within acceptable motor loads.
 - ❑ Replace existing motor and install a larger motor.
3. Well Nos. 3, 4, and 7 motors have reached the same condition with static water levels decreasing.
 - ❑ Monitor well motor load and output and track specific capacity against current measured well yield. The current specific capacity of each well is presented below and is based on the most recent pump efficiency testing where static water level, well drawdown and pump discharge flow and pressure were measured.

	Well No. 1	Well No. 2	Well No. 3	Well No. 4	Well No. 5	Well No. 6	Well No. 7	Well No. 8
Baseline Specific Capacity	60	60	40	60	65	68	100	40

Units are in gallons per minute per foot of water level drawdown in the well and indicate well capacity. Higher numbers reflect higher capacity.

Well cleaning and swabbing may be warranted if the structural condition of the well is suitable. An aquifer pump test is recommended following any well rehabilitation and should include the following steps:

1. Allow well to recover for 24 hours minimum prior to starting test
2. Measure static water level
3. Pump well for 24 hours, measure pumping rate at start of test
4. Measure well pumping rate at end of 24 hours
5. Measure pumping water level at end of 24 hour test

6.4 Groundwater Well Replacement Program

It is recommended that the District implement a program to replace its entire groundwater supply to continue to ensure a reliable drinking water supply. Construction of five (5) new wells at 1,500 gpm each will provide the District with 7,500 gpm of pumping capacity to meet system demands and fire flow. Select existing District wells could be placed in standby operation as redundant water supply sources. The remaining wells would be demolished in accordance with California Department of Water Resources standards.

6.4.1 Replacement Groundwater Supply

Due to the relatively high aquifer yield potential of a new well, it is expected that the District will be able to achieve a 1,500 gpm per well capacity. Through discussion with District staff, there are four (4) preliminary locations selected for future well sites as shown on Figure 6. A typical new well site layout is as shown on Figure 7.

6.5 Pipeline Replacement Planning

The District buried assets are also reaching the upper end of the typical lifecycle with the steel pipe in the northeastern District are most at risk of increasing failure. The balance of the District residential service area is asbestos cement (AC) pipe located in backyards. Although the backyard pipe is protected from traffic loads and other utility construction, AC is subject to damage and failure from tree root loading. Mature trees can either crush the pipe or pull it out of the ground if the tree falls over. Based on the existing age and condition it is reasonable to expect that the District will see increasing leaks and pipe failures over the next 15 years at which point significant replacement will need to be implemented. This forecast is consistent with the observations made by SSWD and one of the drivers behind their pipe replacement program.

A second consideration as to when to begin the pipe replacement program is that the District system is comprised of a well looped 6-inch diameter network. This system includes multiple small water supply wells that are integrated in the distribution system made up of small pipe diameter networks. Increasing well capacity and planning for a possible surface water single point of entry to the system will required a larger backbone distribution system. A computerized hydraulic model was developed to test the proposed water system and wells for meeting peak demands and fire flow requirements. The results of the hydraulic modeling are included in the appendix under separate cover.

This larger diameter system is proposed as 8-inch and 12-inch pipelines forming a single main loop tying into the existing 6-inch system to maintain service through existing residential connections. This approach will allow for relocation over several years of the distribution system from the back lot to the front public right of way consistent with District policy for new pipelines. Ultimately, the water services will be converted from back lot to front yard and meters installed. As discussed later in this Master Plan, meter setters could be installed at the time the pipes are replaced and actual meters installed system wide at one time. Conversion to a metered rate would occur at one time for residential customers and delay the capital outlay for the meters.

Meters are an additional driver as to timing for the pipeline replacement. Installation of meters in the backyards will require radio read meter or access by District staff to read the meters. The meters will ultimately end up in the front yards as the pipeline replacement is completed. We

have developed the replacement plan using the 2030 metering deadline as the completion date for full abandonment of back lot pipelines. This assumption provides a conservative approach to the planning impacts of both metering and pipeline replacement.



6.6 Corporation Yard and Office Building

The existing District office building and corporation yard is located on a residential lot on the east side of the District. The site also includes Well No. 6. Future District staffing and maintenance efforts for meters will require additional work space and a possible expansion of the District's building. Unfortunately the existing site is too small to accommodate a new well, possible CWD joint conjunctive use pump station and the expanded Office and Corporation Yard.

The District should monitor properties for sale and consider purchasing a new site for a joint use or single use facility. The options for joint use and single use facility are generally as follows:


- New Office and Corporation Yard site with existing site used for replacement Well No. 6 and CWD joint conjunctive use pump station.
- New site for replacement Well No. 6 and CWD joint conjunctive use pump station and new site for Office and Corporation Yard. New Office/Corporation Yard site could also provide property for a replacement well.

N:\2008\0870017.00_Del_Paso_Manor_WD_MP1-Sheets\Master_Plan_Figures\FIG-06.dwg SHERLY ROSILELA 7/1/2009 5:07 PM

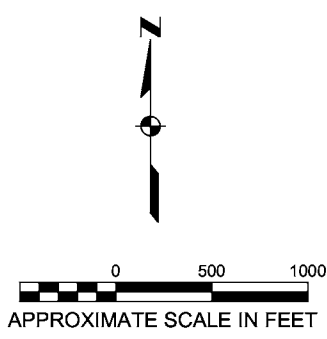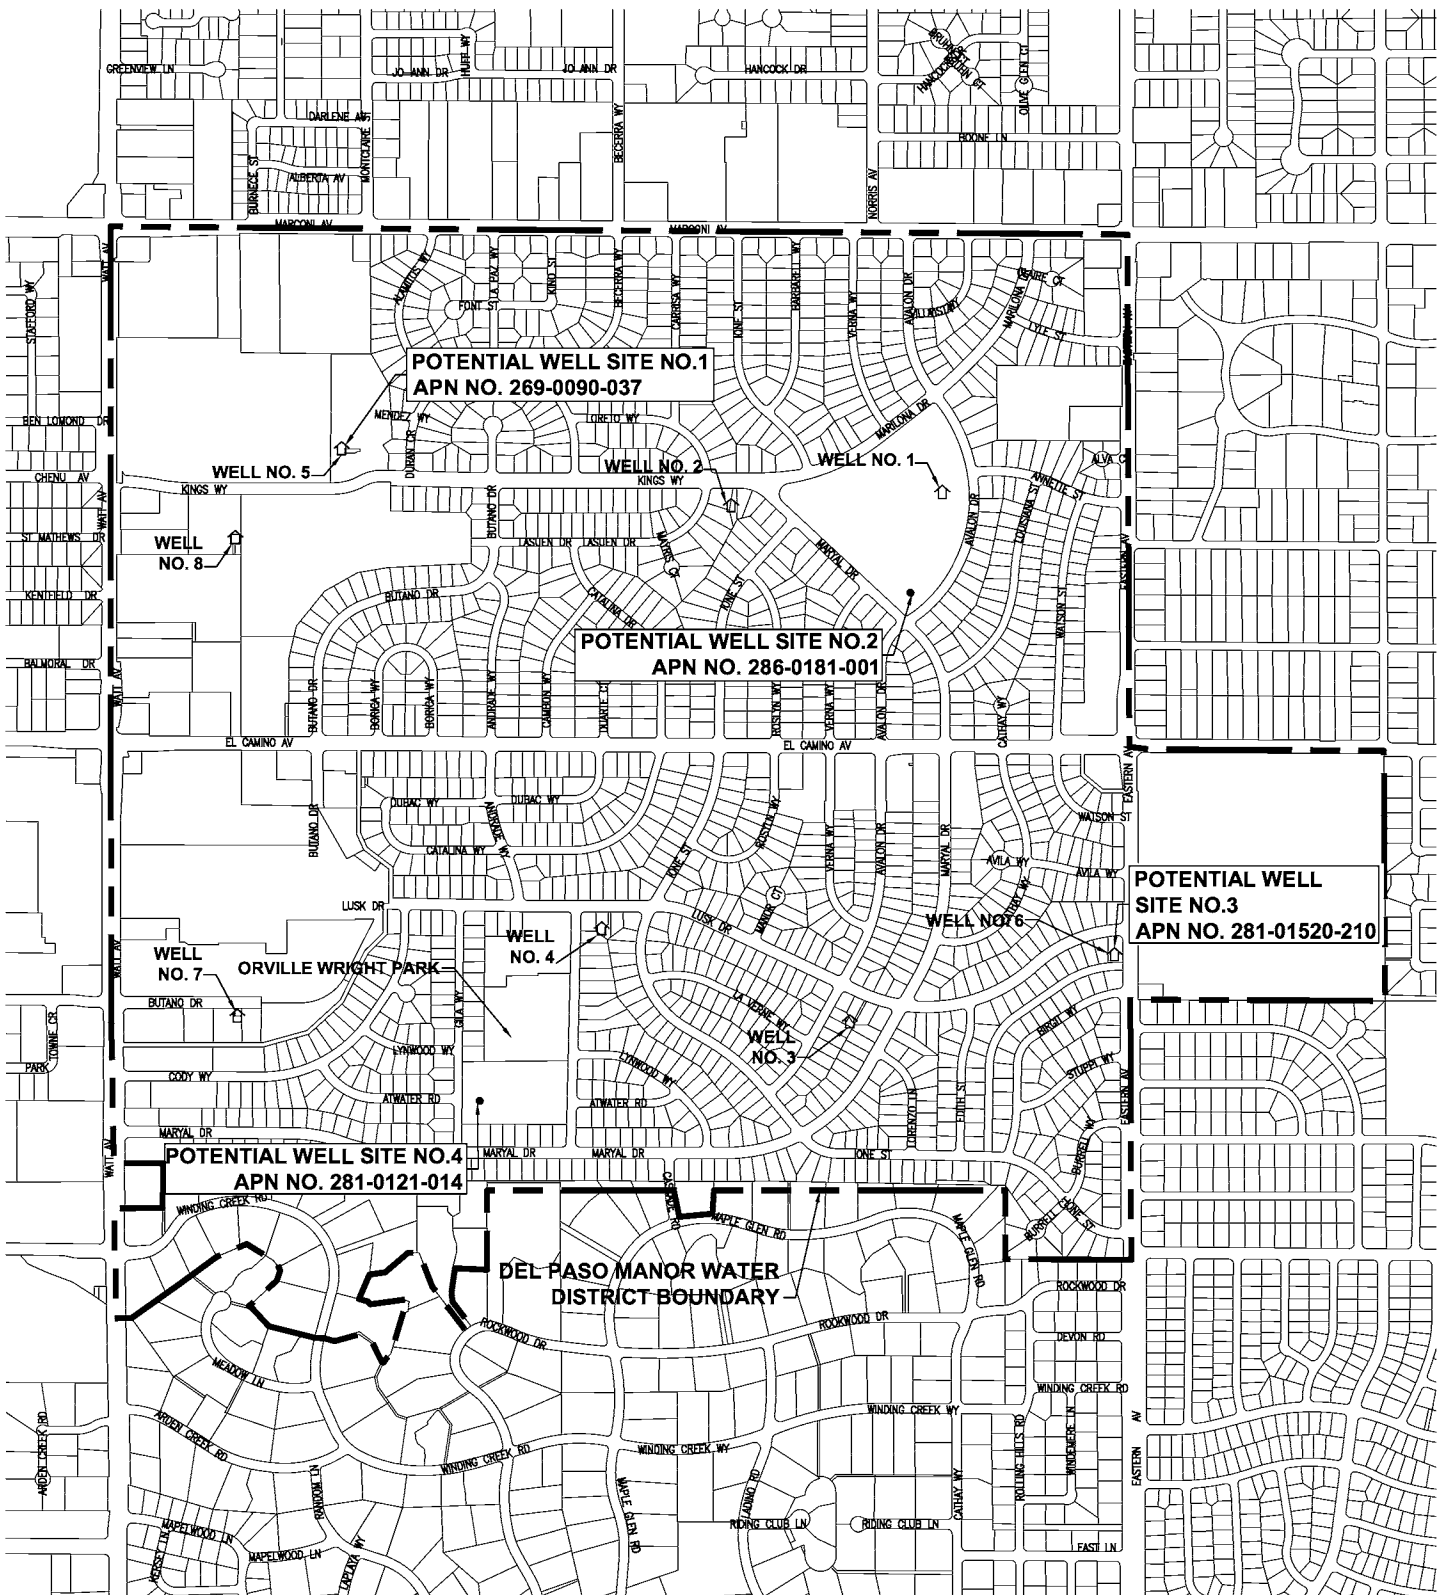

Kennedy/Jenks Consultants
 DEL PASO MANOR WATER DISTRICT
 SACRAMENTO, CALIFORNIA
 MASTER PLAN
 FUTURE WELL SITES
 K/J 0870017.00
 JUNE 2009
FIGURE 6

N:\2006\0670002.00\0670002c0028.dwg SACAPP 6/25/2009 1:41 PM

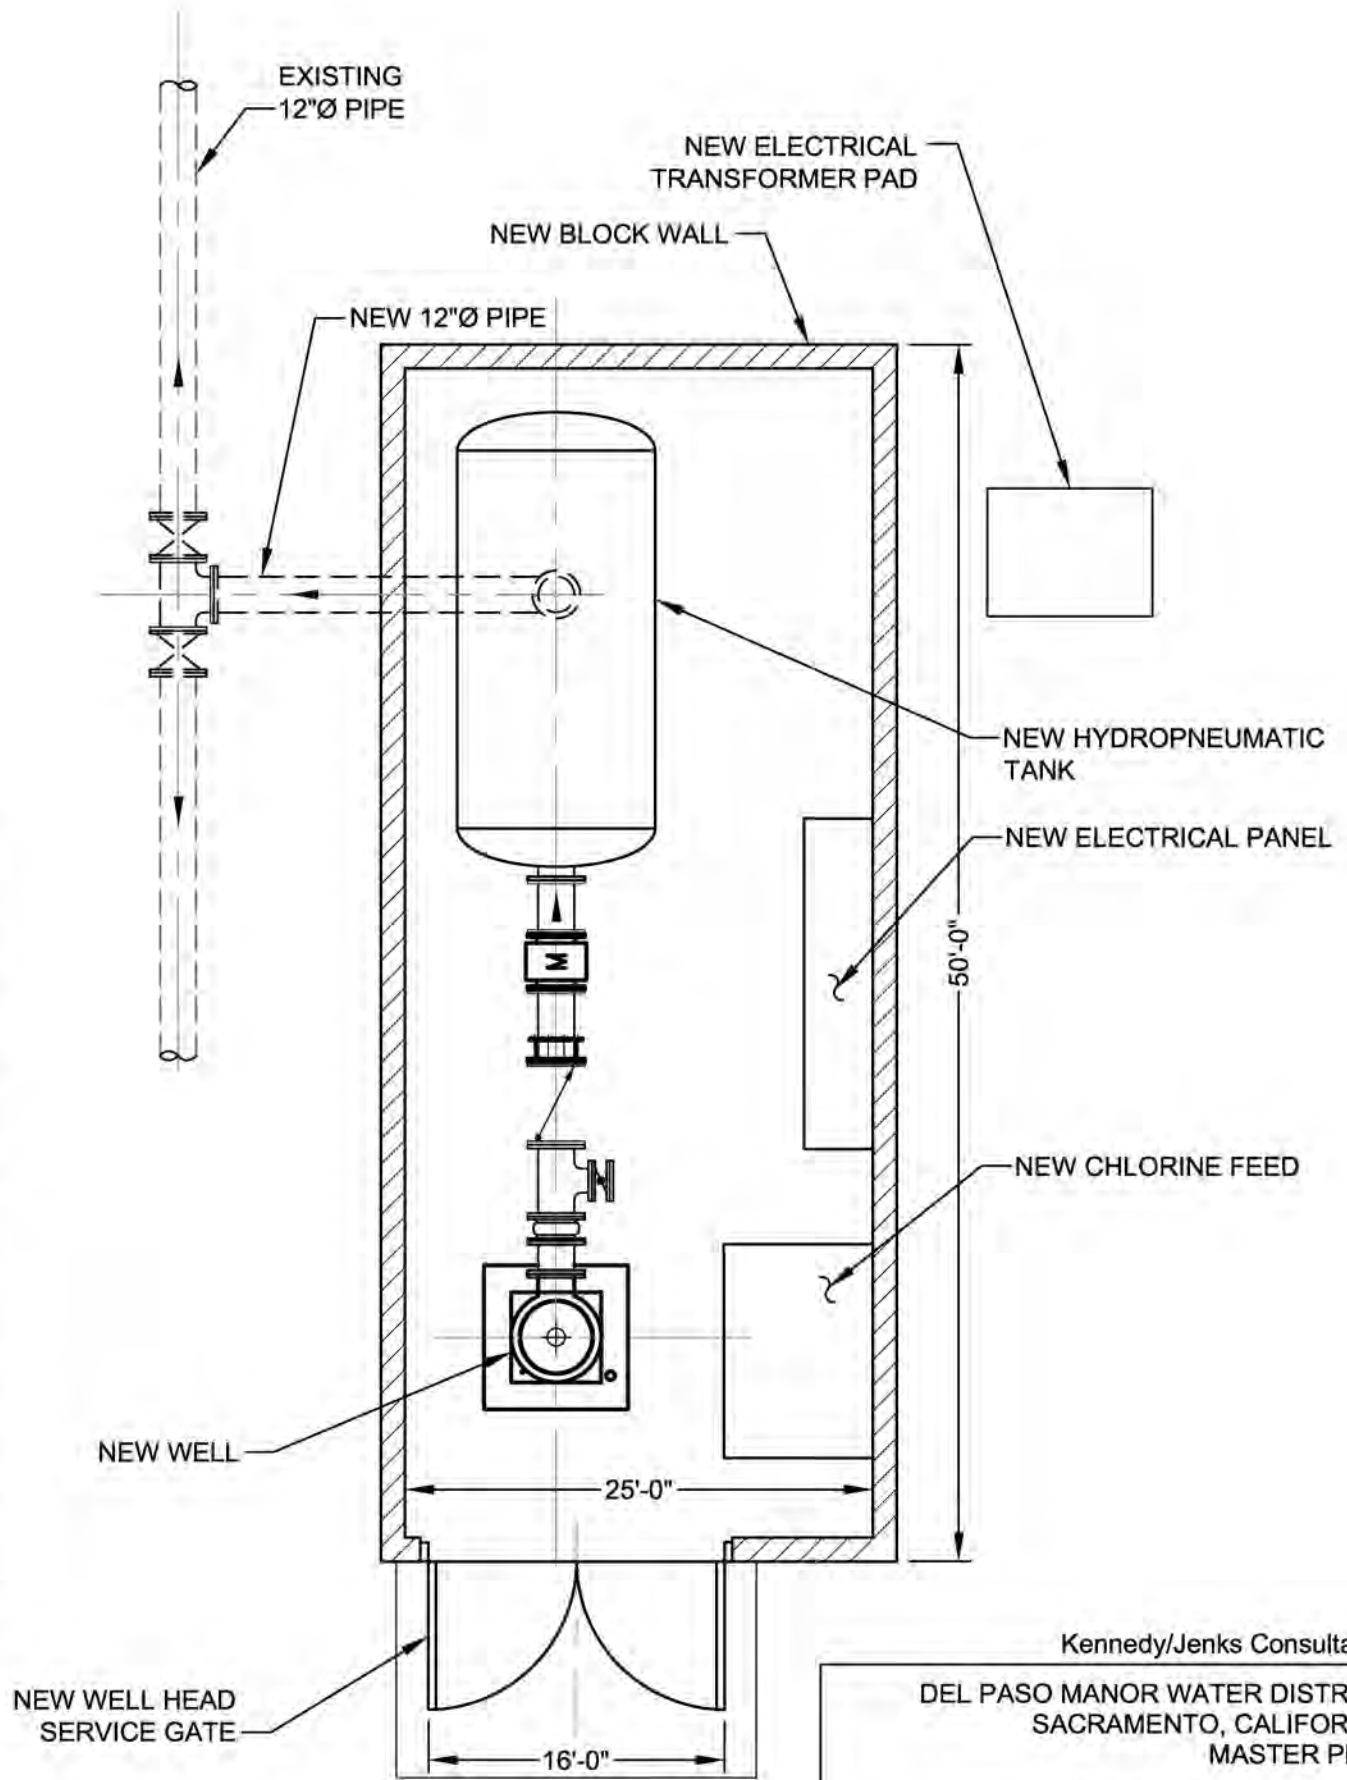

Kennedy/Jenks Consultants

DEL PASO MANOR WATER DISTRICT
SACRAMENTO, CALIFORNIA
MASTER PLAN

TYPICAL NEW WELL SITE LAYOUT

K/J 0870017.00
APRIL 2009

FIGURE 7

Section 7: Facilities Management Planning

7.1 Introduction

This section discusses the organization of the District, operation and maintenance responsibilities, and general practices of the District and provides a general management plan.


7.2 District Organizational Structure

Del Paso Manor Water District is a public agency governed by an elected five member Board of Directors. The Board is elected at large within the District service area. The District is a small water agency with a service area of approximately 1 square mile and under 3000 customers providing less than 3000 acre feet of water annually. As such the District does not meet the definition of an Urban Water Supplier under the California Water Code Section 10617, exempting it from many of the water resource management legislation of the State of California. The minimum agency size threshold helps to avoid placing a disproportionate cost for meeting planning, conservation and management activities on small agencies.

The District performs four principle activities including management and administration; water production and testing; system maintenance; and conservation outreach. The District currently employs four (4) individuals.

Figure 8 reflects the current Organization Chart.

Figure 8: District Current Organizational Chart

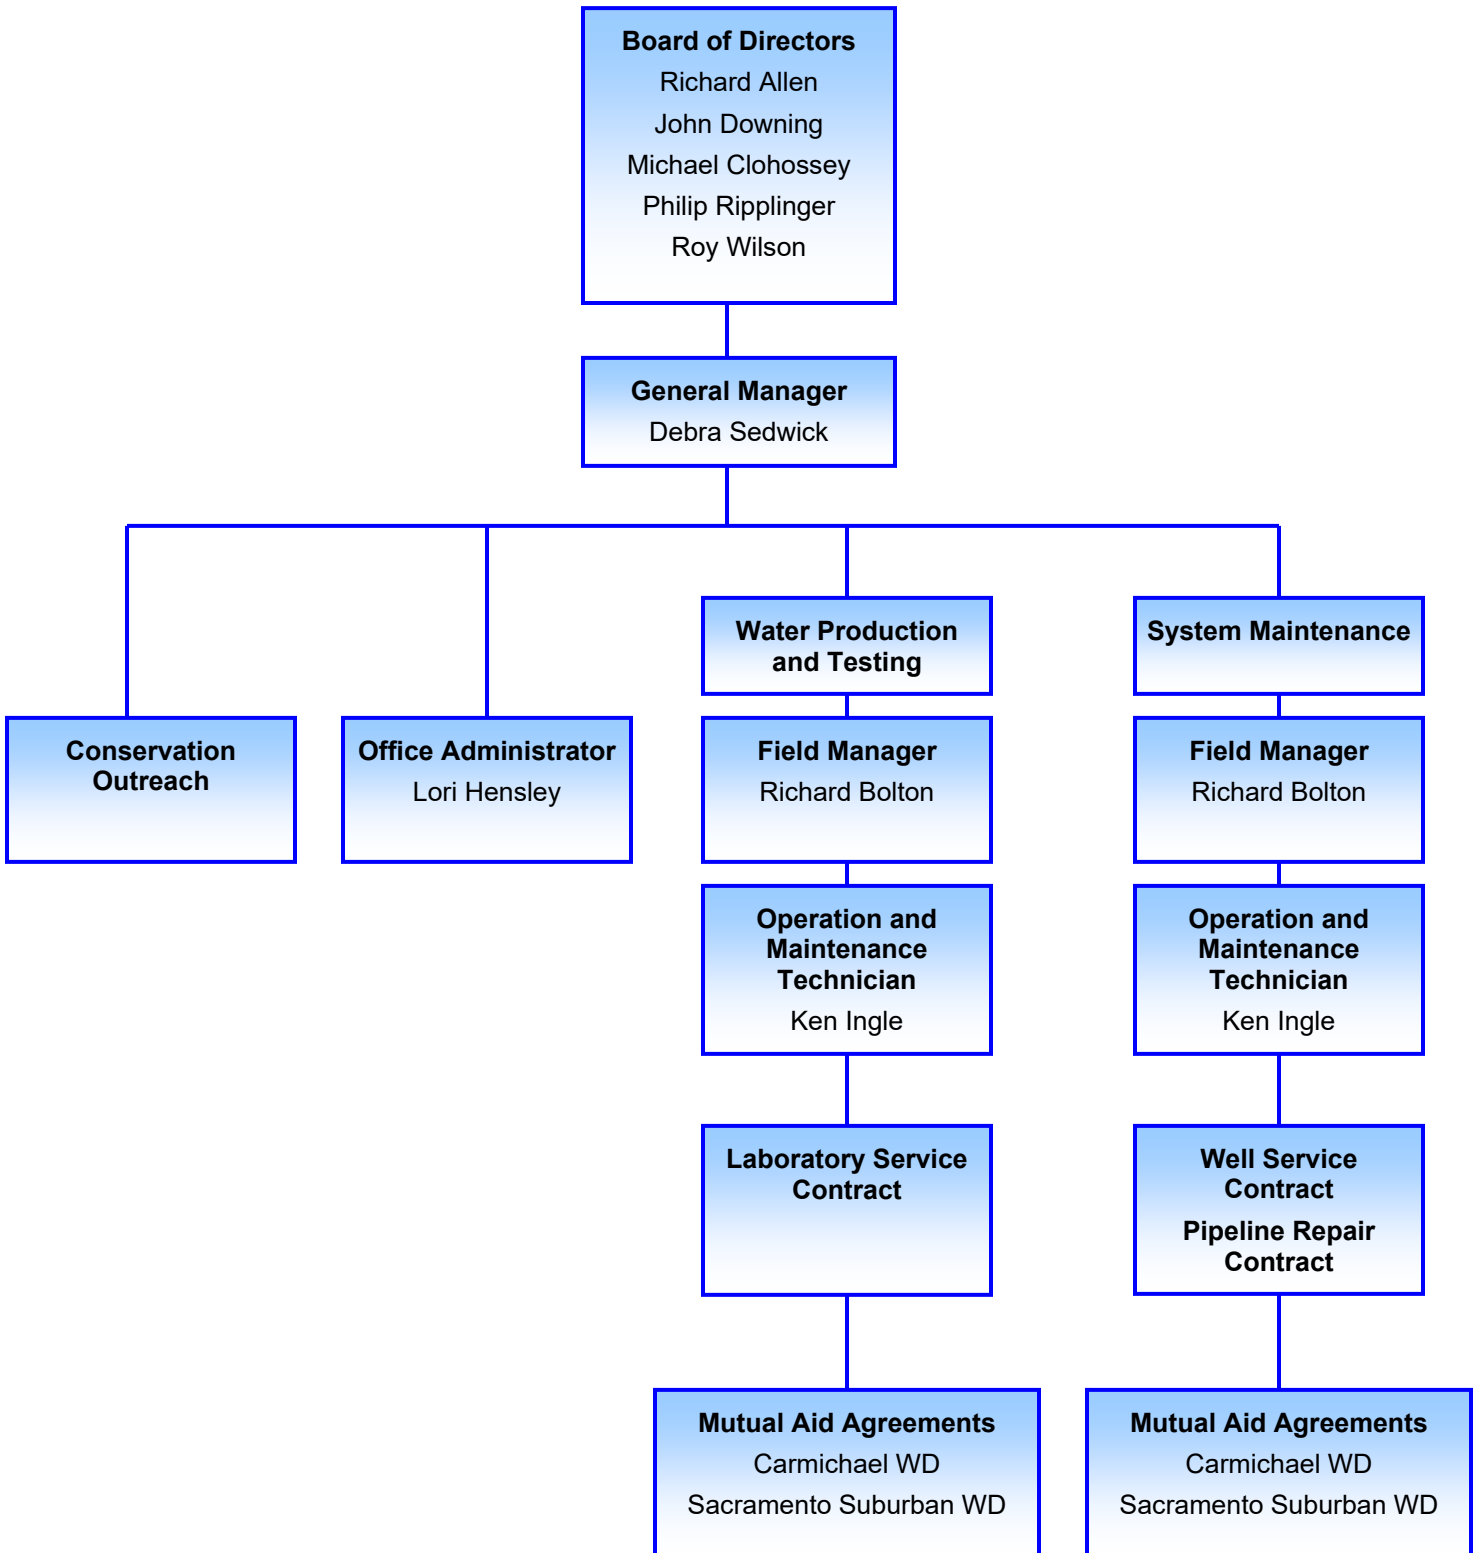

7.2.1 Management and Administration Activities

The management and administration activities are provided by the General Manager and Office Administrator providing the labor effort needed to keep the District operating including customer service (billing and collection), processing accounts payable, District business accounting, Board support, administrative support, as well as answering the telephones, preparing and filing regulatory compliance reports and maintaining customer outreach. Project/staff management also participate and represent the District customer interests in regional planning through the Water Forum, Regional Water Authority, Sacramento Groundwater Authority, and Sacramento Area Water Works Association. The staff also maintains outreach and provides community service through activities with the Del Paso Manor Homeowners Association and San Juan School District.

The key positions of the General Manager and Office Administrator are discussed below:

- General Manager – This person is responsible for all aspects of the District operation and is the key liaison between the elected Board and the District staff. The General Manager is responsible for implementing Board actions and policies and for providing outreach to the community as a visible representative of the organization. The General Manager is responsible for the daily operational decisions and is responsible for regulatory compliance monitoring, capital projects management, labor negotiations, and maintaining the people and resources needed to continue providing safe and reliable services on a daily basis. The General Manager is responsible for development of the annual budget alternatives following the direction of the Board of Directors.
- Office Administrator – This person is responsible for the administration of District accounts, payroll and purchasing processing and acts as the primary customer service representative. In addition, supports all the activities of the General Manager and employees of the District including, support of Administrative activities, document reproduction, emergency dispatch, and public outreach.

7.2.2 Water Production and Testing

The water production and testing staff provides for the groundwater pumping and testing of the District's water supply. District facilities include all District wells, well pumps and system interties with Sacramento Suburban Water District. State Certification as a Water Distribution Operator, Water Treatment Operator, and specialized training is required for the lead responsibilities of these activities for the District.

The existing District staff positions conducting these activities are as follows:

- Field Manager – This person is responsible for maintaining adequate water pressure in the system under all demand conditions and monitoring and maintaining water quality and testing demonstrating compliance with the Drinking Water Standards. This person is responsible for maintaining the mechanical aspects of equipment ranging from small chemical feed pumps through multiphase variable frequency drive pumps providing thousands of gallons per minute of supply. This person maintains District production and operations reports and plans and schedules maintenance

activities. This person is also responsible for emergency response planning and coordination of those activities needed to maintain a safe and reliable water supply.

- Operations and Maintenance Field Technician – This person supports all activities of the Field Manager and must be familiar with all production facilities, operation practices and procedures.

These people are responsible for preventative maintenance for all mechanical, electrical, chemical feed and control systems within the District. They also conduct the distribution system-flushing program, valve exercising, system monitoring and compliance with the California Department of Public Health (CDPH) water quality testing programs under the District Water Supply Permit.

The staff activities support the following four areas: maintenance, water quality, chemicals, and control.

Maintenance

Maintenance includes the electrical and electrical control system, chemical storage and feed equipment, and mechanical equipment, such as pump maintenance.

Electrical and electrical control system maintenance includes cleaning contacts; tightening connections; measuring voltage and amperage loads; and replacing starters, relays, circuit breakers and fuses.

Chemical feed equipment maintenance includes cleaning the pump Internals and solution lines; replacing diaphragms; and checking valves, chemical solution lines and injection point devices.

Mechanical equipment maintenance includes oil and filter changes; charging system check and replacement; efficiencies testing; bearing replacement; cleaning of Y strainers and diaphragms; and speed, travel and pressure adjustment for control valves.

Water Quality

Water quality is broken out into the following sub-categories: Distribution water quality testing, groundwater testing, flushing program, and water quality calls.

- Distribution water quality testing includes sampling at the wells and within the system for chlorine residual, coliform bacteria and periodic sampling for lead and copper at various locations in the District.
- Groundwater testing includes sampling for constituents and contaminants such as VOC, IOC, Gross Alpha, SOC, Gen. Mineral, Physical, Nitrate, Nitrite, Phase 2/5, Perchlorate, and MTBE, as well as other regulated and unregulated parameters required by law and as directed by CDPH.
- Flushing program includes flushing dead-end mains to reduce sedimentation and taste and odor complaints. This effort includes valve exercising and inspection as opportunities allow.

- Water quality calls – includes investigating water quality issues reported by customers.

Chemicals

Activities include ordering, receiving, loading and delivery of sodium hypochlorite to all sites; operation of feed systems; testing, training and emergency response planning.

Control System and Testing

The water system has a single chart recorder that monitors water pressure. The recorder is manually read. System alarms and automated emergency contact and reporting are not currently part of the District capabilities.

7.2.3 System Maintenance

The activities for system maintenance include all buried infrastructure providing transmission and distribution for delivery of water throughout the District. These activities include the inspection of all new construction, replacement and repair of water mains, fire hydrants, water services, meters, and valves. In addition, these people are responsible for inspection of all potential cross-connections and to administer the corrections on those cross-connections.

This activity includes responding to Underground Service Alerts calls for locating the buried water facilities, and maintaining the District water system maps.

The System Maintenance activities the following key Roles:

- Field Manager – This person is responsible for assignments of resources, project scheduling, training, inventory, equipment fleet and maintaining the corporation yard. This person is also responsible for the District record drawing files, contractor submittal review and comments, construction inspection support, and inspection records. In addition, this position coordinates plan checking, fire flow analysis requests and responds to requests for information by developers regarding the District facilities and physical connection requirements.
- Operations and Maintenance Field Technician – This person supports the activities of the Field Manager.

7.2.4 Conservation Outreach

The District maintains a part-time water conservation outreach person who travels the District during high water use periods contacting customers where water waste appears to be occurring. This person is responsible for informing the customer of the importance of avoiding water waste, of District water conservation policies currently in force and consequences for continued water waste.

7.3 Future Water District Organizational Structure and Management Plan

The District staffing provides for assignment of multiple activities to the four full-time employees and one part-time employee for conservation outreach duties. This approach has worked well for several years and will continue to work well; however, the following changes will impact the District staffing:

- District will be undertaking an increased Planned System Maintenance program for system wide replacement of the aging infrastructure resulting in a need for additional resources. This effort could result in an additional workload as follows:
 - 2010 – 2014: Up to 1/8 time senior manager requirement for managing PSM Program development, funding investigations, Proposition 218 rate considerations, and managing project design, bidding, construction, and startup.
 - 2014 to 2018: Up to 1/2 time senior manager requirement for managing PSM Program development, funding investigations, 218 rate considerations, and managing project design, bidding, construction, and startup.
 - 2018 to 2022 up to 1/2 time senior manager requirement for managing PSM Program development, funding investigations, Proposition 218 rate considerations, and managing project design, bidding, construction, and startup.
 - 2022 to 2026 up to 3/4 time senior manager requirement for managing PSM Program development, funding investigations, Proposition 218 rate considerations, and managing project design, bidding, construction, and startup.
 - 2026 to 2030 up to 1/8 time senior manager requirement for managing PSM Program development, funding investigations, Proposition 218 rate considerations, and managing project design, bidding, construction, and startup.
- Modernization to add computerized Supervisory Control and Data Acquisition (SCADA) would not require additional manpower but would require training for the Water Production Field Position in the system operation and in operator control programming. No additional staff recommended however a training budget should be considered.
- Changes in State laws may reach to the small water system providers and require additional labor effort for the following items:
 - Water Conservation BMPs – The District is not required based on its size to under take many of the BMPs. However, if a voluntary implementation of some or all of the BMPs is undertaken, there will need to be additional staffing. It is recommended that a 1/8 to 1/4 time person could manage this activity.
 - Certifications – Additional training and maintenance of Distribution Certifications need to be tracked and maintained. No additional staff is recommend, however a training budget should be considered.

- Chemical Feed System – Fluoridation may become a requirement should the District choose to practice Conjunctive Use. Subsequently, there will be additional operation and maintenance work load related with the fluoridation program. This work will require daily inspection and maintenance at each well adding up to 2 hours per week per site. This could result in between 1/4 and 1/2 time additional field staff.
- Changing Groundwater Quality – If the groundwater quality declines and treatment is required, the District will need to add a Grade 2 Water Treatment Plant Operator. It is recommended for this scenario that the District considers adding a new position and separating production from distribution field work.
- Meter Reading, Calibration, Maintenance, and Monthly Commodity Billing – This will result in a 1/2 time person associated with the meters and a part-time office administrator assistant to process monthly billing using the meter data. Use of auto/reading meters may reduce the meter reading work load, however a minimum number of re-reads, manual reads, and field checks are typically required as part of the normal billing quality control and in response to customer inquiries.

These changes may result in some reorganization and the need for additional staffing as reflected in the possible future organization chart shown in Figure 9 and Figure 10. Figure 9 reflects adding resources with no change to the existing organizational structure. Figure 10 reflects a revised structure adding and Assistant General Manager and maintaining the existing structure below the new manager role.

Figure 9 : Proposed District Organizational Chart – Approach 1


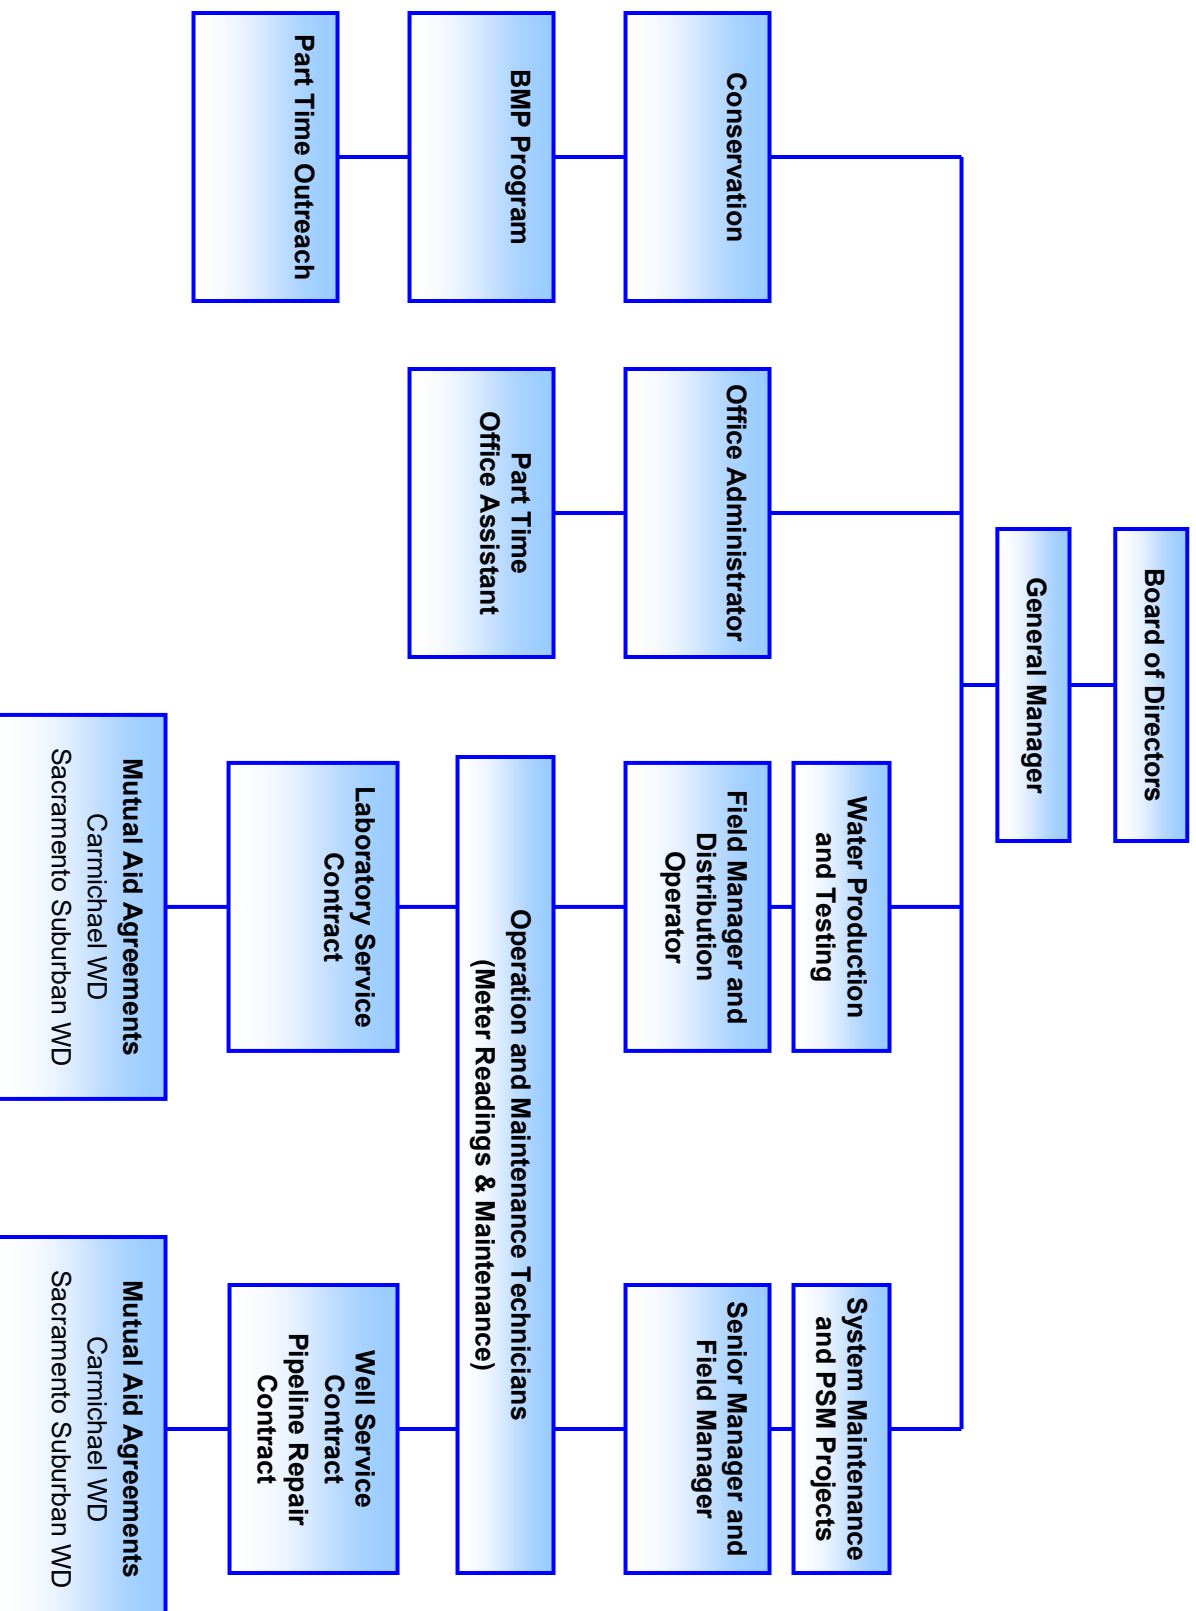


Figure 10: Proposed District Organizational Chart – Approach 2

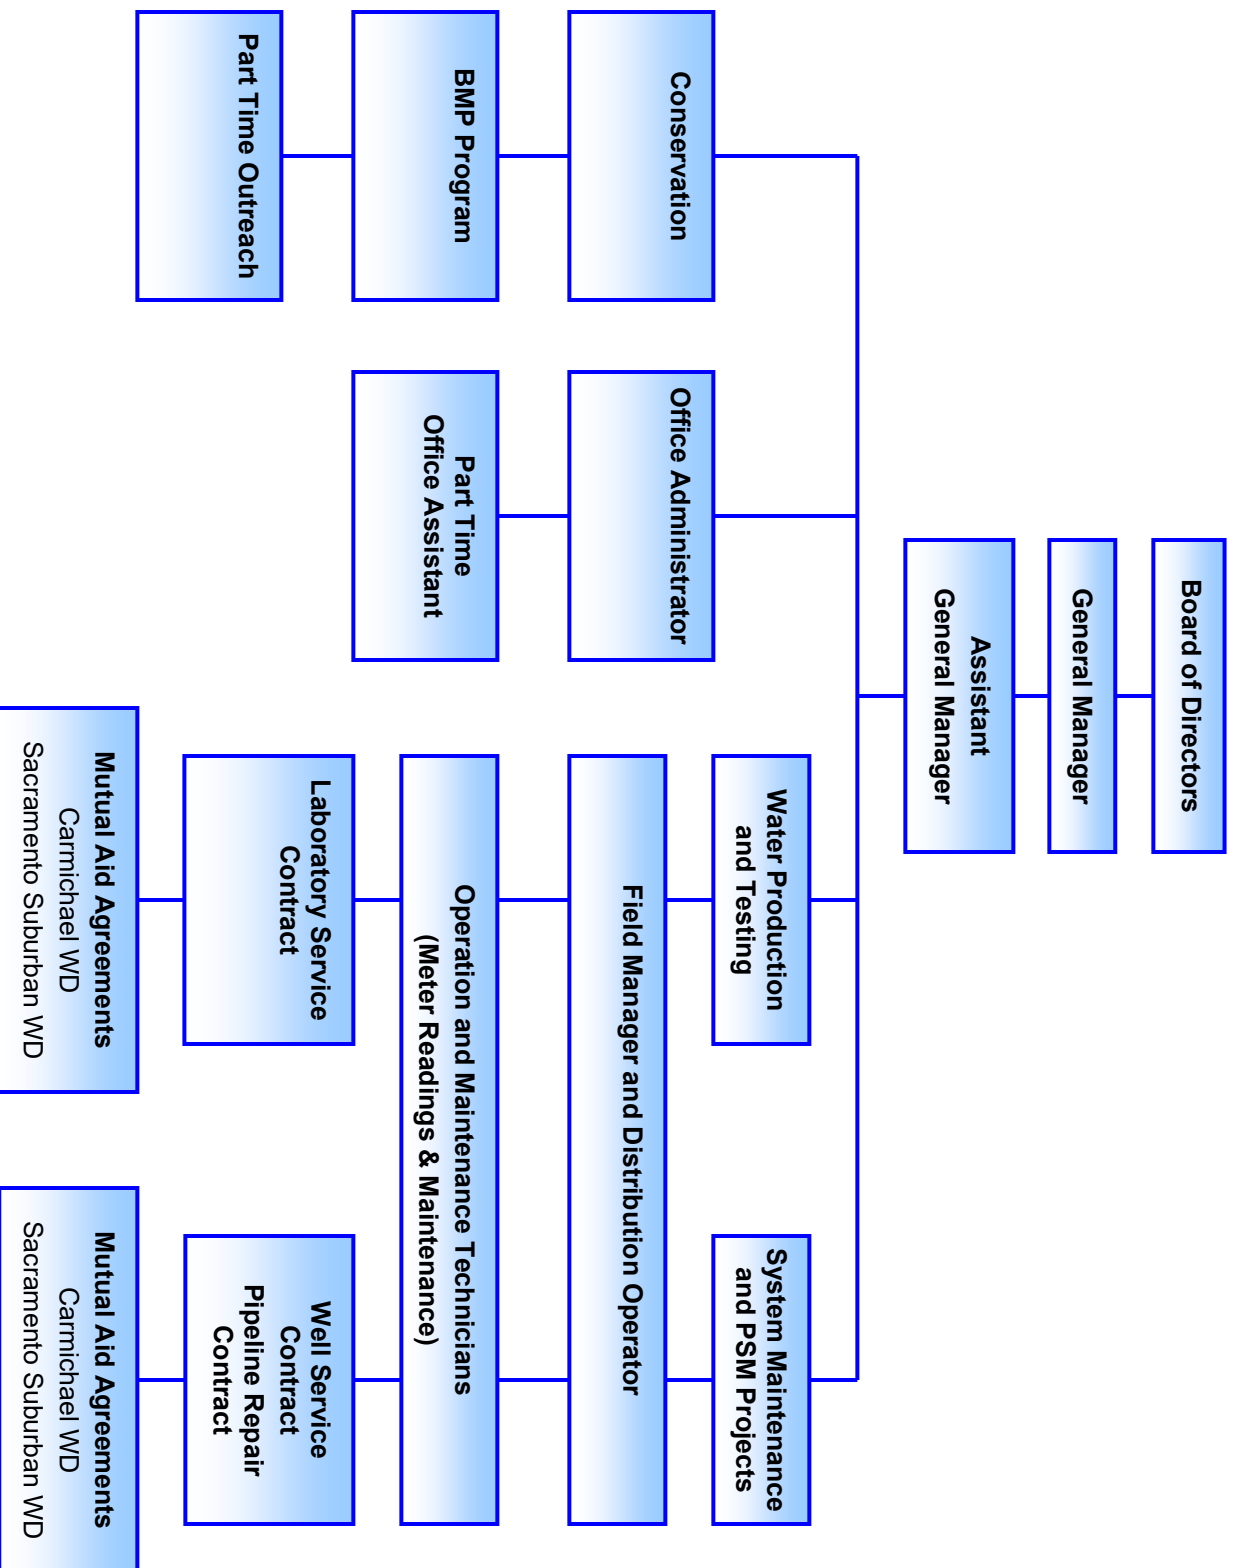

Section 8: Meter Retrofit Planning

8.1 Introduction and Background

This Water Conservation and Meter Retrofit Plan reviews existing Del Paso Manor Water District (District) commitments for metering the District water system and frames the existing ongoing changes is local and state programs to encourage and enforce metering and billing using a metered rate.

The Metering Plan Technical Memorandum includes review of the following documents and are provided in Appendix 2:

- Assembly Bill No. 2572 Water Meters; Water Code Section 10617; Draft Water Forum Agreement – Water Conservation Element, 14 May 2009
- Del Paso Manor Water District (DPMWD) Water Forum Agreement and DPMWD Water Conservation Plan, January 2000 Appendix J
- Memorandum of Understanding Regarding Urban Water Conservation in California, California Urban Water Conservation Council, 10 December 2008
- California Urban Water Conservation Council – Best Management Practices (BMPs), 10 December 2008
- California Urban Water Conservation Council – BMP Cost-Effectiveness Workshop, June 2009
- Assembly Bill No. 1420 (AB 1420) Water Demand Management Measures: Water Management Grant or Loan Funds; AB 1420 Frequently Asked Questions; AB 1420 Self-Certification Statement Forms; Public Workshop Notes, AB 1420 Compliance/Eligibility Requirements, June 2009

The District is a signatory to the Water Forum Memorandum of Understanding (MOU), a member of the Regional Water Authority and participating in ongoing discussions with the Water Forum regarding updating the January 2000 MOU. This effort is part of an ongoing commitment to responsible management of the District and regional solutions to water supply planning.

8.2 Water Metering Commitments

Presented below is a summary of existing water metering commitments, current draft updated commitments and current state laws relating to water metering.

Existing Water Forum Best Management Practice 4 (BMP 4) Residential Meter Retrofit

The District Water Forum Purveyor Specific Water Conservation Plan (Appendix B) Best Management Practice 4 (BMP 4) Residential Meter Retrofit provides for the following commitment.

“It is recognized that Del Paso Manor Water District is a relatively smaller water purveyor currently relying totally on groundwater and will not realize immediate water supply benefits from participating in the Water Forum Agreement. Therefore until such time as Del Paso Manor Water District needs discretionary approvals for new or expanded surface water supplies, an active voluntary meter retrofit with incentives is acceptable. Nothing in the Water Forum Agreement prevents purveyors from deciding to undertake a more rapid meter retrofit program.

“At such time as Del Paso Manor Water District needs discretionary approvals for new or expanded surface water supplies it agrees to annually retrofit at least 3.3% - 5% of the total number of unmetered residential connections and read and bill as set for the in Appendix D of the Water Forum Agreement.

“If in the future Del Paso Manor Water District receives benefits from another agency’s conjunctive use program, it agrees to discuss its meter retrofit program with the Water Forum Successor Effort.”

The District has 1692 (1611 single family and 81 duplex housing) services that are unmetered. The existing commitment is to install 56 to 85 meters per year as part of pursuing a discretionary approval for new or expanded surface water supplies. It is reasonable to assume that this commitment will be triggered by the following surface water supplies actions if undertaken by the District:

- Proceeding with City of Sacramento surface water deliveries whether directly, or through Sacramento Suburban Water District.
- Proceeding with a Point of Diversion effort for City of Sacramento surface water to be treated and wheeled through Carmichael Water District.
- Proceeding with a joint District and Carmichael Water District conjunctive use project for beneficial use of the remediated groundwater discharging at the Bajamont Water Treatment Plant.

The annual cost of installing 85 residential meters in 2009 construction dollars is approximately \$100,000. This assumes retrofit to the existing pipelines using a service tap, corporation stop, 1-inch copper service, curb stop, meter box, meter, customer service shutoff valve and limited customer service retrofit. The District would be fully metered by 2030 if it proceeded at a rate of 5% (85) meters per year starting in 2010.

Assembly Bill 2572 and Water Forum Successor Effort

AB 2572 established requirements for Urban Water Suppliers to be fully metered by the year 2025 and begin billing all metered services within one seasonal year of having installed a water meter. An Urban Water Supplier under the California Water Code Section 10617 is any supplier serving more than 3,000 customers, or supplying more than 3,000 acre-feet per year of water. The District does not fall under the definition of an Urban Water Supplier and is therefore AB 2572 does not pertain to the District.

The Water Forum successor effort is negotiating an update Water Conservation Element and released a draft Water Conservation Element 14 May 2009 (Appendix A) that includes that same working as the original agreement (see above) for the District commitment to 3.3% - 5% triggered by the need for discretionary approvals for new of expanded surface water.

Assembly Bill 1420, California Urban Water Conservation Council Best Management Practices

The Water Forum draft update process is embracing the California Urban Water Conservation Council (CUWCC) Memorandum of Understanding (Appendix C) and the 10 December 2008 Best Management Practices while maintaining flexibility for unmetered members such as the District. Specifically, there is a Pre-Determined Deferral for Meter-Based BMPs that accepts the January 2000 Appendix J (Appendix B) schedule. As stated above, Water Forum Appendix J does not require the District to meter until a discretionary surface water approval is needed.

The CUWCC MOU provides advantages to local larger water purveyors in preparing Urban Water Management Plans. The District does not exceed the minimum size threshold requiring an Urban Water Management Plan. Although alignment with the CUWCC approach and goals are recommended, the District should refrain from committing to accelerating meter installation until the distribution system replacement approach and timing is fully determined.

AB 1420 further tightens water conservation accountability to state grant and bond funding opportunities for Urban Water Suppliers. AB 1420 does not appear to change the California Water Code Section 10617 definition of an Urban Water Supplier and therefore the District does not meet the minimum size threshold to require compliance with AB 1420. This is important because AB 1420 ties back to the CUWCC BMPs and metering.

At this time, based on the evaluation above, it appears that the District is under no obligation to proceed with installation of water meters until such time as a surface water need is acted upon. The District Master Plan is providing recommendations on system-wide pipeline replacement from the back lot line to the street and metering the system in a phased approach at that time. This approach is discussed further in the following sections, but, appears consistent with existing meter installation obligation commitments.

8.3 Current Meter Retrofit Status

The District is partially metered with 95 metered accounts as show in Table 13. There are six (6) accounts that are non-residential that are currently on a flat rate as shown in Table 14 and are assumed to not be metered. There are also four (4) stand-by fire protection accounts that are not metered and are billed at as-needed basis. No residential water meters have been installed in the District.

Table 13: Water Meter Accounts Summary

Type	No. of Accounts
Multi-Family	11
Commercial	64
Institutional	5
Irrigation	15
TOTAL	95

Table 14: Commercial Flat Rate Accounts

Account No.	Customer	Service Size
50004	Eastern Mini Market	1"
50005	SI Investment Trust	8" FP, (5) 1", 2"
50038	Phuong Ngo	5/8"
50055	Sam Co Systems	1", 6" FP
50070	Ben Davis Enterprises	1½"
50112	Eastern Manor Care Home	1", 4" FP

8.4 Meter Installation Options

The District has adopted a policy to proceed with relocation of the water mains from the backyards to the street frontage at such time as the pipelines have reached the end of their useful life. Concurrent with the need to address the aging pipelines is the desire to proceed with installing water meters. The Master Plan provides a Planned System Maintenance program for both replacing the pipes, retrofitting water services during pipe replacements, and installing meters.

The District has expressed targeting a 2025 completion year for all meter installation. The District can choose from the following installation approaches:

1. Annual meter installation of approximately 113 meters per year starting in 2010. This would result in installing meters to existing backyard services and the later relocation of

meters with the planned pipeline system replacement. The estimated annual cost would be approximately \$135,000. Under this option the meters would be installed as the work proceeded and there would be a phased conversion from flat rate to a metered rate on an annual schedule.

2. Installation of meters concurrent with the Planned System Maintenance pipeline replacement projects starting in 2010 and continuing through 2025. Installation of meter setters would proceed concurrently with pipe replacement and all meters are installed in 2025. Meters would be installed at one time and the entire District residential customer group converted to a metered rate at one time. The cost of metering will be reduced from approximately \$1,200 per meter installation to approximately \$700 per installation. This represents a savings of 47% or \$1,200,000 over preceding with the installation of meters annually and in backyards.

8.5 Findings and Recommendations

The findings of this review are that the District has the option to postpone installing meters until such time as the law changes or there is a need for surface water use within the District. The District would face an annual cost of approximately \$100,000 for installing 5% (85) of the total unmetered per year at that time and this would require 20 years to complete should a surface water use be needed.

The District could proceed with installation of meters in advance of the pipeline at a cost of approximately \$135,000 per year and be complete by 2025. This approach would require relocating meters to the front yards when the pipelines are relocated from the backyard easements to the public right of way.

The District could proceed with installing meters as they replace the pipelines at a cost savings of approximately 47% or \$1,200,000 over the life of the projects.

It is recommended that the District proceed with the concurrent pipeline and meter replacement/retrofit program. Installation of meters as an annual element of the pipeline replacement plan could be reconsidered as the pipeline projects are completed.

Section 9: Planned System Maintenance

9.1 Introduction

Kennedy/Jenks has discussed with the District a Facilities Replacement Plan, which includes the evaluation of District water demands and condition assessment of production and distribution facilities. The District currently practices a sufficient day-to-day maintenance practices. Assets are identified as generally in a good working condition but are currently at or exceeding their useful lives. It is reasonably assumed that replacements of production and distribution facilities are necessary by the end of 2030. The system-wide District assets replacements will be executed as Planned System Maintenance (PSM) projects. The PSM projects will be executed through five (5) phases of four (4) year durations.

In addition to production and distribution facilities, the District acknowledged the necessity to modernize the District facilities to bring the District to a standard industry practices, this includes work associated with upgrading electrical facilities at all existing production facilities, installation of computerized supervisory control and data acquisition (SCADA) system, and building new District office and corporation yard. The PSM will also include efforts to meet all residential meters installation by 2025.

Elements of the PSM can be categorized into the following:

1. Production facilities
2. Buried infrastructures
3. Modernization of operation and maintenance
4. Programmatic element, i.e. metering.

9.2 Planning and Phasing Recommendations

Scope of PSM projects outlined in this section reflects revisions made according to inputs and discussions with District staff. Work associated in the PSM planning for each phase is generally grouped into two different types of efforts:

1. Baseline efforts are triggered by aging production facilities. Systematically, existing production facilities will be abandoned and replaced along associated installation of a typically 12" diameter backbone piping that connects through the District's quadrants. Priorities are placed first on hydraulically critical regions of the District and age second.
2. Optional efforts address the District's goal to achieve full residential meter installation by 2025. The distribution facilities replacement includes mainly pipelines with diameters smaller than 12".

The PSM Summary and Phasing are as presented in the following subsections:

9.2.1 Summary of PSM

An approach for planning a PSM project is shown in Table 15 below. Conditions for each individual project will most likely vary, however, it is recommended for the District to research or complete the following activities in the process of decision making.

Table 15: Typical Construction Projects Preparation

Year	Activities
1	Planning, Right of Way, Funding, Preliminary Design
2	Funding, CEQA, Design
3	Funding, Bidding, Construction
4	Construction, Facilities Start-Up

Summary of cost with related phases and components for the PSM project is provided with description of work for each phase as shown in Table 16 and Table 17.

Table 16: Planned System Maintenance Project Description

Project	Description of Work
1A	Demolish (E) Well No. 5; Construct (N) Well No. 5.
1B	Electrical upgrade for Well Nos. 1–8; Demolish (E) Well No. 7.
1C	Install (N) 2,610 LF of 12” pipelines and appurtenances; Retrofit 46 water service connections to front yards and install meter setters.
1D	Intertie with Carmichael Water District: (N) 3,000 LF of 12” intertie pipelines and appurtenances, meter station, and booster pump station.
2A	Demolish (E) Well No. 1; Construct (N) Well No. 1 and new pump station building; Demolish (E) Well No. 6.
2B	Construct/Purchase (N) 3,600 SF District Office.
2C	Install (N) 5,200 LF of 12” pipeline and appurtenances; Retrofit 96 water service connections to front yards and install meter setters.
2D	Install (N) 900 LF of 12” pipeline, (N) 17,230 LF of 8” pipeline, (N) 300 LF of 6” pipelines and appurtenances; Retrofit 341 water service connections to front yards and install meter setters.
3A	Construct (N) Well No. 6.
3B	Install (N) 4,900 LF of 12” pipeline and appurtenances; Retrofit 84 water service connections to front yards and install meter setters.
3C	Install (N) 14,040 LF of 8” pipeline, (N) 1350 LF of 6” pipelines and appurtenances; Retrofit 262 water service connections to front yards and install meter setters.
4A	Demolish (E) Well No. 2; Demolish (E) Well No. 3; Demolish (E) Well No. 4; Construct (N) Well near Country Club Plaza area.
4B	Install (N) 6,880 LF of 12” pipeline, (N) 35,500 LF of 8” pipeline, (N) 1,550 LF of 6” pipelines and appurtenances; Retrofit 407 water service connections to front yards and install meter setters.
4C	Install (N) 4,500 LF of 12” pipeline, (N) 20,000 LF of 8” pipeline, (N) 100 LF of 6” pipelines and appurtenances; Retrofit 381 water service connections to front yards and install meter setters; Retrofit existing 75 water service at front yards and install meter setters.
4D	Install 1,692 water meters.
5A	Demolish (E) Well No. 8; Construct (N) Well at an undetermined site
5B	Install (N) 4,500 LF of 12” pipelines and appurtenances.

Table 17: Planned System Maintenance Summary of Cost by Phase

Phase	Period	Project	Baseline / Optional	Wells	Pipelines	Pipelines (Meter Installation)	Facilities	Conjunctive Use	Total Cost
1	2010- 2014	1A	Baseline	\$1,617,000	-	-	-	-	\$1,617,000
		1B	Baseline	\$451,000	-	-	-	-	\$451,000
		1C	Baseline	-	\$453,000	-	-	-	\$453,000
		1D	Baseline	-	-	-	-	\$831,000	\$831,000
2	2014- 2018	2A	Baseline	\$1,925,000	-	-	-	-	\$1,925,000
		2B	Baseline	-	-	\$1,700,000	-	-	\$1,700,000
		2C	Baseline	-	\$956,000	-	-	-	\$956,000
		2D	Optional	-	-	\$1,147,000	-	-	\$1,147,000
3	2018- 2022	3A	Baseline	\$1,562,000	-	-	-	-	\$1,562,000
		3B	Baseline	-	\$878,000	-	-	-	\$878,000
		3C	Optional	-	-	\$2,185,000	-	-	\$2,185,000
4	2022- 2026	4A	Baseline	\$1,756,000	-	-	-	-	\$1,756,000
		4B	Baseline	-	\$5,154,000	-	-	-	\$5,154,000
		4C	Optional	-	-	\$3,401,000	-	-	\$3,401,000
		4D	Optional	-	-	\$1,880,000	-	-	\$1,880,000
5	2026- 2030	5A	Baseline	\$1,744,000	-	-	-	-	\$1,744,000
		5B	Optional	-	\$617,000	-	-	-	\$617,000

9.2.2 PSM Phase 1: 2010-2014

Phase 1 is scheduled for 2010 – 2014. The District has expressed the need for addressing priority improvements on facilities that requires immediate attention. In this case, replacement of Well No. 5 and electrical facilities upgrade for Well Nos. 1 – 8. District's Well No. 5 operation has reprioritized to be called last due in the well operation lineup. A downhole well video inspection was performed in February 2009 validates that Well No. 5 replacement is imminent. The well feeds AT&T demands, the District's single largest commercial user. Electrical facilities upgrade for Well Nos. 1 – 8 are necessary to bring the facilities to current industry and safety standards. Backbone pipeline installed in association with new Well No. 5 hydraulically connects north westerly portion of the District with the north easterly portion of the District. An intertie with Carmichael Water District is included in this Phase to address the implementation of Conjunctive Use as discussed in Section 5 of this Master Plan. The work for PSM Phase 1 is as shown on Figure 11. Discussion and summary of cost for PSM Phase 1 is included in Section 9.3.

Recommended baseline work includes the following:

Production Facilities


1. Demolish (E) Well No. 5
2. Construct (N) Well No. 5
3. Upgrade electrical facilities Well Nos. 1–8
4. SCADA installation
5. Demolish (E) Well No. 7

Distribution Facilities

1. Install (N) 2,610 LF of 12" pipeline and appurtenances
2. Retrofit 46 water service connections to front yard and install meter setters

Conjunctive Use

1. Intertie with Carmichael Water District: Install (N) 3,000 LF of 12" pipeline and appurtenances, meter station, and booster pump station

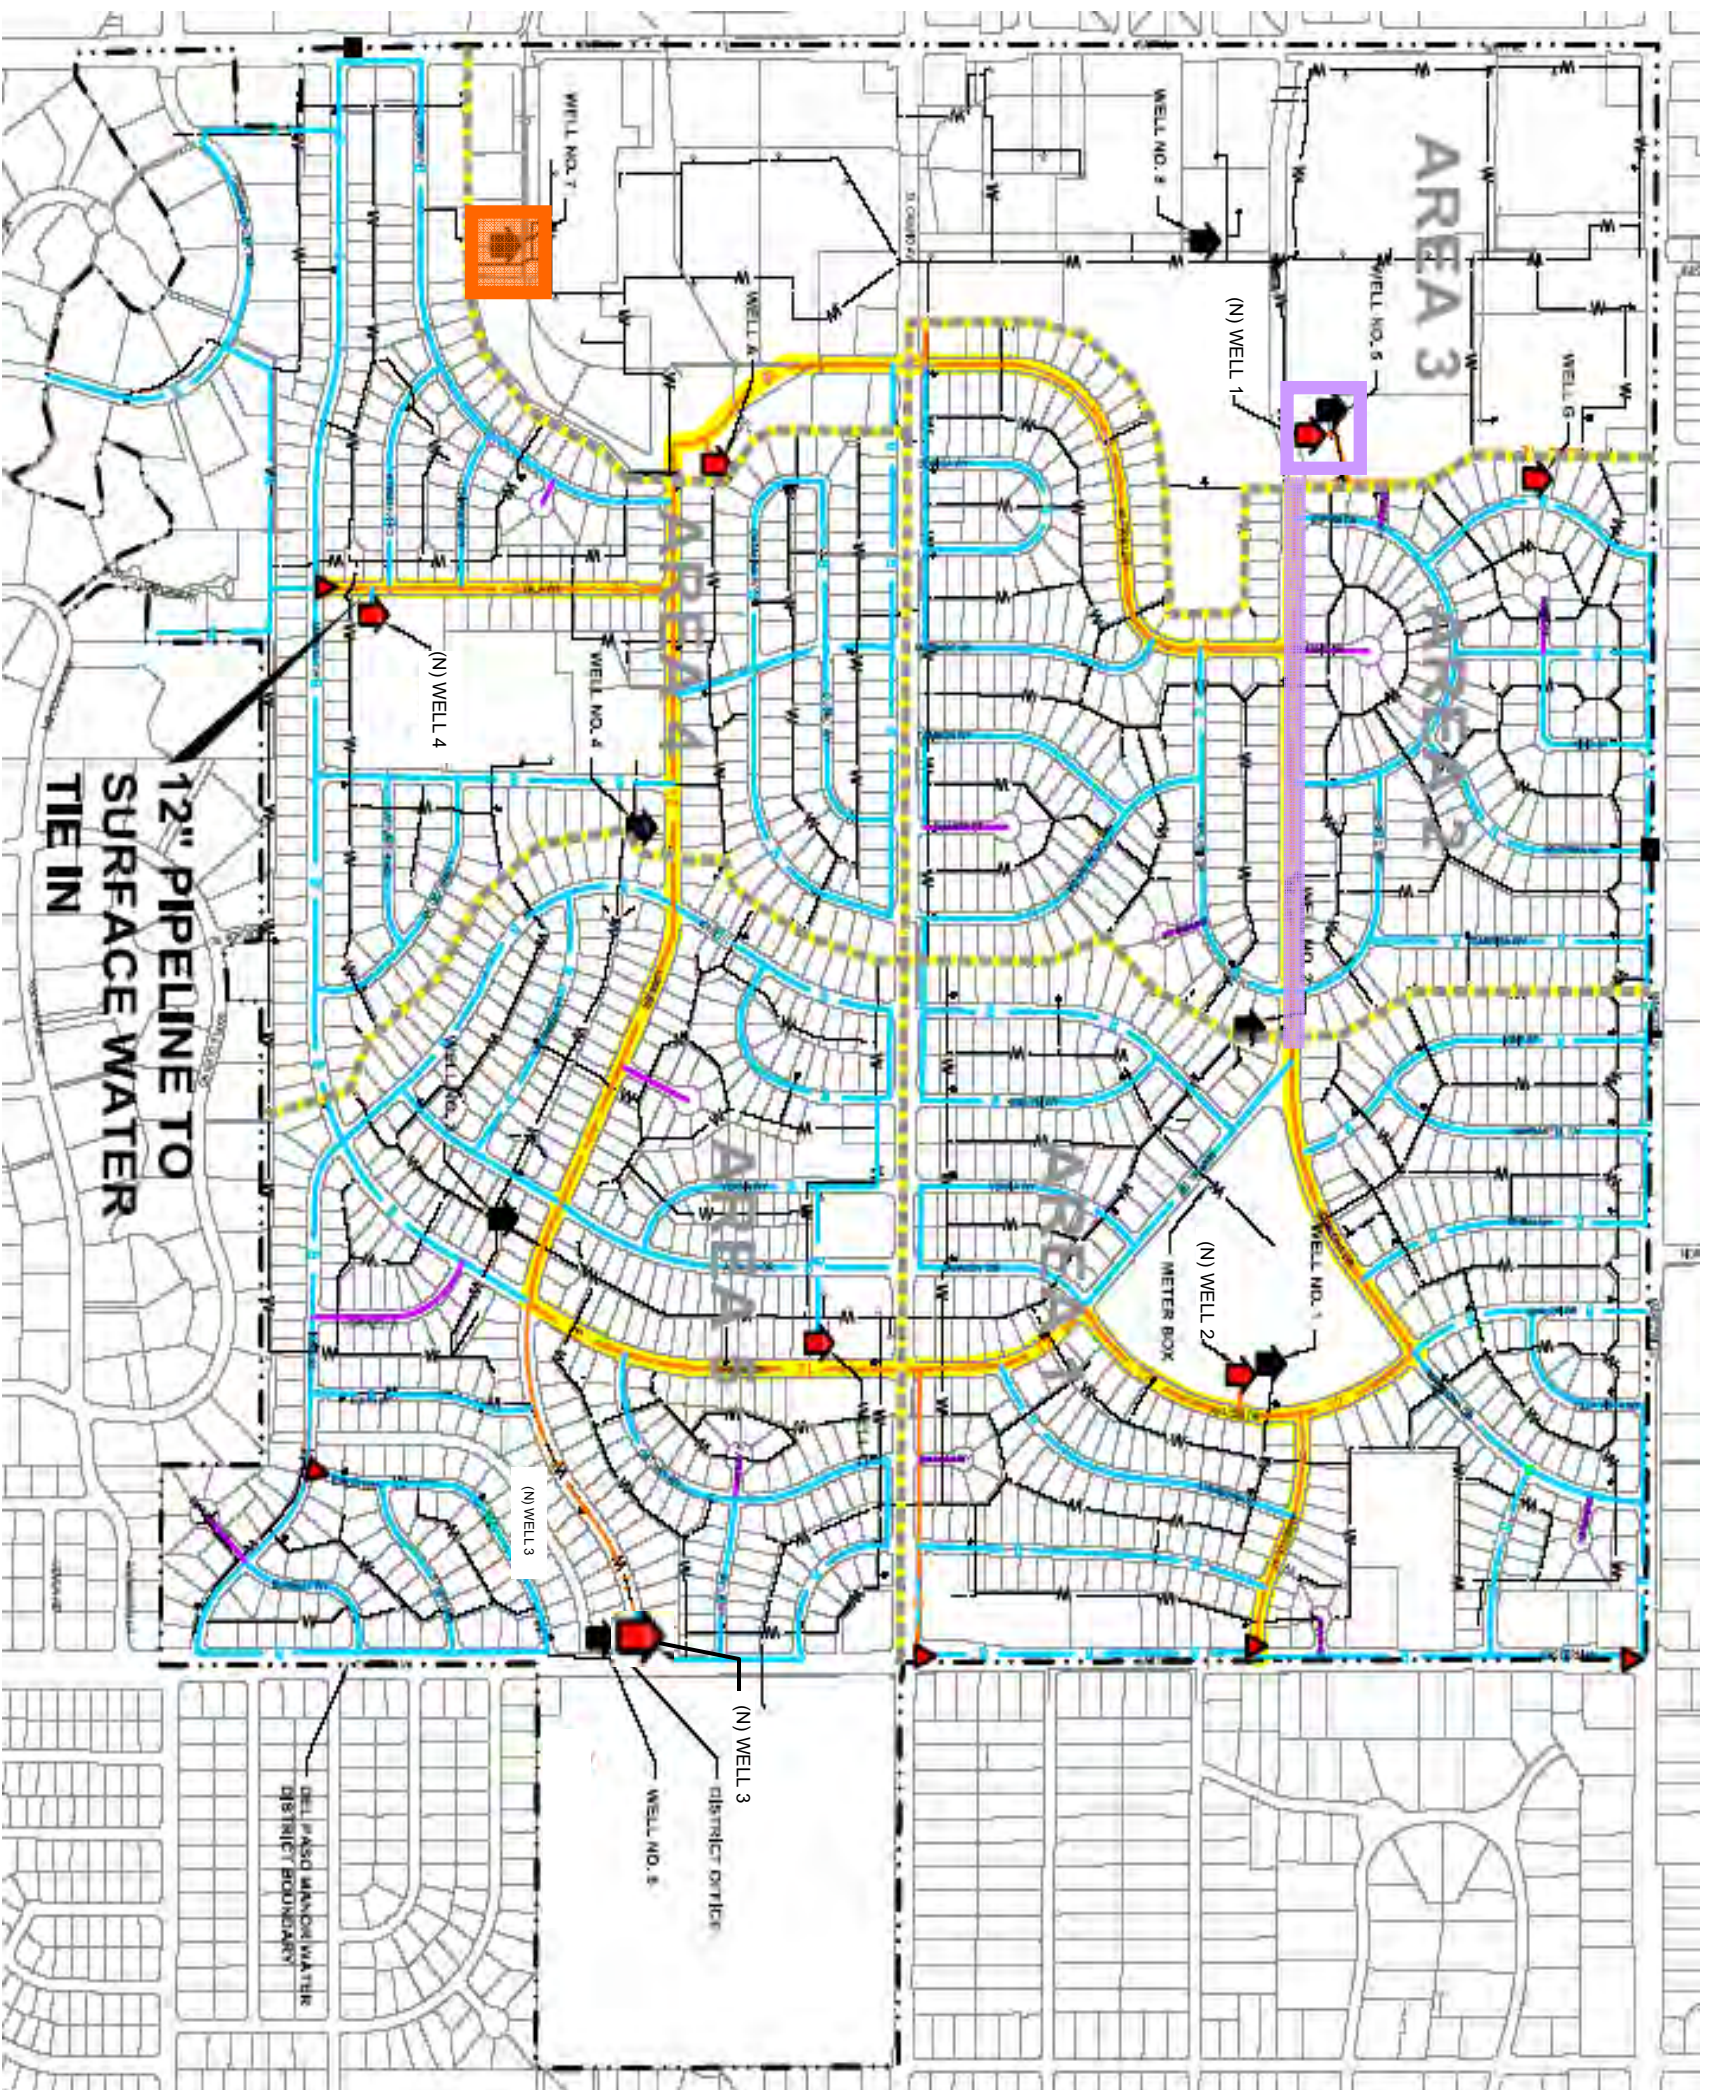

BASELINE, NEW

BASELINE, DEMO

OPTIONAL

12" PIPELINE TO SURFACE WATER TIE IN

DEL PASO MANOR WATER DISTRICT BOUNDARY

DISTRICT OFFICE

Kennedy/Jenks Consultants
 DEL PASO MANOR WATER DISTRICT
 SACRAMENTO, CALIFORNIA
 MASTER PLAN
 WATER SYSTEM PSM 2010-2014

9.2.3 PSM Phase 2: 2014-2018

Phase 2 is scheduled for 2014-2018. The District's Well No. 1 is the District's oldest lead well. The District's Well No. 6 is the only natural gas fueled engine located inside a vault to the rear of District office building. Demolition of Well No. 6 will concurrently take place with moving the District office to a new location. Extension of the backbone pipeline installed in association with new Well No. 1 hydraulically connects north easterly portion of the District with the south easterly portion of the District. The optional efforts related to installation of new distribution facilities begin to take place on this phase. The work for PSM Phase 2 is as shown on Figure 12. Discussion and summary of cost for PSM Phase 2 is included in Section 9.3.

Recommended baseline work includes the following:

Production Facilities

1. Demolish (E) Well No. 1
2. Construct (N) Well No. 1
3. Demolish (E) Well No. 6


Distribution Facilities

1. Install (N) 5,200 LF of 12" pipeline and appurtenances
2. Retrofit 96 water service connections to front yards
3. Construct/Purchase (N) 3,600 SF District Office

Recommended optional work, driven by meter installation includes the following:

Distribution Facilities

1. Install (N) 900 LF of 12" pipeline, (N) 17,230 LF of 8" pipeline, (N) 300 LF of 6" pipelines and appurtenances
2. Retrofit 341 water service connections to front yards

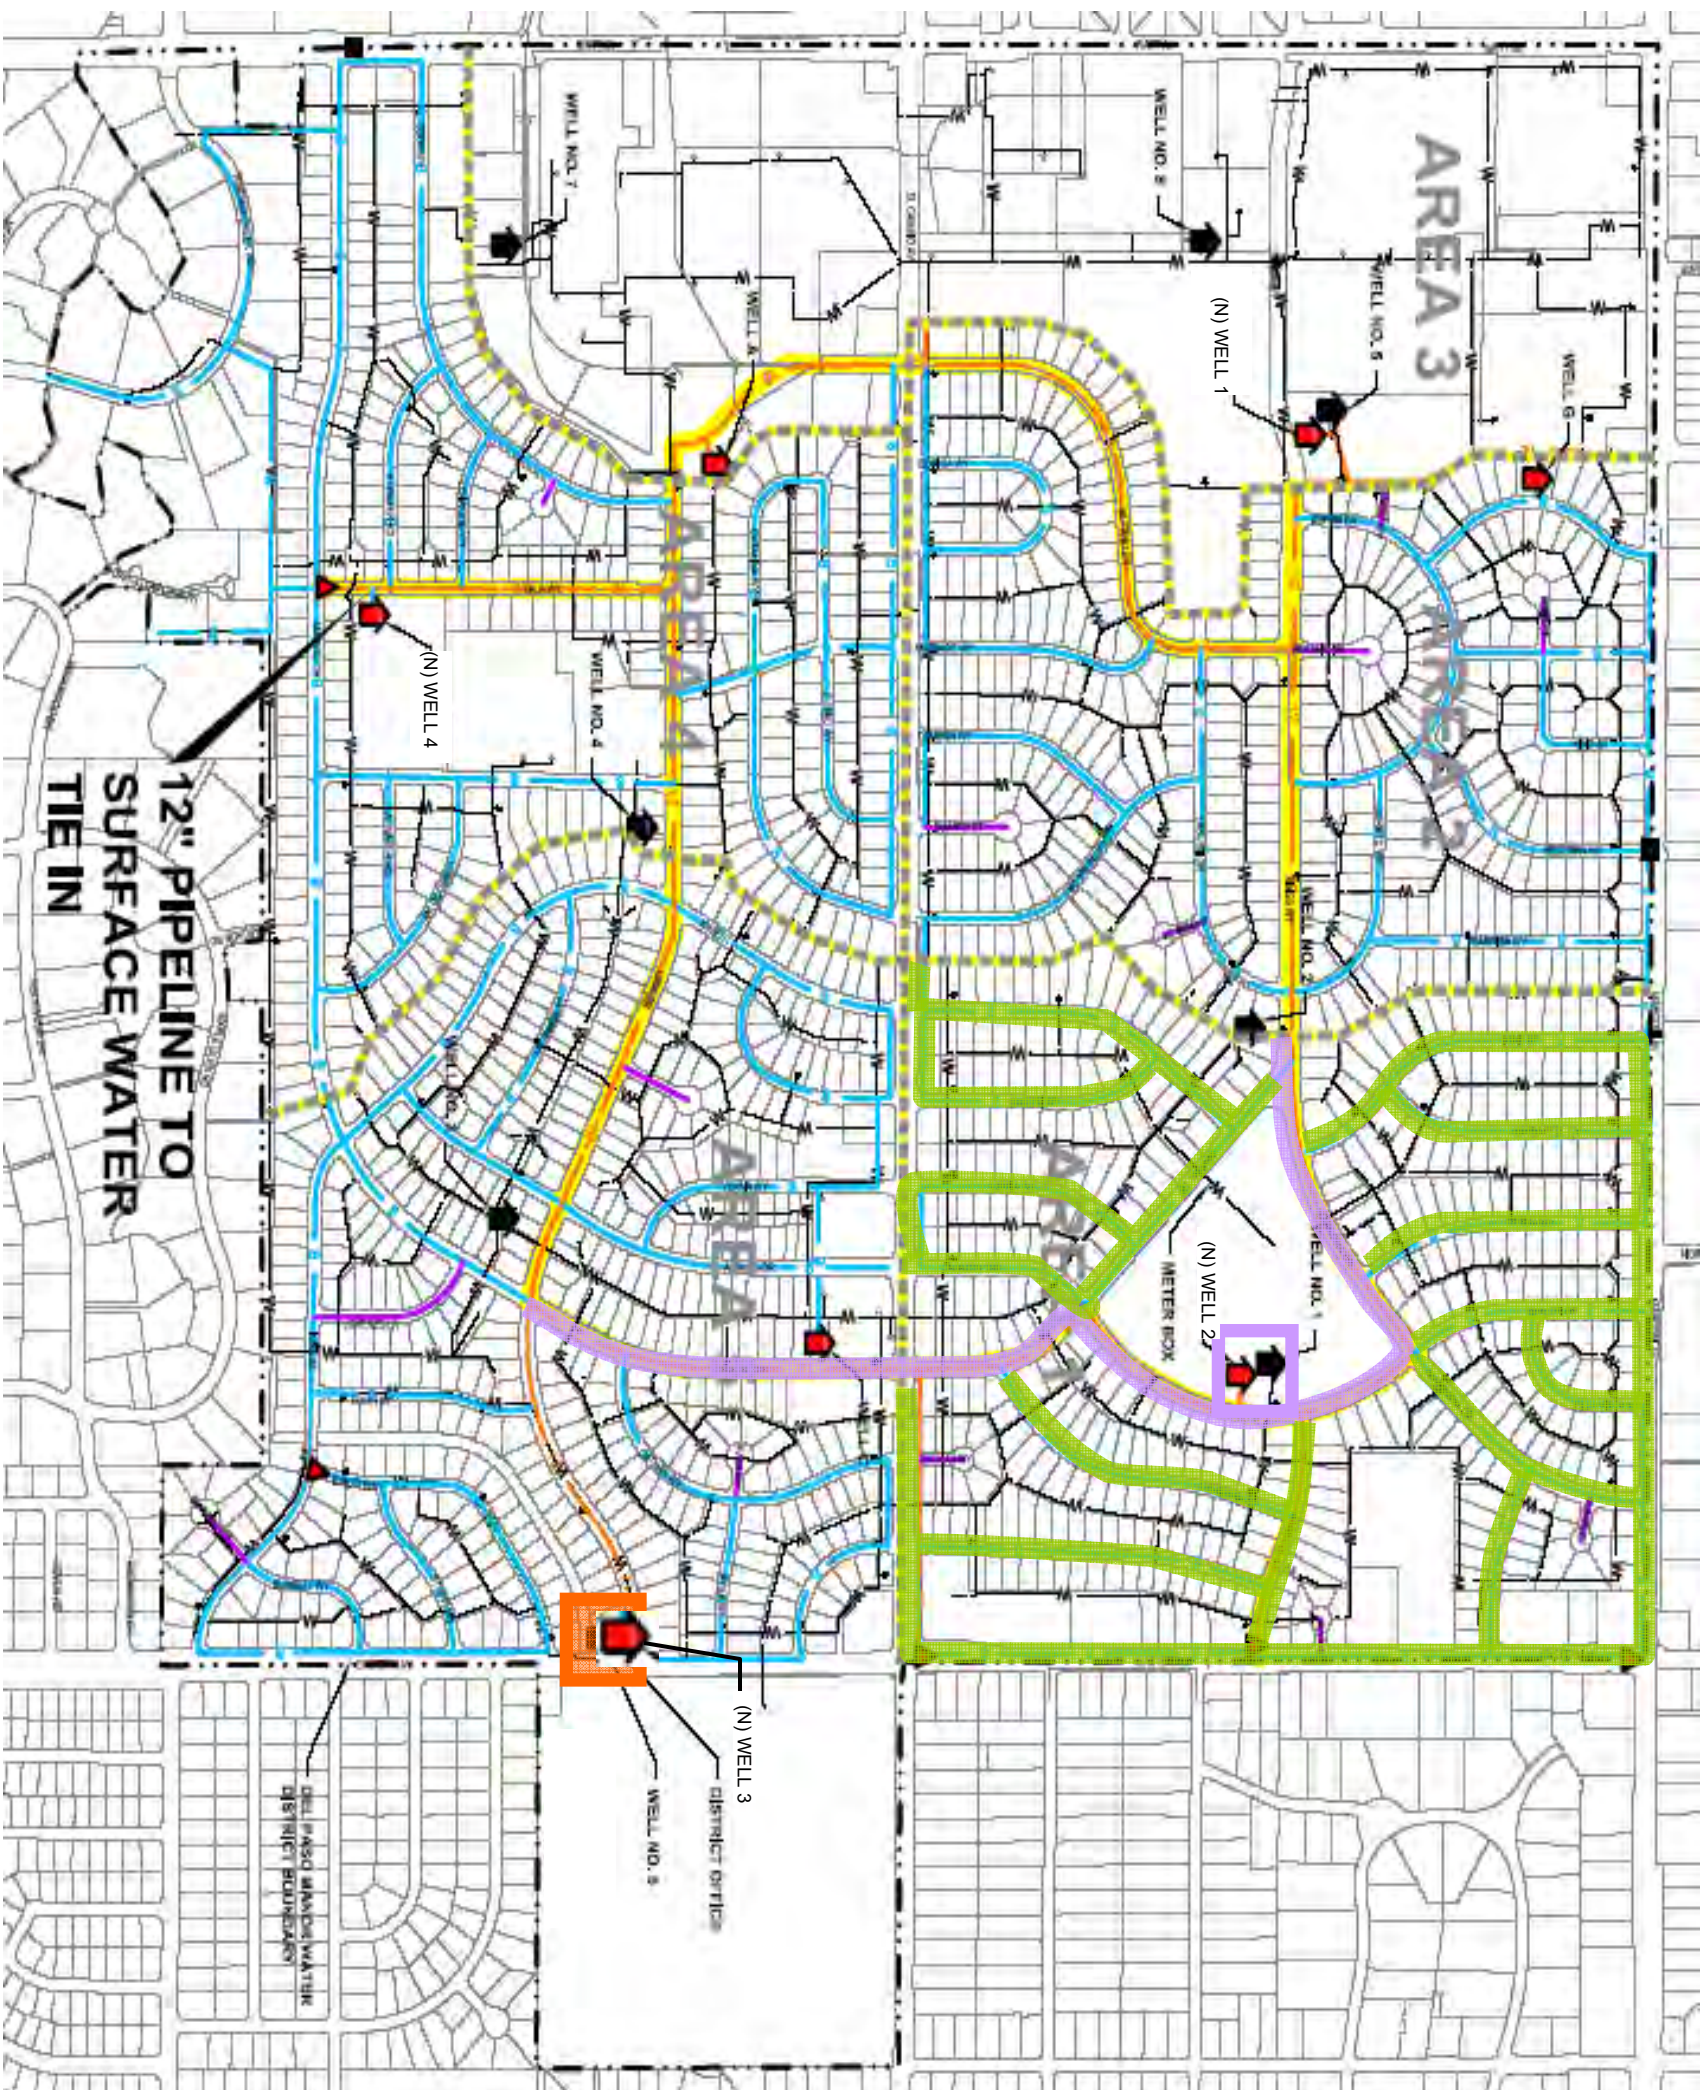

BASELINE, NEW

BASELINE, DEMO

OPTIONAL

12" PIPELINE TO
SURFACE WATER
TIE IN

Kennedy/Jenks Consultants

DEL PASO MANOR WATER DISTRICT
SACRAMENTO, CALIFORNIA
MASTER PLAN

WATER SYSTEM PSM 2014-2018

9.2.4 PSM Phase 3: 2018-2022

Phase 3 is scheduled for 2018-2022. The production facilities replacement continues with construction of new Well No. 6. The extension of the backbone pipeline installed in association with new Well No. 6 hydraulically connects south easterly portion of the District with the south westerly portion of the District. The work for PSM Phase 3 is as shown on Figure 13. Discussion and summary of cost for PSM Phase 3 is included in Section 9.3.

Recommended baseline work includes the following:

Production Facilities

1. Construct (N) Well No. 6


Distribution Facilities

1. Install (N) 4,900 LF of 12" pipeline and appurtenances
2. Retrofit 84 water service connections to front yards

Recommended optional work, driven by meter installation includes the following:

Distribution Facilities

1. Install (N) 14,040 LF of 8" pipeline, (N) 1350 LF of 6" pipelines and appurtenances
2. Retrofit 262 water service connections to front yards

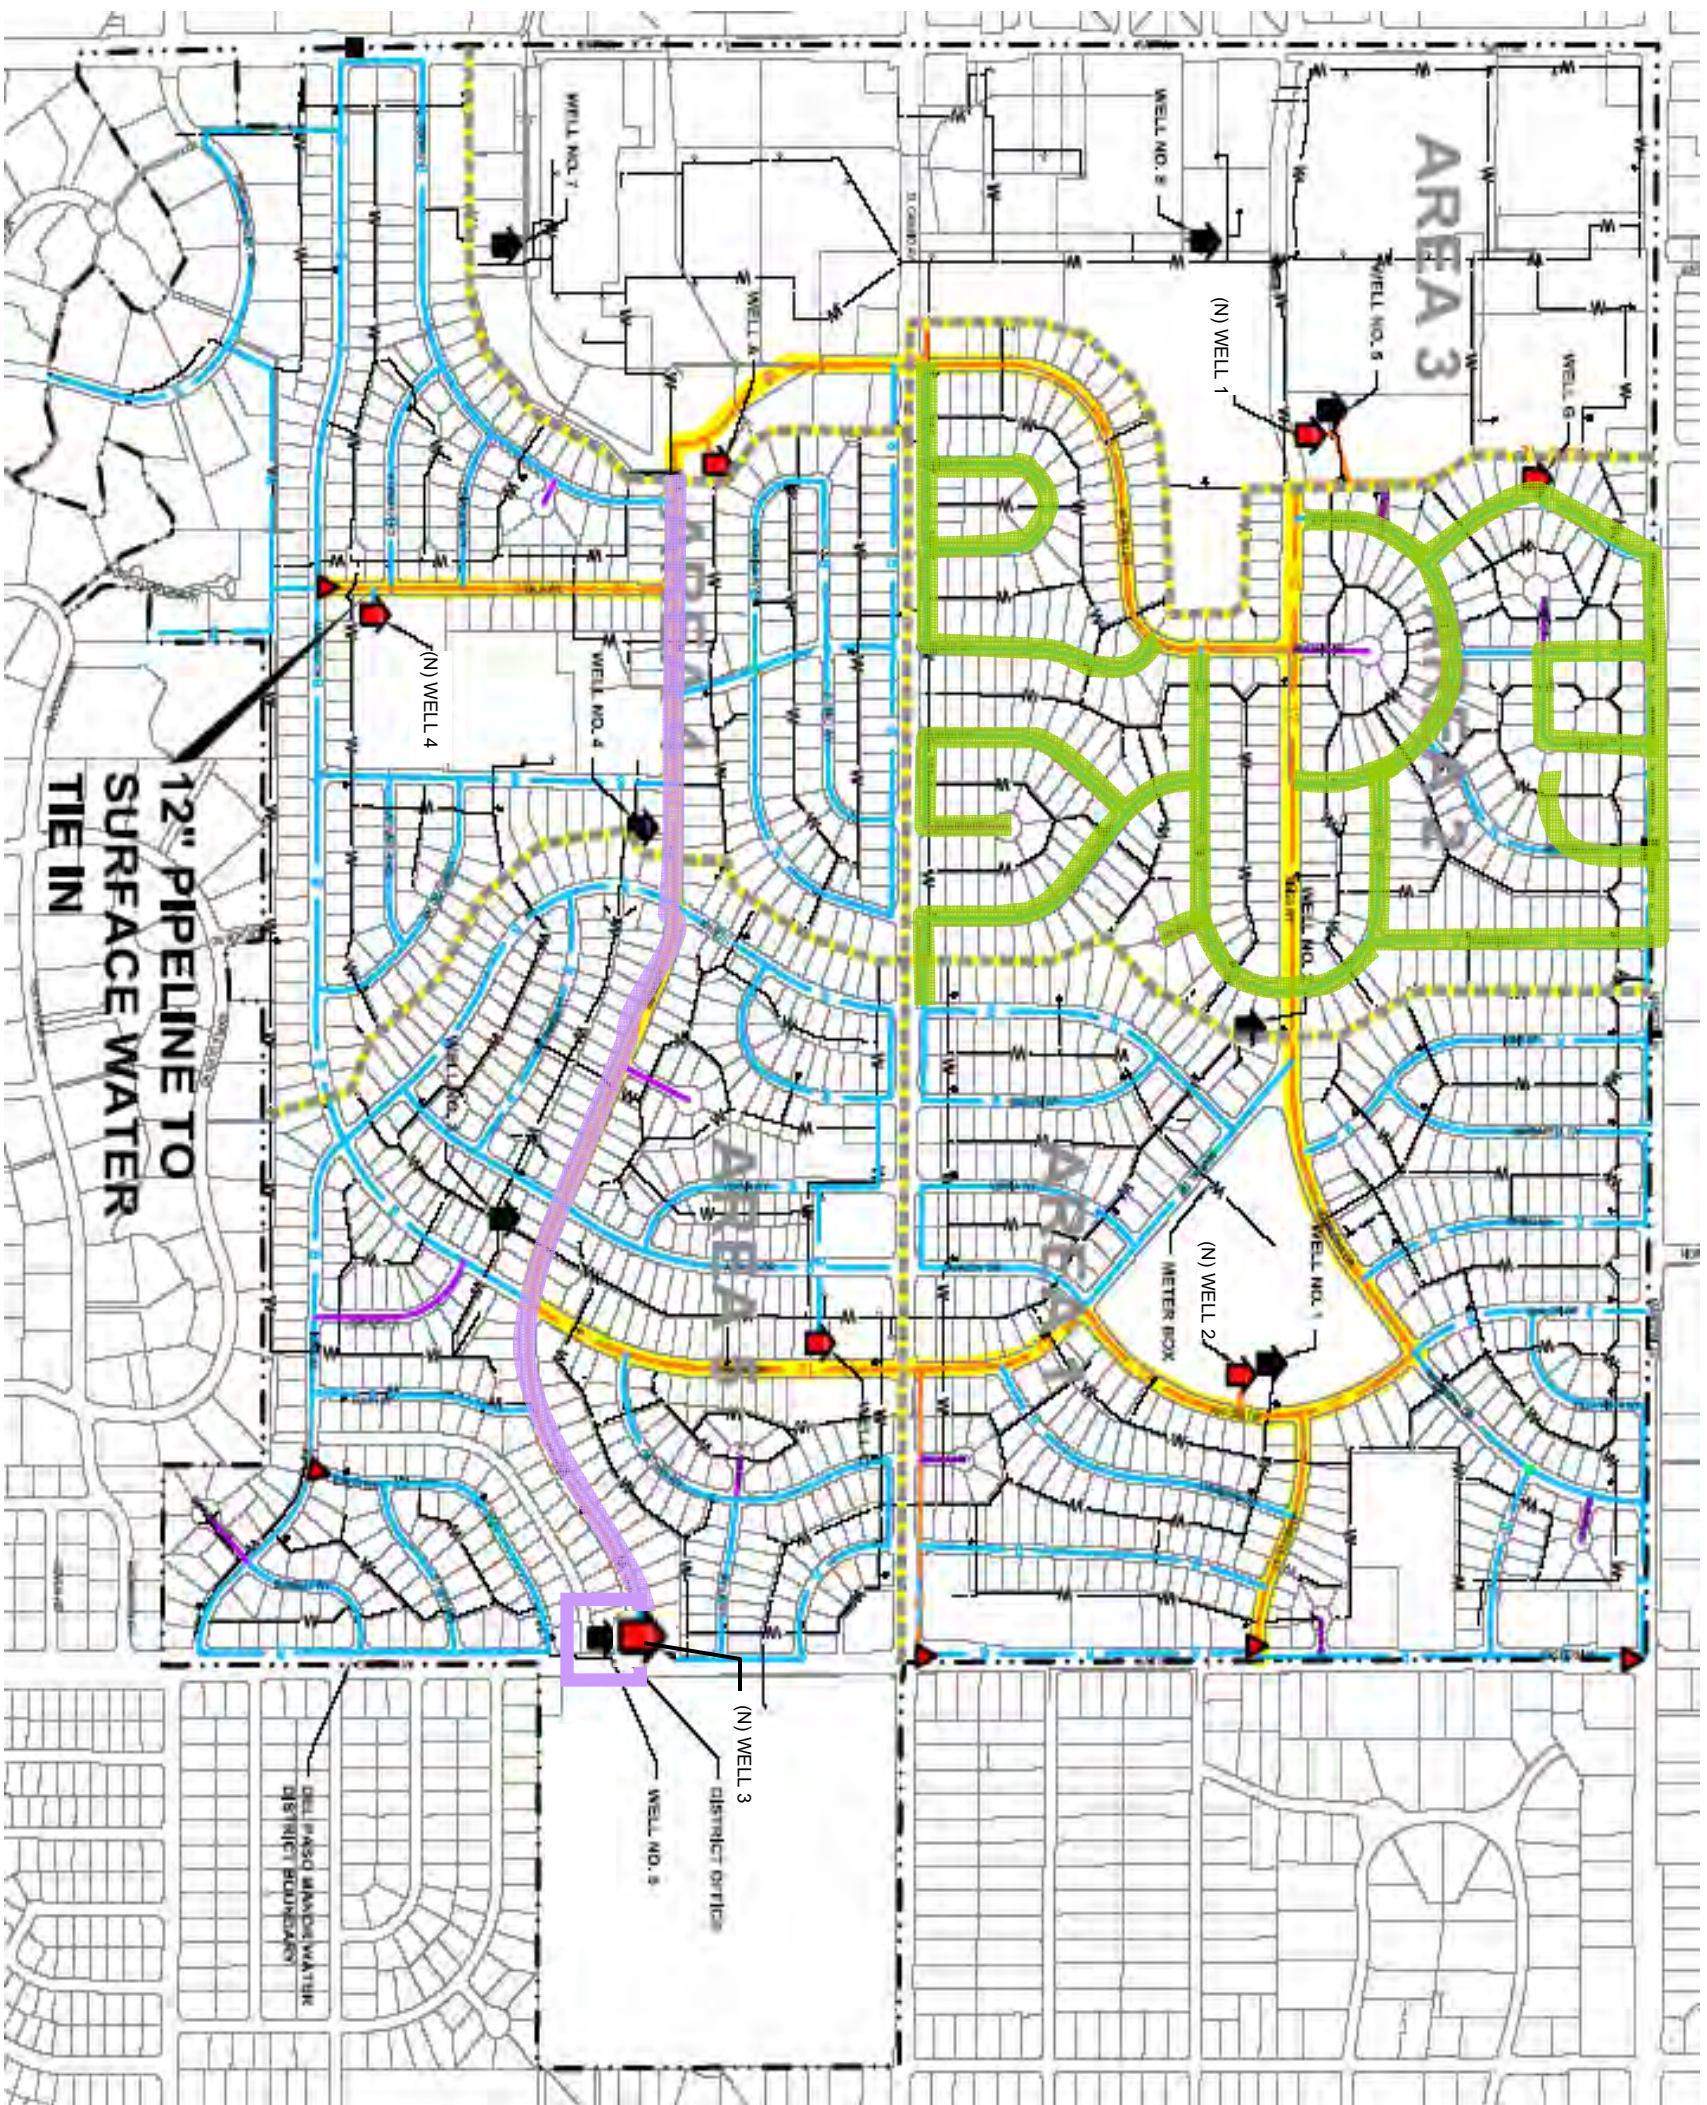

— BASELINE, NEW

— BASELINE, DEMO

— OPTIONAL

**12" PIPELINE TO
SURFACE WATER
TIE IN**

Kennedy/Jenks Consultants
 DEL PASO MANOR WATER DISTRICT
 SACRAMENTO, CALIFORNIA
 MASTER PLAN

WATER SYSTEM PSM 2018-2022

KJ 0870017.00
 APRIL 2009
 FIGURE 13

9.2.5 PSM Phase 4: 2022-2026

Phase 4 is scheduled for 2022-2026. The production facilities replacement continues with demolition of Well Nos. 2, 3, and 4 and construction of a new well at a site near the Country Club commercial area. The extension of the backbone pipeline installed in association with the new well hydraulically connects south westerly portion of the District with the north westerly portion of the District. Non backbone pipelines are included in the baseline to help meeting deadline for meter installation. Work for PSM Phase 4 is as shown on Figure 14. Discussion and summary of cost for PSM Phase 4 is included in Section 9.3.

Recommended baseline work includes the following:

Production Facilities

1. Demolish (E) Well No. 2
2. Demolish (E) Well No. 3
3. Demolish (E) Well No. 4
4. Construct (N) Well at Country Club site


Distribution Facilities

1. Install (N) 6,880 LF of 12" pipeline, (N) 35,500 LF of 8" pipeline, (N) 1,550 LF of 6" pipelines and appurtenances
2. Retrofit 407 water service connections to front yards

Recommended optional work, driven by meter installation includes the following:

Distribution Facilities

1. Install (N) 4,500 LF of 12" pipeline, (N) 20,000 LF of 8" pipeline, (N) 100 LF of 6" pipelines and appurtenances
2. Retrofit 381 water service connections to front yards
3. Retrofit existing 75 water service at front yards
4. Install 1692 water meters

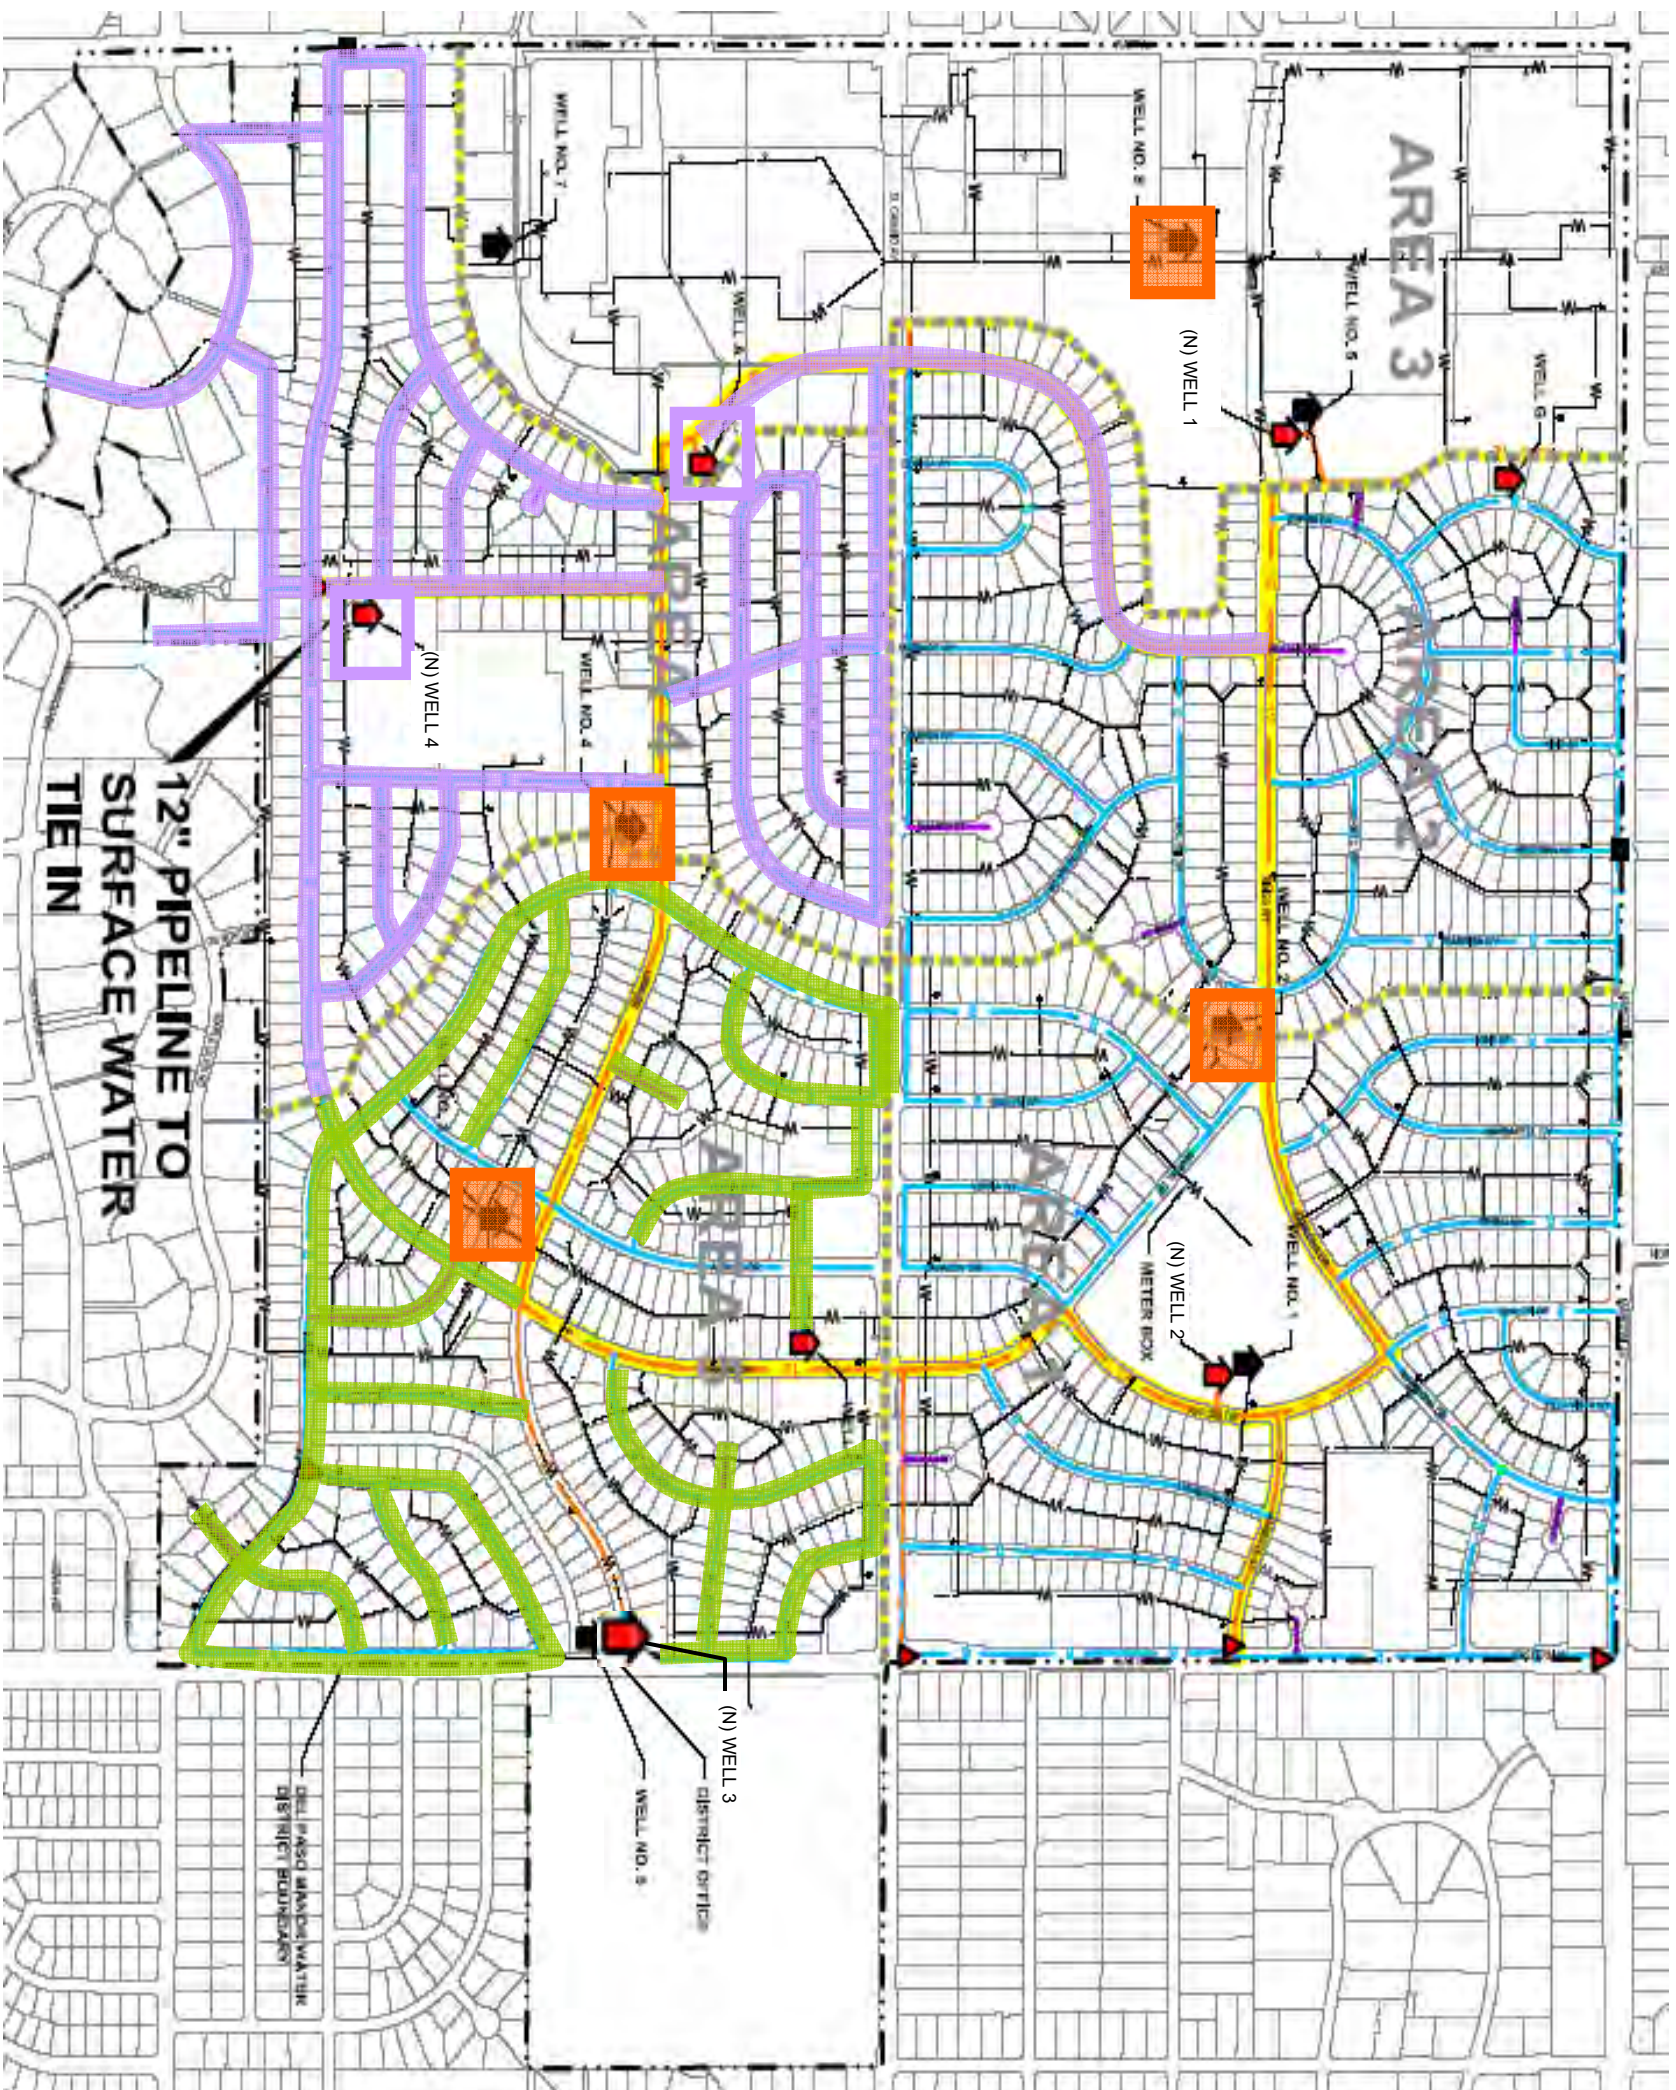

— BASELINE, NEW

— BASELINE, DEMO

— OPTIONAL

12" PIPELINE TO
SURFACE WATER
TIE IN

DEL PASO MANOR WATER
DISTRICT BOUNDARY

(N) WELL 3
DISTRICT OFFICE
WELL NO. 3

(N) WELL 2
METER BOX

WELL NO. 1

WELL NO. 2

WELL NO. 5

WELL NO. 6

WELL NO. 7

(N) WELL 4

WELL NO. 4

WELL NO. 5

WELL NO. 6

WELL NO. 7

AREA 3

AREA 4

WATER SYSTEM PSM 2022-2026

Kennedy/Jenks Consultants
DEL PASO MANOR WATER DISTRICT
SACRAMENTO, CALIFORNIA
MASTER PLAN

KJ 0870017.00
APRIL 2009
FIGURE 14

9.2.6 PSM Phase 5: 2026-2030

Phase 5 is scheduled for 2026-2030. The production facilities replacement finishes with demolition of Well 8 and construction of a new well at a site that is not yet determined. At this time, all the backbone pipeline has been installed to accommodate full capacity of the District's new wells. A distribution facility replacement for a segment in the commercial area is included as optional work. The work for PSM Phase 5 is as shown on Figure 15. Discussion and summary of cost for PSM Phase 5 is included in Section 9.3.

Recommended baseline work includes the following:

Production Facilities

1. Demolish (E) Well 8
2. Construct (N) Well at a site to be determined

Recommended optional work includes the following:


Distribution Facilities

1. Install (N) 4,500 LF of 12" pipelines and appurtenances

— BASELINE, NEW

— BASELINE, DEMO

— OPTIONAL

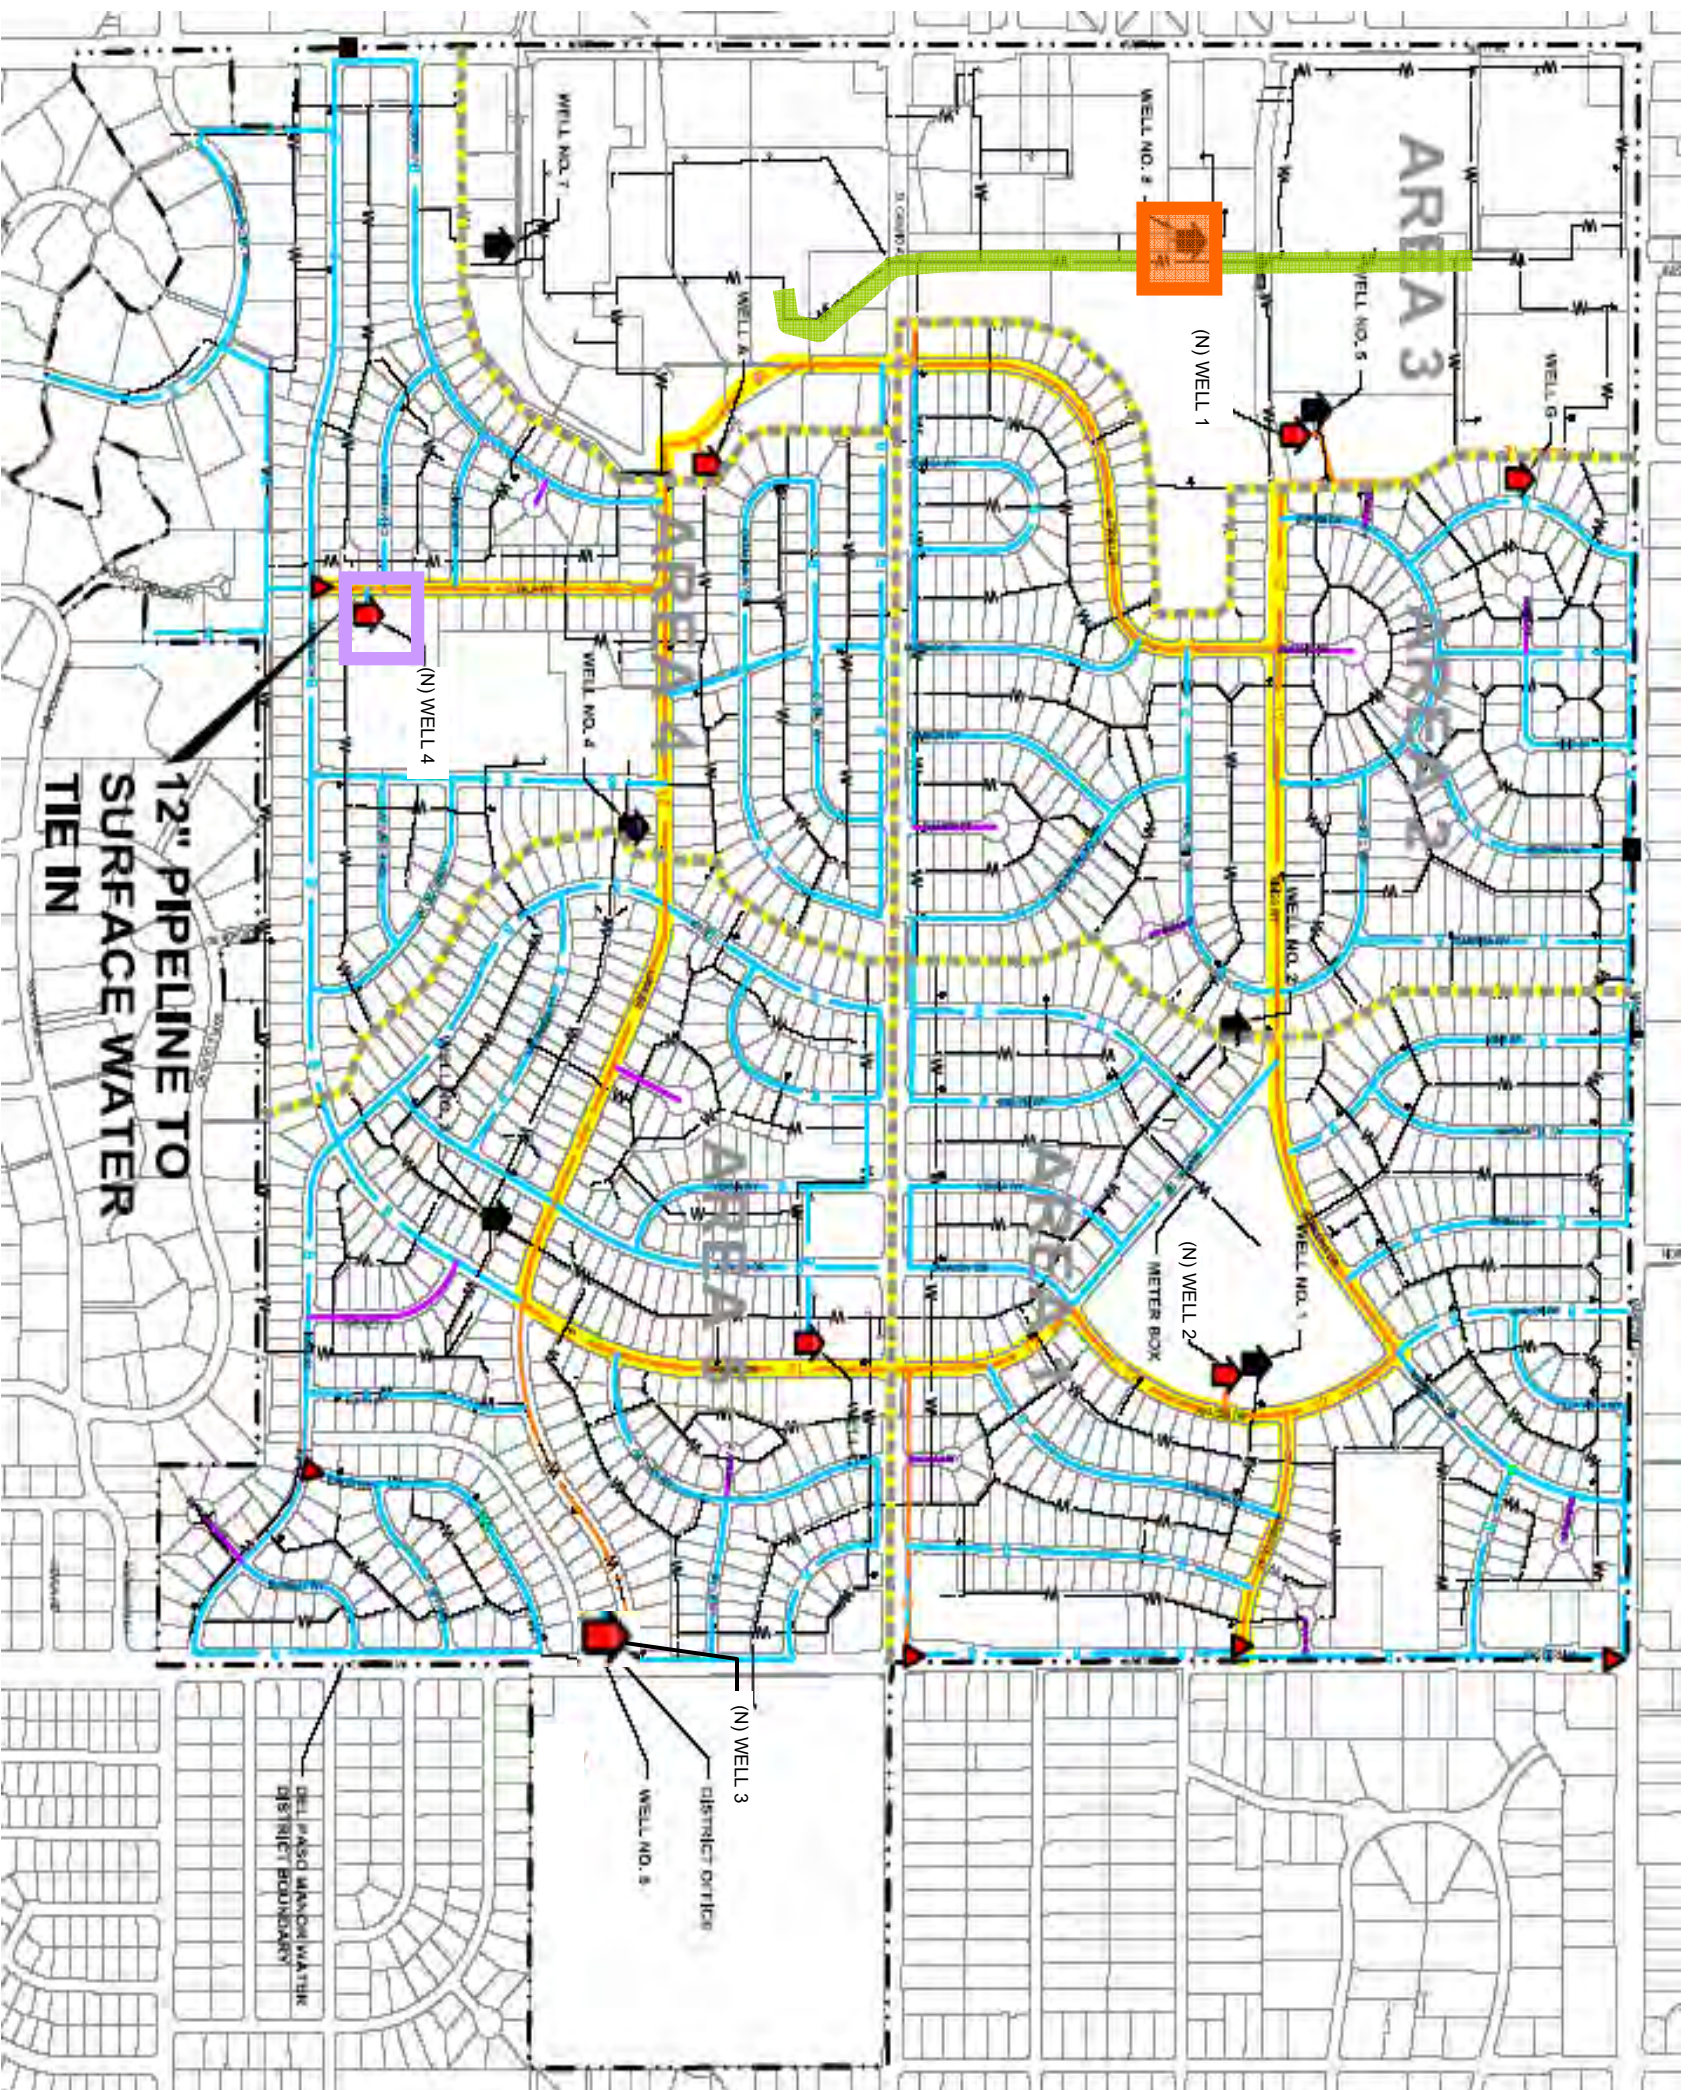

Kennedy/Jenks Consultants
DEL PASO MANOR WATER DISTRICT
SACRAMENTO, CALIFORNIA
MASTER PLAN

WATER SYSTEM PSM 2026-2030

9.3 Cost Estimate

The cost estimates were prepared using prior construction bids, current materials pricing, estimating guides, and engineering judgment. The costs are opinion of probable cost and reflect a conceptual level of accuracy. The estimates include a 25 percent contingency for unforeseen conditions, a 10 percent cost for engineering, administrative, and legal costs, a 1 percent cost for environmental review. In this case, it is assumed that District's Planned System Maintenance projects qualify for CEQA Categorical Exemption. Opinions of cost are in current 2009 dollars and are based on Engineering News Records for West Coast Cities - San Francisco Index of 9757.

The estimated new well construction costs include new well drilling and associated improvements, such as site work, mechanical, electrical and instrumentation. The estimated new pipeline cost is per lineal foot of trench installed. The appurtenances include blow-off assembly, fire hydrants, connection to existing distribution system, and abandonment of existing pipeline. Land costs for new wells are included at an estimated \$250,000 per site and may vary based on actual sites.

Total cost for PSM Phases 1 – 5 in current 2009 is approximately \$28.3 M. The Cost Summary is shown by phase, schedule, and baseline and optional costs. Optional costs reflect costs of distribution pipelines that are driven by District wide completion of service retrofits and meter setters installation for all residential meters installed by 2025. Cost estimate is prepared to reflect options of completing meter installation as an optional effort in phase 4 (2022-2026). The breakdown of cost estimate by individual projects is also included as example of potential staging completion of each PSM phase.

A cost impact calculation was prepared assuming a 4 ½ percent interest rate over 30 years allocated by estimated water use. The estimate provides a monthly residential service cost associated with each PSM phase.

Del Paso Manor Water District
 Planned System Maintenance
 2010-2030
 Meter Installation by 2025
 Cost Summary

PSM Phase	Scheduled	Baseline	Optional	Total
1	2010 - 2014	\$4,393,400	\$0	\$4,393,400
2	2014 - 2018	\$4,928,200	\$1,147,000	\$6,075,200
3	2018 - 2022	\$2,439,400	\$2,184,800	\$4,624,200
4	2022 - 2026	\$6,910,100	\$5,628,300	\$12,538,400
5	2026 - 2030	\$1,744,300	\$617,400	\$2,361,700
Estimated Cost				<u>\$ 29,992,900</u>

Rounded to: \$ 29,993,000.00

Del Paso Manor Water District
Planned System Maintenance
Phase 1- Summary
2010-2014

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish (E) Well 5	1	LS	\$ 50,000.00	\$ 50,000.00
Construct (N) Well 5 (N) Block Wall	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
Well Electrical Upgrade/SCADA	140	LF	\$ 104.00	\$ 14,560.00
Demolish (E) Well 7	1	LS	\$ 250,000.00	\$ 250,000.00
	1	LS	\$ 75,000.00	\$ 75,000.00
PIPELINES				
12" Piping	2610	LF	\$ 87.22	\$ 227,640.00
8" Piping		LF	\$ -	\$ -
6" Piping		LF	\$ -	\$ -
Appurtenances ^a	1	LS	\$ 20,000.00	\$ 20,000.00
a) Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	46	EA	\$ 1,700.00	\$ 78,200.00
Service Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
CONJUNCTIVE USE				
Carmichael WD Intertie Pipeline and System Intertie	1	EA	\$ 360,624.00	\$ 360,624.00
Booster Pump Station	1	EA	\$ 237,600.00	\$ 237,600.00
Additional Environmental	1	LS	\$ 250,000.00	\$ 250,000.00
Land/Right of Way				
Well 5	1	LS	\$ 250,000.00	\$ 250,000.00
CWD Intertie	1	LS	\$ 250,000.00	\$ 250,000.00
Subtotal				\$ 3,163,624.00
Contingencies			25%	\$ 790,906.00
Subtotal				\$ 3,954,530.00
Engineering, Admin, and Legal			10%	\$ 395,453.00
Subtotal				\$ 4,349,983.00
Environmental (Categorical Exemption)			1%	\$ 43,499.83
Estimated Cost				\$ 4,393,482.83

Rounded to:	\$ 4,393,400.00
--------------------	------------------------

Economic Impacts	
Outlay 2014	\$ 4,393,400.00
Annual Cost Factor 30 years @ 4.5% (0.0614)	\$ 269,754.76
Cost per Acre Foot Water/Year	\$ 160.57
Cost per Single Family ResidentialMonth	\$ 7.28

Del Paso Manor Water District
 Planned System Maintenance
 Phase 1
 2010-2014
Project 1A

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish (E) Well 5	1	LS	\$ 50,000.00	\$ 50,000.00
Construct (N) Well 5	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
(N) Block Wall	140	LF	\$ 104.00	\$ 14,560.00

Subtotal				\$ 1,164,560.00
Contingencies			25%	\$ 291,140.00
Subtotal				\$ 1,455,700.00
Engineering, Admin, and Legal			10%	\$ 145,570.00
Subtotal				\$ 1,601,270.00
Environmental (Categorical Exemption)			1%	\$ 16,012.70
Estimated Cost				\$ 1,617,282.70

Rounded to:	\$ 1,617,000.00
--------------------	------------------------

Del Paso Manor Water District
 Planned System Maintenance
 Phase 1
 2010-2014
Project 1B

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Well Electrical Upgrade/SCADA	1	LS	\$ 250,000.00	\$ 250,000.00
Demolish (E) Well 7	1	LS	\$ 75,000.00	\$ 75,000.00

Subtotal				\$ 325,000.00
Contingencies			25%	\$ 81,250.00
Subtotal				\$ 406,250.00
Engineering, Admin, and Legal			10%	\$ 40,625.00
Subtotal				\$ 446,875.00
Environmental (Categorical Exemption)			1%	\$ 4,468.75
Estimated Cost				\$ 451,343.75

Rounded to:	\$ 451,000.00
--------------------	----------------------

Del Paso Manor Water District
Planned System Maintenance
Phase 1
2010-2014
Project 1C

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
PIPELINES				
12" Piping	2610	LF	\$ 87.22	\$ 227,640.00
8" Piping		LF	\$ -	\$ -
6" Piping		LF	\$ -	\$ -
Appurtenances ^a	1	LS	\$ 20,000.00	\$ 20,000.00
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	46	EA	\$ 1,700.00	\$ 78,200.00
Service Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -

Subtotal				\$ 325,840.00
Contingencies			25%	\$ 81,460.00
Subtotal				\$ 407,300.00
Engineering, Admin, and Legal			10%	\$ 40,730.00
Subtotal				\$ 448,030.00
Environmental (Categorical Exemption)			1%	\$ 4,480.30
Estimated Cost				\$ 452,510.30

Rounded to:	\$ 453,000.00
--------------------	----------------------

Del Paso Manor Water District
Planned System Maintenance
Phase 1
2010-2014
Project 1D

Project Element	Quantity	Unit	Unit Cost	Extension
CONJUNCTIVE USE				
Carmichael WD Intertie				
Pipeline and System Intertie	1	EA	\$ 360,624.00	\$ 360,624.00
Booster Pump Station	1	EA	\$ 237,600.00	\$ 237,600.00
Additional Environmental	1	LS	\$ 250,000.00	\$ 250,000.00

Subtotal				\$ 848,224.00
Contingencies			25%	\$ 212,056.00
Subtotal				\$ 1,060,280.00
Engineering, Admin, and Legal			10%	\$ 106,028.00
Subtotal				\$ 1,166,308.00
Environmental (Categorical Exemption)			1%	\$ 11,663.08
Estimated Cost				\$ 1,177,971.08

Rounded to:	\$ 1,178,000.00
--------------------	------------------------

Del Paso Manor Water District
Planned System Maintenance
Phase 2 - Summary
2014-2018

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish (E) Well 1	1	LS	\$ 90,000.00	\$ 90,000.00
Construct (N) Well 1 (N) Pump Station Building	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
Demolish (E) Well 6	1	LS	\$ 90,000.00	\$ 90,000.00
PIPELINES				
12" Piping	5200	LF	\$ 87.46	\$ 454,800.00
8" Piping		LF	\$ -	\$ -
6" Piping		LF	\$ -	\$ -
Appurtenances ^{a)}	1	LS	\$ 70,350.83	\$ 70,350.83
a) Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	96	EA	\$ 1,700.00	\$ 163,482.01
Service Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
NEW DISTRICT OFFICE				
Building Acquisition	3600	SF	\$ 250.00	\$ 900,000.00
Tenant Improvement	3600	SF	\$ 90.00	\$ 324,000.00
Land/Right of Way Well 1	1	LS	\$ 250,000.00	\$ 250,000.00
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	900	LF	\$ 88.00	\$ 79,200.00
8" Piping	17230	LF	\$ 57.90	\$ 57.90
6" Piping	300	LF	\$ 46.00	\$ 46.00
Appurtenances	1	LS	\$ 167,249.17	\$ 167,249.17
a) Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	341	EA	\$ 1,700.00	\$ 579,417.99
Service Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
Subtotal				\$ 4,374,603.90
Contingencies			25%	\$ 1,093,650.98
Subtotal				\$ 5,468,254.88
Engineering, Admin, and Legal			10%	\$ 546,825.49
Subtotal				\$ 6,015,080.37
Environmental (Categorical Exemption)			1%	\$ 60,150.80
Estimated Cost				\$ 6,075,231.17

Rounded to:	\$ 6,075,200.00
--------------------	------------------------

Economic Impacts	
Outlay 2014	\$ 6,075,200.00
Annual Cost Factor 30 years @ 4.5% (0.0614)	\$ 373,017.28
Cost per Acre Foot Water/Year	\$ 222.03
Cost per Single Family ResidentialMonth	\$ 10.07

Del Paso Manor Water District
 Planned System Maintenance
 Phase 2
 2014-2018
Project 2A

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish (E) Well 1	1	LS	\$ 90,000.00	\$ 90,000.00
Construct (N) Well 1 (N) Pump Station Building	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
Demolish (E) Well 6	1	LS	\$ 106,000.00	\$ 106,000.00
	1	LS	\$ 90,000.00	\$ 90,000.00

Subtotal		\$ 1,386,000.00
Contingencies	25%	<u>\$ 346,500.00</u>
Subtotal		\$ 1,732,500.00
Engineering, Admin, and Legal	10%	<u>\$ 173,250.00</u>
Subtotal		\$ 1,905,750.00
Environmental (Categorical Exemption)	1%	<u>\$ 19,057.50</u>
Estimated Cost		<u>\$ 1,924,807.50</u>

Rounded to:	\$ 1,925,000.00
--------------------	------------------------

Del Paso Manor Water District
 Planned System Maintenance
 Phase 2
 2014-2018
Project 2B

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
NEW DISTRICT OFFICE				
Building Acquisition	3600	SF	\$ 250.00	\$ 900,000.00
Tenant Improvement	3600	SF	\$ 90.00	\$ 324,000.00

Subtotal				\$ 1,224,000.00
Contingencies			25%	<u>\$ 306,000.00</u>
Subtotal				\$ 1,530,000.00
Engineering, Admin, and Legal			10%	<u>\$ 153,000.00</u>
Subtotal				\$ 1,683,000.00
Environmental (Categorical Exemption)			1%	<u>\$ 16,830.00</u>
Estimated Cost				<u><u>\$ 1,699,830.00</u></u>

Rounded to:	\$ 1,700,000.00
--------------------	------------------------

Del Paso Manor Water District
 Planned System Maintenance
 Phase 2
 2014-2018
Project 2C

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
PIPELINES				
12" Piping	5200	LF	\$ 87.46	\$ 454,800.00
8" Piping		LF	\$ -	\$ -
6" Piping		LF	\$ -	\$ -
Appurtenances ^a	1	LS	\$ 70,350.83	\$ 70,350.83
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	96	EA	\$ 1,700.00	\$ 163,482.01
Service Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -

Subtotal		\$ 688,632.84
Contingencies	25%	\$ 172,158.21
Subtotal		\$ 860,791.05
Engineering, Admin, and Legal	10%	\$ 86,079.10
Subtotal		\$ 946,870.15
Environmental (Categorical Exemption)	1%	\$ 9,468.70
Estimated Cost		<u>\$ 956,338.86</u>

Rounded to:	\$ 956,000.00
--------------------	----------------------

Del Paso Manor Water District
 Planned System Maintenance
 Phase 2
 2014-2018
Project 2D

Project Element	Quantity	Unit	Unit Cost	Extension
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	900	LF	\$ 88.00	\$ 79,200.00
8" Piping	17230	LF	\$ 57.90	\$ 57.90
6" Piping	300	LF	\$ 46.00	\$ 46.00
Appurtenances ^a	1	LS	\$ 167,249.17	\$ 167,249.17
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	341	EA	\$ 1,700.00	\$ 579,417.99
Service Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -

Subtotal		\$ 825,971.06
Contingencies	25%	<u>\$ 206,492.77</u>
Subtotal		\$ 1,032,463.83
Engineering, Admin, and Legal	10%	<u>\$ 103,246.38</u>
Subtotal		\$ 1,135,710.21
Environmental (Categorical Exemption)	1%	<u>\$ 11,357.10</u>
Estimated Cost		<u><u>\$ 1,147,067.32</u></u>

Rounded to:	\$ 1,147,000.00
--------------------	------------------------

Del Paso Manor Water District
Planned System Maintenance
Phase 3 - Summary
2018-2022

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Construct (N) Well 6	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
(N) Block Wall	140	LF	\$ 104.00	\$ 14,560.00
Landscape	1	LS	\$ 10,000.00	\$ 10,000.00
PIPELINES				
12" Piping	4900	LF	\$ 85.96	\$ 421,200.00
8" Piping	0	LF	\$ -	\$ -
6" Piping	0	LF	\$ -	\$ -
Appurtenances ^a	1	LS	\$ 68,763.43	\$ 68,763.43
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	84	EA	\$ 1,700.00	\$ 142,049.29
Services Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	0	LF	\$ -	\$ -
8" Piping	14040	LF	\$ 57.88	\$ 812,640.00
6" Piping	1350	LF	\$ 43.33	\$ 58,500.00
Appurtenances ^a	1	LS	\$ 125,636.57	\$ 125,636.57
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
AC Pipe Removal	1300	LF	\$ 34.00	\$ 44,200.00
Trenchless Installation	1300	LF	\$ 66.25	\$ 86,125.00
SERVICES				
Service Retrofit to Front Yard	262	EA	\$ 1,700.00	\$ 446,150.71
Services Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
Subtotal				\$ 3,329,825.00
Contingencies			25%	\$ 832,456.25
Subtotal				\$ 4,162,281.25
Engineering, Admin, and Legal			10%	\$ 416,228.13
Subtotal				\$ 4,578,509.38
Environmental (Categorical Exemption)			1%	\$ 45,785.09
Estimated Cost				\$ 4,624,294.47

Rounded to:	\$ 4,624,200.00
--------------------	------------------------

Economic Impacts	
Outlay 2014	\$ 4,624,200.00
Annual Cost Factor 30 years @ 4.5% (0.0614)	\$ 283,925.88
Cost per Acre Foot Water/Year	\$ 169.00
Cost per Single Family ResidentialMonth	\$ 7.66

Del Paso Manor Water District
 Planned System Maintenance
 Phase 3
 2018-2022
Project 3A

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Construct (N) Well 6	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
(N) Block Wall	140	LF	\$ 104.00	\$ 14,560.00
Landscape	1	LS	\$ 10,000.00	\$ 10,000.00
Subtotal				\$ 1,124,560.00
Contingencies				25% \$ 281,140.00
Subtotal				<u>\$ 1,405,700.00</u>
Engineering, Admin, and Legal				10% \$ 140,570.00
Subtotal				<u>\$ 1,546,270.00</u>
Environmental (Categorical Exemption)				1% \$ 15,462.70
Estimated Cost				<u>\$ 1,561,732.70</u>

Rounded to:	\$ 1,562,000.00
--------------------	------------------------

Del Paso Manor Water District
Planned System Maintenance
Phase 3
2018-2022
Project 3B

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
PIPELINES				
12" Piping	4900	LF	\$ 85.96	\$ 421,200.00
8" Piping	0	LF	\$ -	\$ -
6" Piping	0	LF	\$ -	\$ -
Appurtenances ^a	1	LS	\$ 68,763.43	\$ 68,763.43
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	84	EA	\$ 1,700.00	\$ 142,049.29
Services Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -

Subtotal				\$ 632,012.72
Contingencies			25%	\$ 158,003.18
Subtotal				\$ 790,015.89
Engineering, Admin, and Legal			10%	\$ 79,001.59
Subtotal				\$ 869,017.48
Environmental (Categorical Exemption)			1%	\$ 8,690.17
Estimated Cost				\$ 877,707.66

Rounded to:	\$ 878,000.00
--------------------	----------------------

Del Paso Manor Water District
 Planned System Maintenance
 Phase 3
 2018-2022
Project 3C

Project Element	Quantity	Unit	Unit Cost	Extension
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	0	LF	\$ -	\$ -
8" Piping	14040	LF	\$ 57.88	\$ 812,640.00
6" Piping	1350	LF	\$ 43.33	\$ 58,500.00
Appurtenances ^a	1	LS	\$ 125,636.57	\$ 125,636.57
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
AC Pipe Removal	1300	LF	\$ 34.00	\$ 44,200.00
Trenchless Installation	1300	LF	\$ 66.25	\$ 86,125.00
SERVICES				
Service Retrofit to Front Yard	262.441597	EA	\$ 1,700.00	\$ 446,150.71
Services Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -

Subtotal				\$ 1,573,252.28
Contingencies			25%	\$ 393,313.07
Subtotal				\$ 1,966,565.36
Engineering, Admin, and Legal			10%	\$ 196,656.54
Subtotal				\$ 2,163,221.89
Environmental (Categorical Exemption)			1%	\$ 21,632.22
Estimated Cost				\$ 2,184,854.11

Rounded to:	\$ 2,185,000.00
--------------------	------------------------

Del Paso Manor Water District
Planned System Maintenance
Phase 4 - Summary
2022-2026

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish/Abandon (E) Well 2	1	LS	\$ 50,000.00	\$ 50,000.00
Demolish/Abandon (E) Well 3	1	LS	\$ 50,000.00	\$ 50,000.00
Demolish/Abandon (E) Well 4	1	LS	\$ 50,000.00	\$ 50,000.00
Construct (N) Well near Country Club	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
(N) Block Wall	140	LF	\$ 104.00	\$ 14,560.00
PIPELINES				
12" Piping	6880	LF	\$ 86.44	\$ 594,720.00
8" Piping	35500	LF	\$ 56.81	\$ 2,016,800.00
6" Piping	1550	LF	\$ 43.55	\$ 67,500.00
Appurtenances ^a	1	LS	\$ 340,310.17	\$ 340,310.17
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	407	EA	\$ 1,700.00	\$ 691,900.00
Services Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	4500	LF	\$ 87.20	\$ 392,400.00
8" Piping	20000	LF	\$ 56.96	\$ 1,139,200.00
6" Piping	100	LF	\$ 48.00	\$ 4,800.00
Appurtenances ^a	1	LS	\$ 175,089.83	\$ 175,089.83
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	381	EA	\$ 1,700.00	\$ 647,700.00
Services Existing Front Yard	75	EA	\$ 1,200.00	\$ 90,000.00
Meters	1692	EA	\$ 800.00	\$ 1,353,600.00
Land/Right of Way				
Well 4	1	LS	\$ 250,000.00	\$ 250,000.00
Subtotal				\$ 9,028,580.00
Contingencies			25%	\$ 2,257,145.00
Subtotal				\$ 11,285,725.00
Engineering, Admin, and Legal			10%	\$ 1,128,572.50
Subtotal				\$ 12,414,297.50
Environmental (Categorical Exemption)			1%	\$ 124,142.98
Estimated Cost				\$ 12,538,440.48

Rounded to: \$ 12,538,400.00

Economic Impacts	
Outlay 2014	\$ 12,538,400.00
Annual Cost Factor 30 years @ 4.5% (0.0614)	\$ 769,857.76
Cost per Acre Foot Water/Year	\$ 458.25
Cost per Single Family Residential Month	\$ 20.77

Del Paso Manor Water District
 Planned System Maintenance
 Phase 4
 2022-2026
Project 4A

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish/Abandon (E) Well 2	1	LS	\$ 50,000.00	\$ 50,000.00
Demolish/Abandon (E) Well 3	1	LS	\$ 50,000.00	\$ 50,000.00
Demolish/Abandon (E) Well 4	1	LS	\$ 50,000.00	\$ 50,000.00
Construct (N) Well near Country Club	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
(N) Block Wall	140	LF	\$ 104.00	\$ 14,560.00
Subtotal				\$ 1,264,560.00
Contingencies				25% \$ 316,140.00
Subtotal				<u>\$ 1,580,700.00</u>
Engineering, Admin, and Legal				10% \$ 158,070.00
Subtotal				<u>\$ 1,738,770.00</u>
Environmental (Categorical Exemption)				1% \$ 17,387.70
Estimated Cost				<u><u>\$ 1,756,157.70</u></u>

Rounded to:	\$ 1,756,000.00
--------------------	------------------------

Del Paso Manor Water District
 Planned System Maintenance
 Phase 4
 2022-2026
Project 4B

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
12" Piping	6880	LF	\$ 86.44	\$ 594,720.00
8" Piping	35500	LF	\$ 56.81	\$ 2,016,800.00
6" Piping	1550	LF	\$ 43.55	\$ 67,500.00
Appurtenances ^a	1	LS	\$ 340,310.17	\$ 340,310.17
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	407	EA	\$ 1,700.00	\$ 691,900.00
Services Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
Subtotal				\$ 3,711,230.17
Contingencies				25% \$ 927,807.54
Subtotal				\$ 4,639,037.71
Engineering, Admin, and Legal				10% \$ 463,903.77
Subtotal				\$ 5,102,941.48
Environmental (Categorical Exemption)				1% \$ 51,029.41
Estimated Cost				\$ 5,153,970.90

Rounded to: \$ 5,154,000.00

Del Paso Manor Water District
Planned System Maintenance
Phase 4
2022-2026
Project 4C

Project Element	Quantity	Unit	Unit Cost	Extension
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	4500	LF	\$ 87.20	\$ 392,400.00
8" Piping	20000	LF	\$ 56.96	\$ 1,139,200.00
6" Piping	100	LF	\$ 48.00	\$ 4,800.00
Appurtenances ^a	1	LS	\$ 175,089.83	\$ 175,089.83
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	381	EA	\$ 1,700.00	\$ 647,700.00
Services Existing Front Yard	75	EA	\$ 1,200.00	\$ 90,000.00
Subtotal				\$ 2,449,189.83
Contingencies				25% \$ 612,297.46
Subtotal				\$ 3,061,487.29
Engineering, Admin, and Legal				10% \$ 306,148.73
Subtotal				\$ 3,367,636.02
Environmental (Categorical Exemption)				1% \$ 33,676.36
Estimated Cost				\$ 3,401,312.38

Rounded to: \$ 3,401,000.00

Del Paso Manor Water District
 Planned System Maintenance
 Phase 4
 2022-2026
Project 4D

Project Element	Quantity	Unit	Unit Cost	Extension
METER INSTALLATION EFFORT				
SERVICES				
Meters	1692	EA	\$ 800.00	\$ 1,353,600.00
Subtotal				\$ 1,353,600.00
Contingencies				25% \$ 338,400.00
Subtotal				<u>\$ 1,692,000.00</u>
Engineering, Admin, and Legal				10% \$ 169,200.00
Subtotal				<u>\$ 1,861,200.00</u>
Environmental (Categorical Exemption)				1% \$ 18,612.00
Estimated Cost				<u><u>\$ 1,879,812.00</u></u>

Rounded to: \$ 1,880,000.00

Del Paso Manor Water District
Planned System Maintenance
Phase 5 Summary
2026-2030

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish (E) Well 8	1	LS	\$ 50,000.00	\$ 50,000.00
(N) Well at an undetermined site	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
(N) Pump Station Building	1	LS	\$ 106,000.00	\$ 106,000.00
PIPELINES				
12" Piping	0	LF	\$ -	\$ -
8" Piping	0	LF	\$ -	\$ -
6" Piping	0	LF	\$ -	\$ -
Appurtenances ^a	0	LS	\$ -	\$ -
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				
SERVICES				
Service Retrofit to Front Yard	0	EA	\$ 1,700.00	\$ -
Service Existing Front Yard	0	EA	\$ 1,200.00	\$ -
Meters	0	EA	\$ 800.00	\$ -
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	4500	LF	\$ 84.00	\$ 378,000.00
Appurtenances ^a	1	LS	\$ 66,600.00	\$ 66,600.00
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				

Subtotal				\$ 1,700,600.00
Contingencies			25%	\$ 425,150.00
Subtotal				\$ 2,125,750.00
Engineering, Admin, and Legal			10%	\$ 212,575.00
Subtotal				\$ 2,338,325.00
Environmental (Categorical Exemption)			1%	\$ 23,383.25
Estimated Cost				\$ 2,361,708.25

Rounded to:	\$ 2,361,700.00
--------------------	------------------------

Economic Impacts	
Outlay 2014	\$ 2,361,700.00
Annual Cost Factor 30 years @ 4.5% (0.0614)	\$ 145,008.38
Cost per Acre Foot Water/Year	\$ 86.31
Cost per Single Family Residential Month	\$ 3.91

Del Paso Manor Water District
 Planned System Maintenance
 Phase 5
 2026-2030
Project 5A

Project Element	Quantity	Unit	Unit Cost	Extension
BASELINE EFFORT				
WELLS				
Demolish (E) Well 8	1	LS	\$ 50,000.00	\$ 50,000.00
(N) Well at an undetermined site	1	LS	\$ 1,100,000.00	\$ 1,100,000.00
(N) Pump Station Building	1	LS	\$ 106,000.00	\$ 106,000.00

Subtotal				\$ 1,256,000.00
Contingencies			25%	\$ 314,000.00
Subtotal				\$ 1,570,000.00
Engineering, Admin, and Legal			10%	\$ 157,000.00
Subtotal				\$ 1,727,000.00
Environmental (Categorical Exemption)			1%	\$ 17,270.00
Estimated Cost				<u>\$ 1,744,270.00</u>

Rounded to:	\$ 1,744,000.00
--------------------	------------------------

Del Paso Manor Water District
 Planned System Maintenance
 Phase 5
 2026-2030
Project 5B

Project Element	Quantity	Unit	Unit Cost	Extension
METER INSTALLATION EFFORT				
PIPELINES				
12" Piping	4500	LF	\$ 84.00	\$ 378,000.00
Appurtenances ^a	1	LS	\$ 66,600.00	\$ 66,600.00
a Appurtenances include valves, fire hydrants, blow off assemblies and fittings				

Subtotal			\$ 444,600.00
Contingencies	25%		\$ 111,150.00
Subtotal			\$ 555,750.00
Engineering, Admin, and Legal	10%		\$ 55,575.00
Subtotal			\$ 611,325.00
Environmental (Categorical Exemption)	1%		\$ 6,113.25
Estimated Cost			<u>\$ 617,438.25</u>

Rounded to:	\$ 617,000.00
--------------------	----------------------

EXHIBIT 7



December 1, 2021

Hon. Russell L. Hom, Presiding Judge
Sacramento County Superior Court
720 9th Street
Sacramento, CA 95814

Dear Judge Hom,

The Sacramento Local Agency Formation Commission has received the recent Grand Jury Report, titled "Del Paso Manor Water District Flooded with Public Safety Dangers." On behalf of this Commission, I thank you for the opportunity to comment.

Sacramento LAFCo has carefully considered the report, the methodology, its findings and each of the recommendations submitted by the Grand Jury. The report specifically requests that LAFCo respond to Recommendation R3, which reads,

R3: A Municipal Service Review should be performed by LAFCO to study and analyze information about the Water District's governance structures and efficiencies. The Grand Jury also recommends that DPMWD fully cooperate with LAFCO to initiate this process by January 31, 2022 for completion of a new Municipal Service Review by June 30, 2022.

Response: Sacramento LAFCo agrees with this finding.

Explanation: Sacramento LAFCo can have a role to play in ensuring that the constituents of Del Paso Manor Water District receive safe drinking water and will definitely be involved if there has to be some type of governmental reorganization as part of the solution. Sacramento LAFCo also pledges to devote the necessary resources to complete the MSR in a timely manner.


LAFCo does request that the Grand Jury consider an adjusted timeline for the completion of the MSR. As you are aware, a municipal service review covers many topics. The MSR is not limited in its discussion to governance; it also includes finances and service capability and capacity. Among other things, the Grand Jury is recommending that Del Paso Manor WD complete an infrastructure improvement plan (Recommendation R1) "within six months" and a Consumer Confidence Report (Recommendation R5) by "May 2022."

The information contained in those reports would be extremely useful and valuable to include in the MSR. As a result, LAFCo recommends adjusting the MSR start date to May 2022. The MSR can incorporate the findings of what would be at that time the nearly-completed infrastructure plan, the completed CCR and any other materials Del Paso Manor WD will produce in the next few months. The adjusted timelines puts the completion of the MSR to November 2022.

LAFCo will use the time in the first quarter of 2022 to start the preparation work on the MSR. In addition, LAFCo will be setting up a process to work with the District through a series of meetings in order to assist in completing the necessary tasks. We have already reached out to the District and will discuss the next steps at our December LAFCo meeting.

We thank the Grand Jury for its time and attention to this matter.

Regards,



Chris Little
Chair

cc: Ginger Derham, Jury Commissioner
Erendira Tapia-Bouthillier, Grand Jury

EXHIBIT 8



**SPECIAL MEETING OF THE BOARD OF DIRECTORS
DEL PASO MANOR WATER DISTRICT**

**December 10, 2021 6:30 PM
1817 Maryal Drive, Suite 300, Sacramento 95864**

The Del Paso Manor Water District Board of Directors meeting will be conducted virtually pursuant to the provisions of Assembly Bill 361 amending the Ralph M. Brown Act and Government Code Section 54953(e) and without compliance with Section 54953(b)(3) related to conducting public meetings during the COVID-19 pandemic based on the current State recommendations on social distancing.

Note: Given the state of emergency regarding the threat of COVID-19, the meeting will be held via teleconference only. Members of the public may call into the teleconference to participate. The District will also accept written public comment letters that are emailed to victoria@delpasomanorwd.org. Please include the specific agenda item and date of the meeting in the subject line of your email.

We encourage Board members and participants to join the teleconference 15 minutes early. Due to high call volumes, we ask that Board members and participants retry calling in if there is a busy signal or if you cannot successfully connect to the meeting when you call in.

Teleconference Information:

Join Zoom Meeting Link:

<https://zoom.us/j/97737667936?pwd=NnBxVmswRnRrZXVSVGhZbWd2b0FFUT09>

Meeting ID: 977 3766 7936 Passcode: 473630

Dial By Phone

US (SAN JOSE) +1 669 900 6833

US (TACOMA) +1 253 215 8782

A G E N D A

1. CALL TO ORDER:

2. ROLL CALL:

Chairman: Saunders
Directors: Dolk
Macias
Matteoli
Pratt

2157928.1 14685-001

3. ADOPTION OF AGENDA: Members may pull an item from the agenda.

4. PUBLIC COMMENTS: The Board of Directors welcomes participation at these meetings. Matters under the jurisdiction of the Board that are not posted on the agenda may be addressed by the public, California law prohibits the Board from acting on any matter which is not on the posted agenda, unless the members determines that it is an emergency or other situation specified in Government Code Section 54954.2. Public comments are limited to five (5) minutes per individual. Please make your comments directly to the DPMWD Chair. Comments will be accepted via teleconference and in writing.

5. CONSENT CALENDAR: All items under Consent Calendar will be considered together by one action of the Board, any Member or members of the public may request that an item be removed and considered separately.

Item 5.A: Approval of Warrants

Recommendation: Approval of Warrants

6. PUBLIC HEARING:

7. NEW BUSINESS:

Item 7.A: Review of May 2021 HydroScience Strategic Water Solutions Technical Memorandum.

Pursuant to the November 5, 2021 Grand Jury Report, discussion of the findings and recommendations of the May 2021 HydroScience Strategic Water Solutions Technical Memorandum, originally authorized by the DPMWD as a Proposed Update to its 2009 Water District Master Plan and request for public comment.

Recommendation: Allow staff to provide a presentation on the findings and recommendations of the May 2021 HydroScience Strategies Water Solutions Technical Memorandum, and provide staff with direction on next steps for the District to address such findings and recommendations, including, but not limited to prioritizing projects for the Engineering firm to be retained.

8. DIRECTORS COMMENTS: Verbal information, non-action comments.

9. GENERAL MANAGERS COMMENTS: Verbal report


10. ADJOURNMENT: Next Regular Board of Directors meeting is scheduled for January 4th, 2022

CERTIFICATION OF POSTING:

I, Victoria Hoppe, Secretary of the Board of the Del Paso Manor Water District, do hereby declare under penalty of perjury that the foregoing agenda for the Regular meeting of the Board of Directors has been posted at the administrative office, and District website of the District and at least 24 hours prior to the meeting date.

Date Posted: __December 9, 2021

Time posted: 6:30 p.m.

Signature: 
Secretary of the Board of Directors
Del Paso Manor Water District

OTHER IMPORTANT INFORMATION

The Board will discuss all items on its agenda, and may take action on any of those items, including information items and continued items. The Board may also discuss other items that do not appear on its agenda but will not act on those items unless action is urgent, and a resolution is passed by two-thirds (2/3) vote declaring the need for action arose after posting of the agenda.

This agenda has been prepared and posted in compliance with the provisions of the Ralph M. Brown Act, and specifically the provisions of Sections 54954.2 and 54954.3 of the Government Code. Board action may occur on any identified agenda item. Any member of the public may address the Board on any identified agenda item of interest after board discussion has ended on that item, and if there is a motion, before the vote is taken. Public comment on items within the jurisdiction of the Board is welcomed, subject to reasonable time limitations for each speaker.

PUBLIC COMMENTS: If you would prefer to submit public comments in writing, please email your comments to Victoria@delpasomanorwd.org if you are commenting on a specific agenda item, or items, please state the agenda item number(s) in the subject line of the email. All comments received via email will be provided to the Board in writing and included as part of the record of the meeting.

DISABLED OR SPECIAL NEEDS ACCOMMODATION:



In compliance with the Americans with Disabilities Act, Del Paso Manor Water District encourages those with disabilities to participate fully in the public hearing process. If you have a special need in order to allow you to attend or participate in our public meeting and public hearing processes, including receiving notices, agendas, and other writings in appropriate alternative formats, please contact our office at (916) 487-0419 at least 72 hours in advance of the public meeting or hearing you wish to attend so that we may make every reasonable effort to accommodate you.



DEL PASO MANOR WATER DISTRICT BOARD MEETING STAFF REPORT

MEETING DATE: December 10, 2021

AGENDA ITEM 7.A Review of May 2021 HydroScience Strategic Water Solutions Technical Memorandum.

Allow staff to provide a presentation on the findings and recommendations of the May 2021 HydroScience Strategies Water Solutions Technical Memorandum, and provide staff with direction on next steps for the District to address such findings and recommendations, including, but not limited to prioritizing projects for the Engineering firm recently retained.

EXECUTIVE SUMMARY:

Pursuant to the November 5, 2021 Grand Jury Report, discussion of the findings and recommendations of the May 2021 HydroScience Strategic Water Solutions Technical Memorandum, originally authorized by the DPMWD as a Proposed Update to its 2009 Water District Master Plan and request for public comment.

STAFF REPORT:

Background:

I. Grand Jury Report

The Sacramento County Grand Jury published a report on or around November 5, 2021 that addressed the Del Paso Manor Water District (DPMWD) operations and activities.

On December 2, 2021, the District's new General Counsel sought additional clarification and a request for extension from the Grand Jury, due to the new leadership of the District and time constraints in providing a meaningful response. (See Attachment 1). On December 3, 2021, the Grand Jury responded to the District's request and allowed the preparation of one consolidated response, to be due on or before February 4, 2021. (See Attachment 2).

Notwithstanding this time extension, the Grand Jury Report required the District

to act on some recommendations before that deadline.

Included as part of its Recommendations was:

Recommendation R2: The DPMWD should address the findings and recommendations of the May 2021 HydroScience Strategic Water Solutions Technical Memorandum, originally authorized by the DPMWD as a Proposed Update to its 2009 Water District Master Plan; formal public involvement should be documented to meet the requirements of the Brown Act. This process should begin immediately and be completed within 60 days.

Pursuant to this recommendation, staff recommends a discussion of the May 2021 HydroScience Technical Memorandum, a copy which may be obtained on the District's website at:

<https://www.delpasomanorwd.org/files/be3933fc6/Board+Packet+01JUN21.pdf>, and also available in hard copy at the District's offices for inspection.

II. 2021 HydroScience Technical Memorandum

On October 20, 2020 the District retained HydroScience to perform their proposed September 22, 2020 limited update to its Master Plan for \$56,830. There were undocumented changes to the September 22, 2020 proposal that were not preserved in writing such as not performing the surface water analysis listed on page 9, excluding any discussion of ultimate replacement of the 1945 circa iron pipes, and the need to mention the plume under well 8 and allocating money to study the extent of the plume for possible outside monies to remediate it. If HydroScience were to amend the Technical Memo to include exhibits with this information that could cure the issues raise by the Board and staff.

The contract was executed on November 12, 2020. HydroScience was charged with "creating a supplemental but comprehensive update that provides the District the flexibility to make decisions now and in the future."

HydroScience prepared a technical memorandum which was then distributed to the then-board of directors.

The technical memorandum represented an amendment to the District's 2009 Water Master Plan (2009 WMP) to document data, policies, projects, and strategies that have been completed or updated in the intervening 11 years and provided a roadmap for reaching new policy and vision goals.

The District's water system is comprised of buried water mains, eight (8) groundwater wells, and individual service connections, and has generally been in continuous service for over 65 years. Since 2009, two wells were abandoned, two wells were developed and equipped as replacements, one well has been taken offline indefinitely due to contamination, another was placed on standby

due to high contaminant levels, and one well is being monitored for rising contaminant levels.

There are approximately 1800 water connections, of which 100 are commercial. This means that 95% of the connections are residential; however, based on water demands, commercial uses more water. Residential water use of 768,816 gpd represented approximately 49% of all water delivered while commercial/industrial/institutional represented 51%. The largest single water use account was the cooling towers at AT&T.

The TM updated specific aspects of the 2009 WMP as follows:

- Water demands and planning criteria.
- Water supply and wells.
- Hydraulic modeling utilizing updated system flow criteria to determine pipe and hydrant deficiencies.
- Identification of near term (0-5 years) prioritized projects to address the most significant deficiencies.
- Longer-term recommendations for additional studies and projects.

The 2021 Amendment did not commit the ratepayer to any specific discretionary action in order to implement policy goals, nor did the District implement any. The report is up for discussion tonight and amendments are recommended by staff as noted above.

In addition to updating the data and facilities to represent current conditions, the TM presented a preliminary Capital Improvement Plan (CIP) for near-term system improvements to supplement the longer-range improvements in the 2009 WMP.

III. DPMWD Next Steps and Recommendations

During its December 7, 2021 Board meeting, the Board directed staff to publish a Request for Proposals/Qualifications for Engineering Services. Included within that scope of work was design engineering services related to potable water facilities, including pipelines, pump stations, tanks, dams, and diversion facilities. Furthermore, the prospective engineering company will be asked to assist with support services during bidding and construction, and task orders would be issued by the General Manager to effectuate projects.

Staff recommends that once the District retains and approves a contract for said Engineering Firm, that they peer review the 2021 Technical Memorandum and advise the District on high priority, medium priority, and low priority projects in comparison to what was set forth in the Technical Memorandum, and then assist with implementing high priority projects.

Staff expects that high priority projects will include rehabilitation of Well 7 to

increase use from standby/emergency use to regular use, and the potential repair of Wells 2 and 4, among other projects. Well 8 has been taken offline indefinitely due to exceedances of the maximum contaminant level (MCL) for tetrachloroethylene (PCE) and staff does not recommend bringing that well back online for those reasons unless the plume is remediated. Well 5, which is in the same general vicinity, is being monitored to ensure that it is not impacted by the PCE plume migration from the McClellan Air Base, but staff supports the TM's recommendation to inspect and repair the casing hole as an intermediate priority. Following the State Water Resources Control Board inspection and 2019 report, Well 3's status was changed from active to standby/emergency due to exceedances of the MCL for 1,2,3 Trichloro propane (TCP). Additional testing will be required in order to apply for a change in status back to active and increasing the pedestal height to at least 18 inches may resolve this issue altogether.

Despite many of the District's wells being offline, its well system firm capacity (with Well 9 on standby) is 3,075 gpm, which is greater than the updated MDD of 1,396 gpm. Therefore, the District meets this waterworks standard.

The District must work on addressing Maximum Day and Fire Flow demands for the Commercial District, since it does not have a storage tank in its distribution system and the well capacity cannot meet the 3,500 gpm requirements for both the AT&T and WinCo facilities. Short term recommendations include the potential use of emergency water from its Mutual Aid Assistance agreement with Sacramento Suburban Water District or drilling a new well at Oroville Wright Park until such time that the District may make use of its surface water rights, or bring standby and inactive wells back online. However, the District has started the rehabilitation of Wells 2 and 4, and is doing the preliminary work to upgrade Well 7 to fully active.

Even though the District is considered a "Small Water District" and not an "Urban Water Supplier" and is not subject to Assembly Bill 2572, requiring metering of all connections, since the District is a signator to the Water Forum Agreement, it has agreed to convert all water connections to meters by 2030. At present, only commercial properties and multi-family connections are metered.

These immediate projects will ensure that the District has sufficient water for its customers in the near and immediate future. Once high priority projects are addressed, the District can begin working on medium and low priority projects to ensure efficiency and long-term viability. For example, as part of medium priority, the District can install additional fire hydrants. As part of important but lower priority projects, while the District has surface water rights to the American River, it has not been able to use such water due to the lack of infrastructure that would transmit to the water to the District jurisdiction.

ENVIRONMENTAL CONSIDERATIONS:

Consideration of the May 2021 HydroScience report is itself not a project under the California Environmental Quality Act. However, any future projects to implement improvements or repairs will be analyzed at the time of approval.

ATTACHMENTS:

1. December 2, 2021 Kronick Letter to Grand Jury
2. December 3, 2021 Grand Jury Email Allowing Consolidated Response
3. November 5, 2021 Grand Jury Report (available at <https://www.saccourt.ca.gov/grand-jury/docs/reports/21-22/dpmwd-investigative-report-110521.pdf>).
4. May 2021 HydroScience Strategic Water Solutions Technical Memorandum (available at <https://www.delpasomanorwd.org/files/be3933fc6/Board+Packet+01JUN21.pdf>)

STAFF RESPONSIBLE FOR REPORT: Alan Gardner, General Manager

12-10-2021

Date